

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902501

Luminaire Tested: DFN2DIP-HX2F0-060D020US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902501
REPORT IS A COMBINATION OF REPORTS P900680 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D020US830-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6673.2 lumens
Efficiency: N/A
Efficacy: 89.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 74.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLLONL

Luminous Intensity Polar Plot

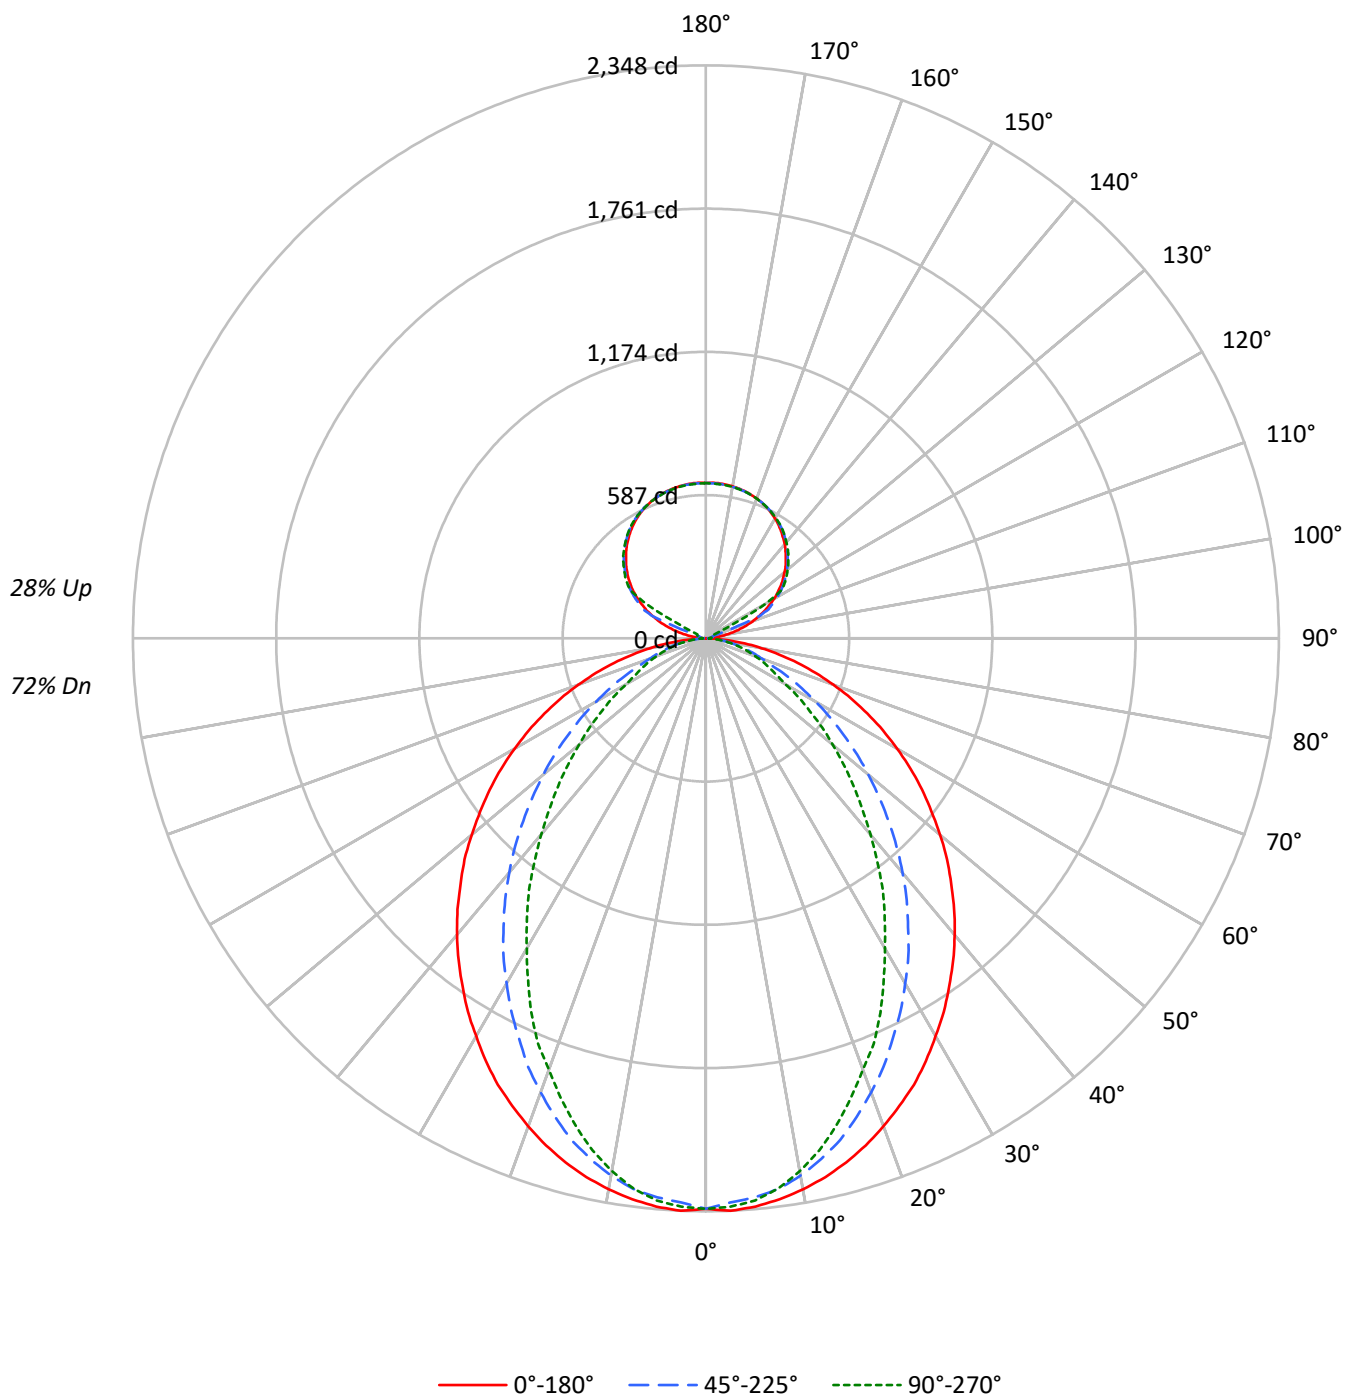

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	107	107	107	107	96	96	96	86	86	86	76	76	76
1	103	99	95	92	98	94	91	88	85	82	80	76	75	73	69	67	66
2	95	87	81	76	90	83	78	73	75	71	68	68	65	62	61	59	57
3	87	78	70	65	82	74	67	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	54	60	54	50	55	50	46	50	46	43
5	74	62	54	48	70	59	52	47	54	48	44	50	45	41	45	41	38
6	68	56	48	42	65	54	46	41	49	43	39	45	40	36	41	37	34
7	63	51	43	38	60	49	42	36	45	39	34	41	36	32	38	34	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	27
9	55	43	35	30	52	41	34	30	38	32	28	35	30	26	32	28	25
10	52	40	32	28	49	38	31	27	35	29	25	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5507	5507	5507
5°	5507	5406	5444
10°	5444	5288	5257
15°	5360	5100	4974
20°	5252	4847	4630
25°	5142	4566	4298
30°	4996	4279	3881
35°	4853	3971	3514
40°	4707	3654	3096
45°	4539	3305	2718
50°	4364	2953	2349
55°	4180	2579	1995
60°	3967	2190	1632
65°	3721	1797	1458
70°	3423	1429	1306
75°	3048	1235	1168
80°	2508	1000	983
85°	1641	618	690

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4539 cd/sqm

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	3.3
10°-20°	601.3	9.0
20°-30°	844.3	12.7
30°-40°	920.3	13.8
40°-50°	845.9	12.7
50°-60°	664.3	10.0
60°-70°	432.4	6.5
70°-80°	222.6	3.3
80°-90°	57.9	0.9
90°-100°	21.0	0.3
100°-110°	78.2	1.2
110°-120°	207.4	3.1
120°-130°	344.0	5.2
130°-140°	365.4	5.5
140°-150°	339.6	5.1
150°-160°	273.0	4.1
160°-170°	175.9	2.6
170°-180°	60.6	0.9
0°-30°	1664.7	24.9
0°-40°	2585.0	38.7
0°-60°	4095.1	61.4
0°-90°	4808.1	72.1
90°-120°	306.6	4.6
90°-150°	1355.6	20.3
90°-180°	1865.0	27.9
0°-180°	6673.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	0	6	9	12	12	6
95°	30	15	18	20	20	35
105°	140	154	28	33	35	150
115°	265	272	284	71	38	261
125°	374	380	389	392	394	334
135°	463	470	475	479	478	358
145°	537	537	545	548	546	336
155°	592	587	593	596	592	273
165°	623	621	622	625	622	176
175°	638	634	635	638	634	61
180°	636	636	636	636	636	

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	0.5	5.6	9.1	11.5	12.4
92.5°	11.5	9.7	11.0	12.0	12.4
95°	29.9	14.7	17.9	20.3	19.8
97.5°	53.8	16.1	23.5	24.9	25.4
100°	81.5	18.4	26.2	29.9	30.8
102.5°	111.9	110.9	27.1	32.2	33.6
105°	140.0	153.7	28.1	33.1	35.0
107.5°	172.7	184.1	29.0	34.0	35.9
110°	204.0	213.6	80.6	34.6	36.4

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	233.4	241.7	233.8	35.4	36.9
115°	264.7	272.5	284.1	70.9	37.8
117.5°	291.8	301.0	308.9	243.1	122.4
120°	322.3	329.1	337.4	343.0	280.8
122.5°	348.0	355.3	364.6	367.3	367.9
125°	374.3	380.2	389.0	392.2	393.6
127.5°	398.2	404.6	411.6	416.1	416.6
130°	420.8	428.1	433.2	438.3	437.8
132.5°	443.7	449.8	454.8	458.9	458.5
135°	463.2	470.5	474.6	479.3	478.3
137.5°	483.3	488.9	493.5	498.1	496.7
140°	503.1	506.9	511.9	516.0	513.8
142.5°	519.7	523.0	529.0	532.6	530.3
145°	537.2	536.8	544.6	547.8	545.5
147.5°	552.4	551.0	558.8	561.1	559.3
150°	567.1	563.9	571.3	574.0	571.7
152.5°	579.6	575.9	582.8	585.6	582.3
155°	591.5	587.4	593.0	595.7	592.0
157.5°	601.2	597.6	601.7	604.9	601.2
160°	609.5	606.7	609.5	612.3	609.1
162.5°	616.8	614.1	616.4	619.6	615.5
165°	623.3	620.6	621.9	625.2	621.9
167.5°	628.4	625.6	627.0	630.3	626.0
170°	632.5	629.7	630.7	633.9	629.7
172.5°	635.3	632.5	633.5	636.7	632.5
175°	637.5	634.3	635.3	638.5	633.9
177.5°	638.5	635.3	635.7	638.9	634.8
180°	636.2	636.2	636.2	636.2	636.2

TEST NUMBER: P902501

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.79	15.84	15.54	16.60	17.52	10.77	11.82	11.52	12.59	13.51
	3H	16.46	17.40	17.22	18.17	19.12	11.96	12.90	12.72	13.67	14.63
	4H	17.06	17.94	17.84	18.73	19.69	12.41	13.29	13.19	14.08	15.04
	6H	17.47	18.29	18.26	19.08	20.06	12.73	13.54	13.52	14.33	15.31
	8H	17.59	18.37	18.40	19.18	20.16	12.81	13.59	13.62	14.40	15.38
	12H	17.65	18.39	18.46	19.20	20.20	12.86	13.60	13.67	14.40	15.41
4H	2H	14.83	15.71	15.61	16.50	17.46	11.38	12.26	12.16	13.05	14.01
	3H	16.65	17.38	17.45	18.20	19.18	12.73	13.46	13.53	14.28	15.26
	4H	17.33	18.00	18.14	18.82	19.82	13.27	13.94	14.08	14.76	15.76
	6H	17.83	18.41	18.66	19.25	20.27	13.68	14.26	14.51	15.10	16.12
	8H	18.00	18.54	18.83	19.37	20.40	13.81	14.34	14.64	15.18	16.21
	12H	18.09	18.57	18.94	19.43	20.46	13.87	14.36	14.72	15.21	16.25
8H	4H	17.31	17.85	18.14	18.69	19.71	13.55	14.09	14.38	14.93	15.95
	6H	17.86	18.30	18.72	19.18	20.21	14.06	14.50	14.91	15.38	16.41
	8H	18.06	18.45	18.93	19.33	20.37	14.23	14.63	15.10	15.50	16.55
	12H	18.19	18.54	19.06	19.40	20.50	14.35	14.70	15.22	15.56	16.66
12H	4H	17.27	17.75	18.12	18.61	19.64	13.56	14.05	14.41	14.91	15.94
	6H	17.83	18.23	18.70	19.10	20.15	14.10	14.49	14.97	15.37	16.41
	8H	18.04	18.39	18.92	19.26	20.36	14.30	14.65	15.17	15.52	16.62

END OF REPORT