

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905193

Luminaire Tested: DFN2DIP-HX2F0-040D030US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905193
REPORT IS A COMBINATION OF REPORTS P900686 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D030US835-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6370.0 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 57.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLLONL

Luminous Intensity Polar Plot

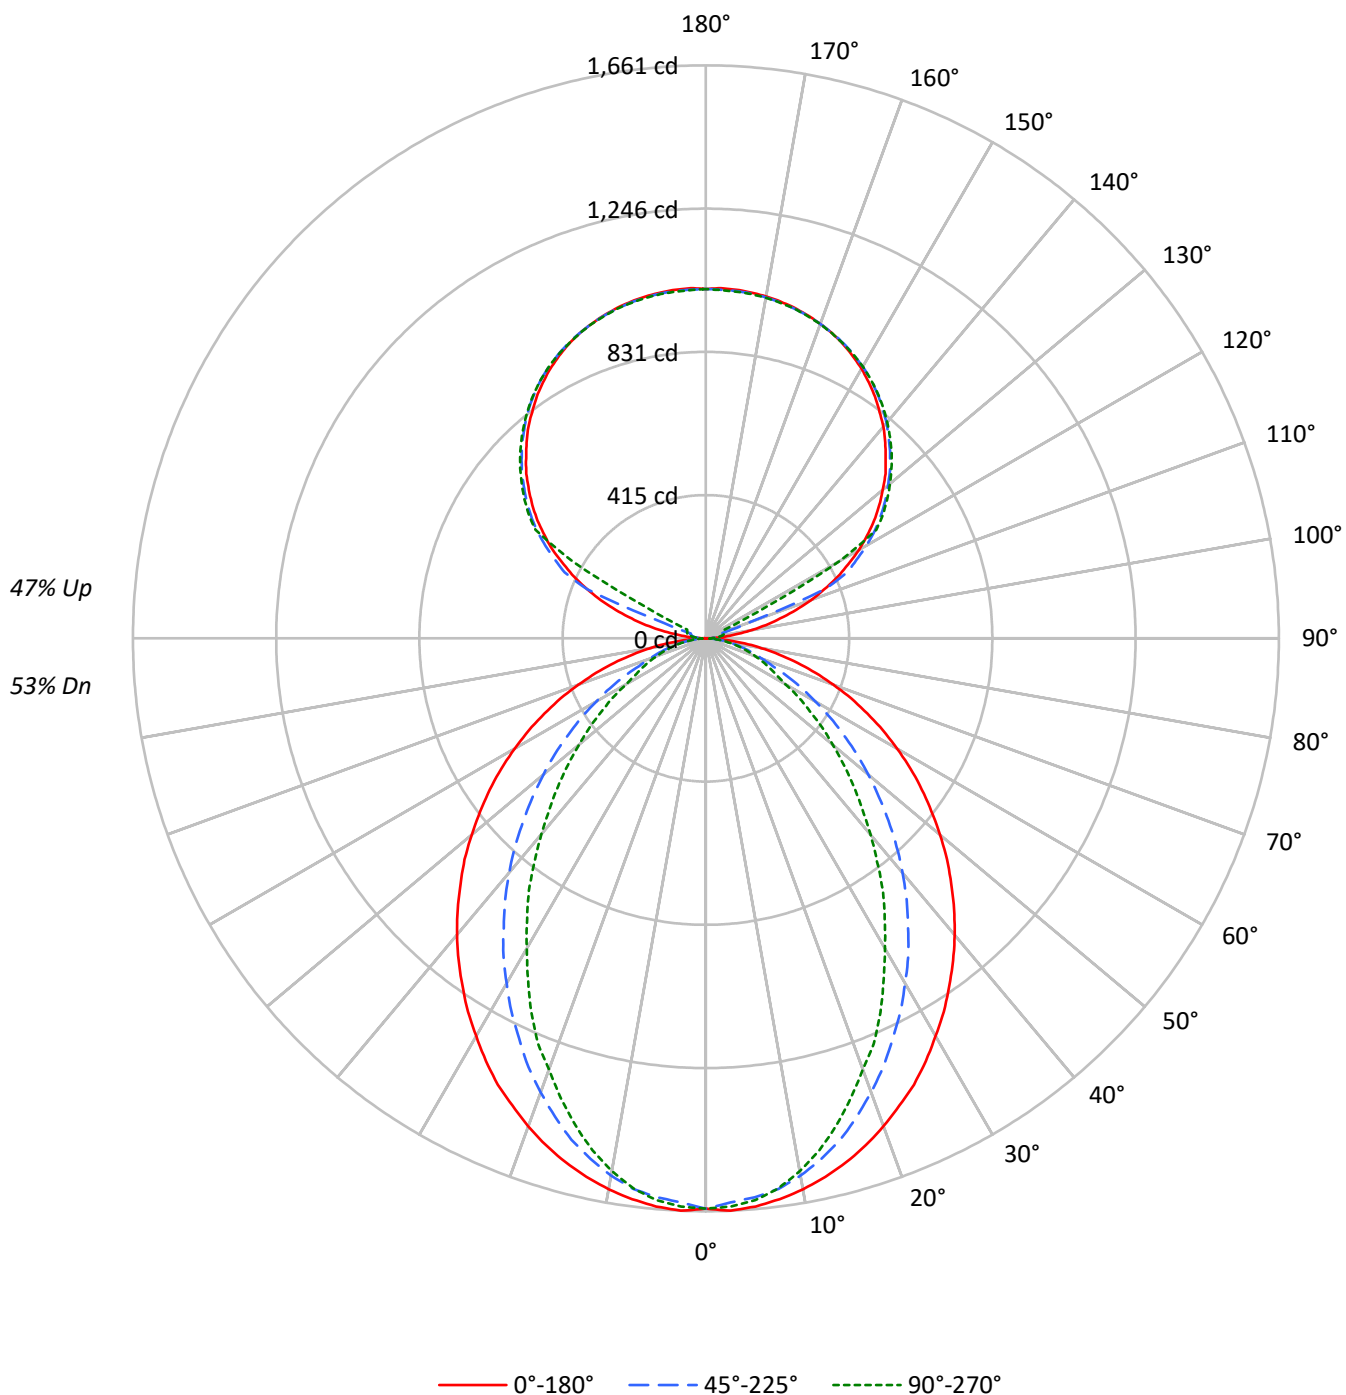

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	108	108	108	108		100	100	100	100		85	85	85		72	72	72		59	59	59
1	99	95	91	88		92	88	85	82		76	73	71		64	62	61		53	52	51
2	91	83	78	73		84	78	73	68		67	63	60		57	54	52		47	45	44
3	83	74	67	61		77	69	63	58		59	55	51		51	47	44		42	40	38
4	76	66	58	52		70	61	55	49		53	48	44		45	42	38		38	35	33
5	70	59	51	45		65	55	48	43		48	42	38		41	37	34		35	32	29
6	65	53	45	39		60	50	43	37		43	38	34		37	33	30		32	28	26
7	60	48	40	35		56	45	38	33		39	34	30		34	30	26		29	26	23
8	56	44	36	31		52	41	34	29		36	31	27		31	27	24		27	24	21
9	52	40	33	28		48	38	31	26		33	28	24		29	25	22		25	22	19
10	49	37	30	25		45	35	28	24		31	25	22		27	23	20		23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3895	3895	3895
5°	3895	3824	3851
10°	3851	3740	3718
15°	3791	3607	3518
20°	3715	3428	3275
25°	3637	3229	3040
30°	3534	3026	2745
35°	3433	2809	2486
40°	3330	2585	2190
45°	3210	2338	1922
50°	3086	2089	1661
55°	2957	1824	1411
60°	2806	1549	1155
65°	2632	1270	1031
70°	2421	1011	923
75°	2155	873	826
80°	1774	707	696
85°	1161	437	488

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3210 cd/sqm

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	154.9	2.4
10°-20°	425.3	6.7
20°-30°	597.2	9.4
30°-40°	650.9	10.2
40°-50°	598.3	9.4
50°-60°	469.9	7.4
60°-70°	305.8	4.8
70°-80°	157.4	2.5
80°-90°	42.0	0.7
90°-100°	33.4	0.5
100°-110°	124.4	2.0
110°-120°	330.1	5.2
120°-130°	547.5	8.6
130°-140°	581.5	9.1
140°-150°	540.5	8.5
150°-160°	434.5	6.8
160°-170°	280.0	4.4
170°-180°	96.4	1.5
0°-30°	1177.4	18.5
0°-40°	1828.4	28.7
0°-60°	2896.5	45.5
0°-90°	3401.8	53.4
90°-120°	487.9	7.7
90°-150°	2157.3	33.9
90°-180°	2968.0	46.6
0°-180°	6370.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1653	1653	1653	1653	1653	
5°	1653	1646	1626	1640	1635	157
15°	1572	1556	1505	1477	1462	443
25°	1427	1379	1281	1219	1197	656
35°	1230	1154	1022	928	895	770
45°	1005	905	748	642	606	776
55°	764	648	486	396	368	683
65°	516	395	260	210	205	512
75°	275	170	120	109	108	291
85°	64	33	28	28	28	74
90°	1	9	15	18	20	6
95°	48	23	28	32	32	56
105°	223	245	45	53	56	238
115°	421	434	452	113	60	415
125°	596	605	619	624	626	531
135°	737	749	755	763	761	569
145°	855	854	867	872	868	535
155°	941	935	944	948	942	434
165°	992	988	990	995	990	280
175°	1015	1010	1011	1016	1009	97
180°	1012	1012	1012	1012	1012	

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1653.2	1653.2	1653.2	1653.2	1653.2
2.5°	1660.7	1653.2	1636.7	1651.8	1648.7
5°	1653.2	1645.7	1626.2	1639.7	1635.3
7.5°	1639.7	1630.8	1609.9	1615.7	1608.3
10°	1621.8	1611.3	1581.4	1576.8	1568.0
12.5°	1599.4	1585.9	1545.4	1536.5	1520.0
15°	1572.4	1555.9	1505.1	1476.7	1461.8
17.5°	1541.0	1517.0	1454.1	1421.3	1397.3
20°	1505.1	1475.1	1400.3	1363.0	1330.0
22.5°	1466.2	1431.8	1344.9	1294.1	1271.8
25°	1427.3	1379.4	1280.6	1219.4	1196.8
27.5°	1381.0	1330.0	1220.8	1150.5	1116.0
30°	1331.6	1274.6	1154.9	1078.7	1038.3
32.5°	1283.7	1214.8	1092.2	1002.4	964.9
35°	1229.9	1153.5	1021.9	927.6	894.6
37.5°	1177.5	1095.1	956.0	852.7	815.4
40°	1122.1	1032.4	887.2	781.0	742.1
42.5°	1065.2	969.5	818.4	707.6	670.3
45°	1005.4	905.1	748.1	641.8	605.9
47.5°	948.6	842.4	680.8	574.5	541.6
50°	885.7	779.5	614.9	511.6	480.3
52.5°	824.3	712.1	552.1	453.3	424.9
55°	764.5	647.8	486.2	396.5	368.1
57.5°	703.2	583.5	427.9	344.1	320.2
60°	640.3	520.6	366.5	290.3	266.4
62.5°	579.1	459.4	314.1	242.4	230.5
65°	516.2	394.9	260.3	209.5	204.9
67.5°	456.4	335.1	209.5	184.0	179.5
70°	393.5	276.8	173.5	158.6	152.5
72.5°	333.7	222.9	145.1	133.2	130.2
75°	275.2	170.5	119.7	109.2	107.8
77.5°	217.0	121.1	94.3	88.3	85.2
80°	163.0	86.8	71.7	65.9	65.9
82.5°	113.7	58.4	49.4	46.3	46.3
85°	64.3	32.9	28.4	28.4	28.4
87.5°	24.0	11.9	11.9	10.5	10.5
90°	0.7	8.8	14.6	18.4	19.7
92.5°	18.4	15.4	17.6	19.1	19.7
95°	47.6	23.4	28.5	32.3	31.5
97.5°	85.7	25.7	37.3	39.6	40.3
100°	129.7	29.3	41.8	47.6	49.1
102.5°	178.0	176.6	43.2	51.2	53.5
105°	222.7	244.7	44.7	52.7	55.7
107.5°	274.7	293.0	46.2	54.2	57.2
110°	324.6	339.9	128.2	55.0	57.9

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	371.5	384.6	372.2	56.4	58.6
115°	421.2	433.7	452.0	112.8	60.1
117.5°	464.5	479.1	491.6	386.8	194.9
120°	512.8	523.8	537.0	545.8	446.9
122.5°	553.8	565.6	580.3	584.6	585.4
125°	595.6	605.1	619.1	624.2	626.4
127.5°	633.7	643.9	655.0	662.3	663.0
130°	669.6	681.4	689.4	697.4	696.8
132.5°	706.2	715.8	723.8	730.4	729.7
135°	737.0	748.8	755.3	762.7	761.2
137.5°	769.2	778.0	785.4	792.7	790.5
140°	800.7	806.6	814.6	821.2	817.6
142.5°	827.2	832.3	841.8	847.6	844.0
145°	855.0	854.2	866.7	871.8	868.1
147.5°	879.1	876.9	889.4	893.0	890.1
150°	902.6	897.5	909.2	913.5	909.9
152.5°	922.3	916.5	927.5	931.9	926.8
155°	941.4	934.9	943.6	948.0	942.2
157.5°	956.8	951.0	957.6	962.7	956.8
160°	970.0	965.6	970.0	974.4	969.2
162.5°	981.7	977.3	981.0	986.1	979.5
165°	991.9	987.6	989.8	994.9	989.8
167.5°	1000.0	995.6	997.8	1003.0	996.4
170°	1006.6	1002.2	1003.7	1008.8	1002.2
172.5°	1011.0	1006.6	1008.1	1013.2	1006.6
175°	1014.6	1009.5	1011.0	1016.1	1008.8
177.5°	1016.1	1011.0	1011.8	1016.9	1010.3
180°	1012.5	1012.5	1012.5	1012.5	1012.5

TEST NUMBER: P905193

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.05	12.91	12.98	13.85	15.08	8.03	8.89	8.96	9.83	11.06
	3H	13.70	14.47	14.65	15.43	16.67	9.20	9.97	10.15	10.93	12.18
	4H	14.29	15.02	15.25	15.98	17.24	9.64	10.37	10.60	11.33	12.59
	6H	14.70	15.36	15.67	16.33	17.60	9.95	10.62	10.92	11.59	12.85
	8H	14.81	15.45	15.79	16.43	17.70	10.03	10.67	11.01	11.65	12.92
	12H	14.87	15.47	15.85	16.45	17.74	10.07	10.68	11.05	11.65	12.94
4H	2H	12.06	12.79	13.03	13.75	15.01	8.61	9.34	9.58	10.30	11.56
	3H	13.87	14.47	14.84	15.46	16.73	9.95	10.55	10.92	11.54	12.81
	4H	14.54	15.09	15.53	16.08	17.37	10.48	11.03	11.47	12.02	13.31
	6H	15.03	15.51	16.03	16.52	17.81	10.88	11.36	11.88	12.37	13.66
	8H	15.20	15.64	16.19	16.64	17.95	11.00	11.45	12.00	12.45	13.75
	12H	15.28	15.68	16.29	16.69	18.01	11.06	11.46	12.08	12.48	13.79
8H	4H	14.51	14.95	15.51	15.95	17.26	10.75	11.19	11.75	12.19	13.50
	6H	15.05	15.41	16.07	16.45	17.76	11.25	11.61	12.27	12.65	13.96
	8H	15.25	15.57	16.28	16.60	17.92	11.42	11.74	12.45	12.77	14.10
	12H	15.37	15.65	16.40	16.68	18.05	11.53	11.81	12.56	12.84	14.20
12H	4H	14.46	14.86	15.48	15.87	17.19	10.75	11.15	11.77	12.17	13.48
	6H	15.02	15.34	16.05	16.37	17.70	11.29	11.61	12.32	12.64	13.96
	8H	15.23	15.51	16.26	16.53	17.90	11.48	11.77	12.52	12.79	14.16

END OF REPORT