

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905202

Luminaire Tested: DFN2DIP-HX2F0-040D060US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905202
REPORT IS A COMBINATION OF REPORTS P899195 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D060US835-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9270.0 lumens
Efficiency: N/A
Efficacy: 109.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 84.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

Luminous Intensity Polar Plot

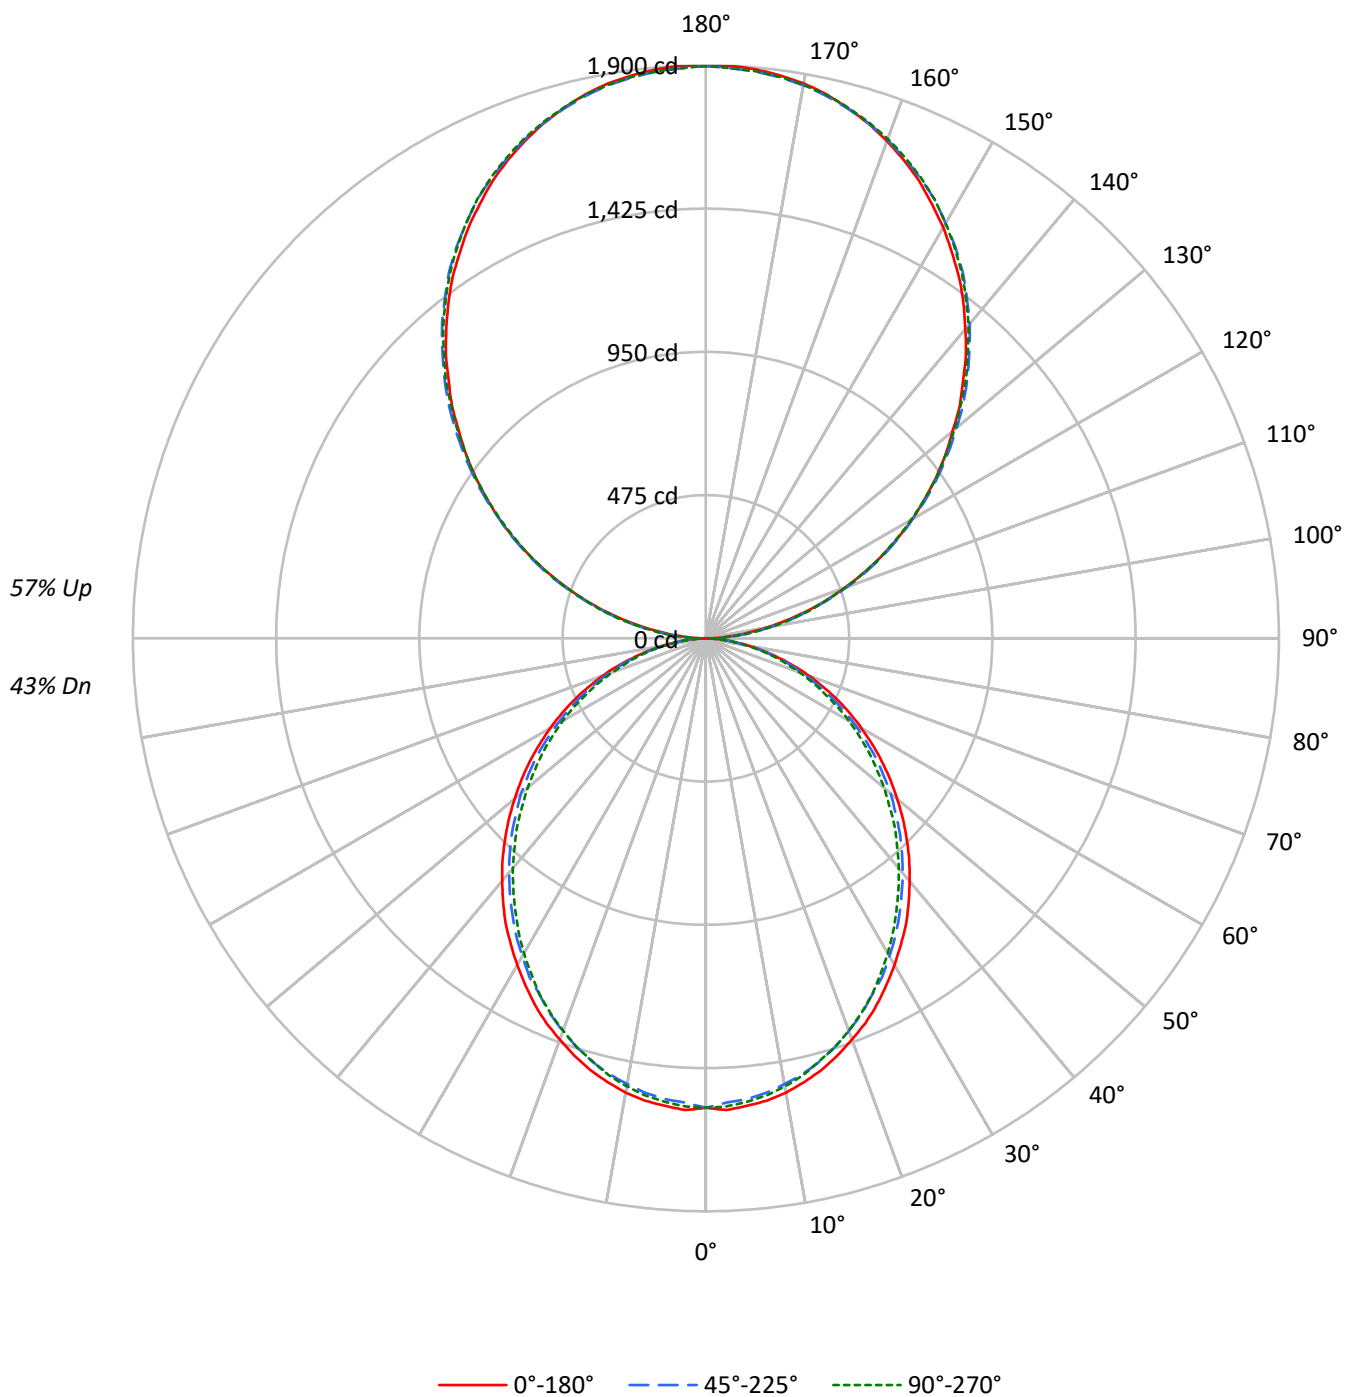

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3667	3667	3667
5°	3667	3607	3634
10°	3632	3550	3578
15°	3572	3483	3494
20°	3494	3393	3409
25°	3417	3287	3311
30°	3321	3188	3189
35°	3229	3073	3061
40°	3118	2956	2937
45°	3006	2839	2811
50°	2884	2715	2665
55°	2755	2572	2530
60°	2610	2404	2375
65°	2450	2228	2192
70°	2247	2014	1993
75°	1969	1758	1801
80°	1629	1431	1454
85°	1106	898	900

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3006 cd/sqm

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	146.5	1.6
10°-20°	412.2	4.4
20°-30°	605.7	6.5
30°-40°	703.5	7.6
40°-50°	702.6	7.6
50°-60°	612.7	6.6
60°-70°	452.9	4.9
70°-80°	256.2	2.8
80°-90°	73.0	0.8
90°-100°	117.4	1.3
100°-110°	373.1	4.0
110°-120°	638.5	6.9
120°-130°	839.7	9.1
130°-140°	942.5	10.2
140°-150°	924.2	10.0
150°-160°	775.3	8.4
160°-170°	514.2	5.5
170°-180°	179.7	1.9
0°-30°	1164.4	12.6
0°-40°	1867.9	20.1
0°-60°	3183.2	34.3
0°-90°	3965.4	42.8
90°-120°	1129.0	12.2
90°-150°	3835.4	41.4
90°-180°	5305.0	57.2
0°-180°	9270.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1556	1556	1556	1556	1556	
5°	1556	1550	1534	1546	1543	148
15°	1482	1473	1453	1459	1452	417
25°	1341	1329	1304	1306	1304	617
35°	1157	1142	1118	1109	1102	722
45°	941	931	908	892	886	727
55°	712	703	686	668	660	637
65°	480	471	456	443	436	475
75°	251	248	241	232	235	268
85°	61	60	58	54	52	68
90°	2	21	56	53	54	9
95°	84	100	102	102	100	93
105°	344	349	352	355	355	363
115°	641	650	647	645	641	634
125°	932	946	942	936	935	833
135°	1205	1223	1226	1225	1220	932
145°	1463	1475	1484	1486	1479	914
155°	1673	1678	1683	1691	1686	770
165°	1820	1819	1819	1830	1822	514
175°	1894	1890	1886	1898	1888	180
180°	1898	1898	1898	1898	1898	

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1556.4	1556.4	1556.4	1556.4	1556.4
2.5°	1565.5	1558.0	1541.5	1556.4	1553.6
5°	1556.4	1550.5	1534.0	1545.9	1543.1
7.5°	1545.9	1537.0	1520.5	1532.6	1529.6
10°	1529.6	1519.1	1501.2	1513.1	1508.6
12.5°	1507.0	1498.1	1480.2	1487.7	1484.6
15°	1481.6	1472.7	1453.2	1459.2	1451.8
17.5°	1450.2	1441.3	1421.8	1429.2	1421.8
20°	1415.7	1406.8	1385.9	1390.3	1384.5
22.5°	1381.4	1367.9	1348.4	1348.4	1345.4
25°	1340.9	1329.0	1303.6	1306.5	1303.6
27.5°	1296.0	1285.5	1266.2	1261.7	1254.3
30°	1251.2	1239.2	1216.8	1212.3	1206.3
32.5°	1203.3	1194.4	1170.4	1161.4	1155.3
35°	1156.9	1142.0	1118.0	1109.0	1101.5
37.5°	1104.5	1091.0	1067.0	1056.6	1049.1
40°	1050.7	1038.6	1014.6	1001.3	995.3
42.5°	998.3	986.2	962.4	947.3	938.4
45°	941.4	931.0	908.4	892.1	886.0
47.5°	886.0	875.5	851.6	835.1	826.2
50°	827.6	820.1	799.2	778.2	770.7
52.5°	770.7	760.3	740.9	724.4	713.9
55°	712.5	703.4	685.5	667.5	660.1
57.5°	654.0	646.6	627.0	609.1	603.1
60°	595.6	589.7	568.8	552.3	547.8
62.5°	538.8	528.3	513.4	498.4	492.4
65°	480.5	471.4	456.5	443.0	435.6
67.5°	420.6	413.0	399.7	389.2	383.2
70°	365.2	359.2	345.7	335.2	329.3
72.5°	308.4	302.3	294.9	284.4	279.9
75°	251.4	248.5	240.9	232.0	235.0
77.5°	200.5	194.5	191.5	187.0	182.6
80°	149.7	148.1	145.1	140.7	137.7
82.5°	101.8	101.8	100.4	94.3	94.3
85°	61.3	59.9	58.4	53.8	52.4
87.5°	27.0	24.0	21.0	16.5	14.9
90°	1.7	20.6	56.1	52.6	54.3
92.5°	35.5	48.1	49.8	51.5	51.5
95°	83.5	99.5	102.4	102.4	99.5
97.5°	139.0	153.9	160.2	160.2	160.2
100°	203.1	216.2	220.8	220.8	219.1
102.5°	270.6	280.3	286.6	288.3	286.6
105°	344.4	349.0	352.4	355.3	355.3
107.5°	417.6	424.5	424.5	425.6	417.6
110°	488.6	497.7	497.7	497.7	493.1

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	565.2	574.9	573.2	568.6	565.2
115°	640.7	649.9	647.0	645.3	640.7
117.5°	715.7	728.3	720.2	715.7	711.1
120°	791.2	803.8	791.2	791.2	786.0
122.5°	859.8	875.8	867.8	863.3	859.8
125°	931.9	946.2	941.6	936.5	934.8
127.5°	1002.3	1020.0	1013.7	1006.9	1002.3
130°	1068.1	1088.7	1085.8	1082.4	1076.1
132.5°	1141.9	1157.9	1159.0	1151.0	1146.4
135°	1205.4	1223.1	1226.5	1224.8	1220.2
137.5°	1276.3	1290.6	1293.5	1292.3	1285.5
140°	1338.7	1353.0	1361.0	1361.0	1354.7
142.5°	1402.7	1417.0	1421.6	1423.3	1417.0
145°	1463.4	1474.8	1484.0	1485.7	1479.4
147.5°	1517.7	1532.0	1538.9	1541.7	1535.4
150°	1573.8	1583.5	1589.8	1594.9	1589.8
152.5°	1623.5	1633.3	1641.3	1647.6	1641.3
155°	1673.3	1677.9	1683.0	1691.1	1685.9
157.5°	1716.2	1719.7	1722.5	1734.0	1726.0
160°	1754.6	1758.0	1759.7	1769.4	1762.6
162.5°	1790.0	1790.0	1791.7	1802.6	1794.6
165°	1820.3	1818.6	1818.6	1830.1	1822.1
167.5°	1847.8	1842.7	1842.7	1854.1	1846.1
170°	1868.4	1863.8	1862.1	1873.5	1863.8
172.5°	1882.7	1878.1	1876.4	1887.8	1878.1
175°	1894.1	1889.6	1886.1	1897.6	1887.8
177.5°	1900.4	1895.9	1892.4	1902.1	1892.4
180°	1897.6	1897.6	1897.6	1897.6	1897.6

TEST NUMBER: P905202

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.94	11.74	11.96	12.77	14.14	10.52	11.32	11.53	12.34	13.71
	3H	12.57	13.29	13.60	14.32	15.71	12.11	12.83	13.14	13.86	15.25
	4H	13.14	13.82	14.18	14.86	16.25	12.68	13.36	13.72	14.40	15.80
	6H	13.52	14.14	14.57	15.18	16.59	13.06	13.68	14.11	14.72	16.14
	8H	13.61	14.21	14.66	15.26	16.67	13.15	13.75	14.21	14.81	16.21
	12H	13.65	14.21	14.71	15.27	16.70	13.19	13.75	14.24	14.80	16.23
4H	2H	11.39	12.07	12.43	13.10	14.50	11.05	11.73	12.09	12.76	14.16
	3H	13.22	13.78	14.27	14.85	16.26	12.83	13.40	13.89	14.47	15.88
	4H	13.91	14.43	14.97	15.48	16.92	13.51	14.03	14.57	15.09	16.52
	6H	14.40	14.84	15.47	15.92	17.35	14.00	14.45	15.07	15.53	16.96
	8H	14.53	14.95	15.60	16.02	17.47	14.14	14.55	15.21	15.63	17.07
	12H	14.59	14.97	15.68	16.05	17.50	14.19	14.56	15.27	15.65	17.10
8H	4H	14.09	14.51	15.16	15.58	17.02	13.74	14.16	14.81	15.23	16.67
	6H	14.69	15.03	15.78	16.15	17.59	14.34	14.68	15.43	15.80	17.24
	8H	14.89	15.19	15.99	16.29	17.75	14.54	14.84	15.64	15.94	17.40
	12H	15.00	15.27	16.11	16.36	17.86	14.64	14.90	15.74	15.99	17.49
12H	4H	14.07	14.45	15.16	15.53	16.98	13.73	14.10	14.81	15.19	16.64
	6H	14.71	15.02	15.81	16.11	17.57	14.37	14.67	15.47	15.77	17.23
	8H	14.93	15.20	16.04	16.29	17.79	14.59	14.85	15.69	15.95	17.45

END OF REPORT