

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905234

Luminaire Tested: DFN2DIP-HX2F0-060D040US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905234
REPORT IS A COMBINATION OF REPORTS P899179 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D040US835-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9480.0 lumens
Efficiency: N/A
Efficacy: 106.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

Luminous Intensity Polar Plot

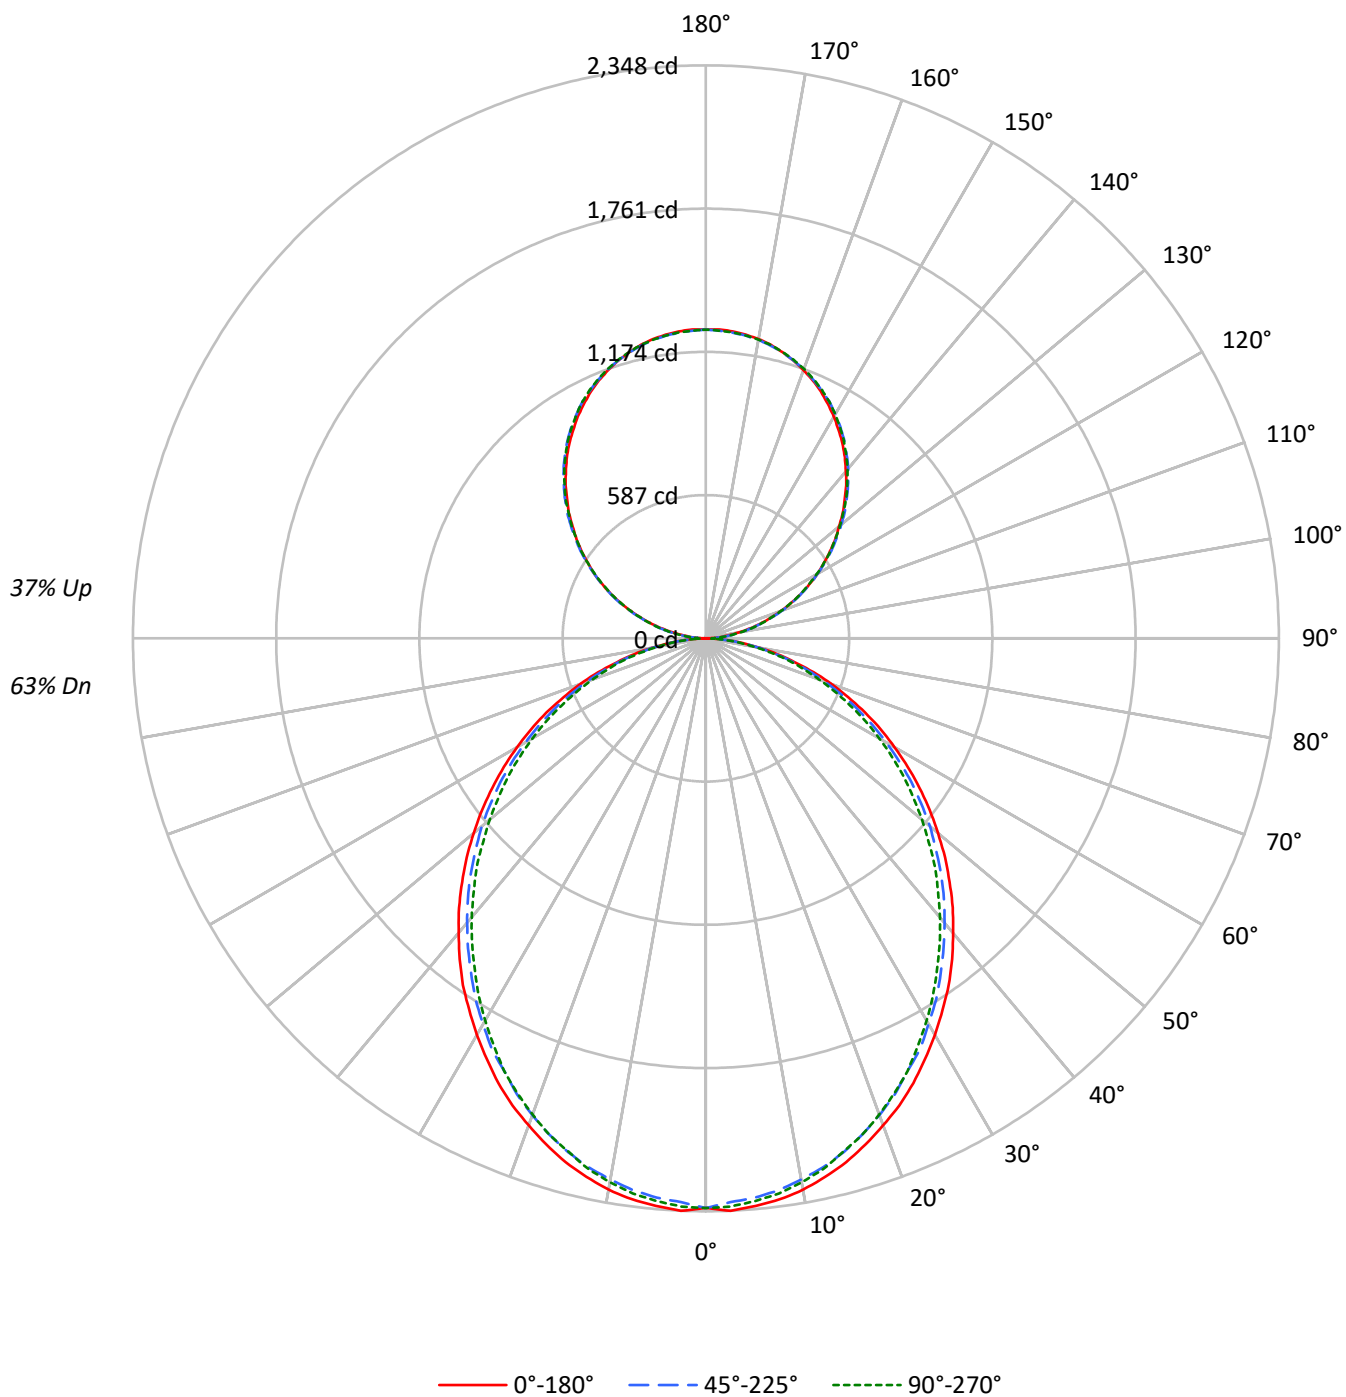

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5501	5501	5501
5°	5501	5411	5450
10°	5447	5325	5366
15°	5358	5224	5241
20°	5242	5089	5113
25°	5125	4931	4967
30°	4981	4783	4784
35°	4844	4609	4591
40°	4676	4434	4406
45°	4509	4258	4216
50°	4326	4072	3998
55°	4133	3858	3795
60°	3915	3606	3562
65°	3675	3342	3288
70°	3371	3021	2990
75°	2952	2636	2702
80°	2444	2146	2180
85°	1659	1347	1349

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4509 cd/sqm

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	2.3
10°-20°	618.3	6.5
20°-30°	908.6	9.6
30°-40°	1055.3	11.1
40°-50°	1054.0	11.1
50°-60°	919.0	9.7
60°-70°	679.4	7.2
70°-80°	384.4	4.1
80°-90°	105.0	1.1
90°-100°	78.3	0.8
100°-110°	248.7	2.6
110°-120°	425.6	4.5
120°-130°	559.8	5.9
130°-140°	628.3	6.6
140°-150°	616.2	6.5
150°-160°	516.9	5.5
160°-170°	342.8	3.6
170°-180°	119.8	1.3
0°-30°	1746.6	18.4
0°-40°	2801.8	29.6
0°-60°	4774.8	50.4
0°-90°	5943.6	62.7
90°-120°	752.7	7.9
90°-150°	2556.9	27.0
90°-180°	3536.0	37.3
0°-180°	9480.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	1	14	37	35	36	9
95°	56	66	68	68	66	62
105°	230	233	235	237	237	242
115°	427	433	431	430	427	422
125°	621	631	628	624	623	555
135°	804	815	818	816	814	621
145°	976	983	989	990	986	610
155°	1116	1119	1122	1127	1124	513
165°	1214	1212	1212	1220	1215	342
175°	1263	1260	1257	1265	1259	120
180°	1265	1265	1265	1265	1265	

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	1.1	13.7	37.4	35.1	36.2
92.5°	23.6	32.0	33.2	34.3	34.3
95°	55.7	66.4	68.3	68.3	66.4
97.5°	92.7	102.6	106.8	106.8	106.8
100°	135.4	144.2	147.2	147.2	146.1
102.5°	180.4	186.9	191.1	192.2	191.1
105°	229.6	232.6	234.9	236.8	236.8
107.5°	278.4	283.0	283.0	283.7	278.4
110°	325.7	331.8	331.8	331.8	328.8

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	376.8	383.3	382.1	379.1	376.8
115°	427.1	433.3	431.3	430.2	427.1
117.5°	477.1	485.5	480.2	477.1	474.1
120°	527.5	535.8	527.5	527.5	524.0
122.5°	573.2	583.9	578.6	575.5	573.2
125°	621.3	630.8	627.8	624.3	623.2
127.5°	668.2	680.0	675.8	671.2	668.2
130°	712.0	725.8	723.9	721.6	717.4
132.5°	761.2	771.9	772.7	767.3	764.3
135°	803.6	815.4	817.7	816.5	813.5
137.5°	850.9	860.4	862.3	861.5	857.0
140°	892.4	902.0	907.3	907.3	903.1
142.5°	935.2	944.7	947.7	948.9	944.7
145°	975.6	983.2	989.3	990.5	986.3
147.5°	1011.8	1021.3	1025.9	1027.8	1023.6
150°	1049.2	1055.7	1059.9	1063.3	1059.9
152.5°	1082.4	1088.8	1094.2	1098.4	1094.2
155°	1115.5	1118.6	1122.0	1127.4	1123.9
157.5°	1144.2	1146.4	1148.3	1156.0	1150.6
160°	1169.7	1172.0	1173.1	1179.6	1175.0
162.5°	1193.3	1193.3	1194.5	1201.7	1196.4
165°	1213.6	1212.4	1212.4	1220.0	1214.7
167.5°	1231.9	1228.4	1228.4	1236.1	1230.7
170°	1245.6	1242.5	1241.4	1249.0	1242.5
172.5°	1255.1	1252.1	1250.9	1258.6	1252.1
175°	1262.8	1259.7	1257.4	1265.0	1258.6
177.5°	1267.0	1263.9	1261.6	1268.1	1261.6
180°	1265.0	1265.0	1265.0	1265.0	1265.0

TEST NUMBER: P905234

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.15	15.14	14.99	16.00	17.08	13.73	14.72	14.57	15.58	16.66
	3H	15.80	16.69	16.65	17.56	18.66	15.34	16.22	16.19	17.10	18.20
	4H	16.37	17.21	17.24	18.09	19.21	15.92	16.75	16.78	17.63	18.75
	6H	16.76	17.53	17.64	18.42	19.55	16.30	17.08	17.18	17.96	19.09
	8H	16.86	17.60	17.75	18.50	19.63	16.40	17.14	17.29	18.04	19.17
	12H	16.90	17.61	17.80	18.50	19.66	16.44	17.14	17.34	18.04	19.19
4H	2H	14.62	15.46	15.49	16.34	17.45	14.28	15.12	15.15	16.00	17.11
	3H	16.47	17.17	17.35	18.08	19.21	16.08	16.78	16.97	17.70	18.83
	4H	17.17	17.81	18.06	18.71	19.87	16.77	17.41	17.67	18.32	19.48
	6H	17.67	18.22	18.58	19.15	20.31	17.27	17.82	18.18	18.75	19.91
	8H	17.81	18.32	18.72	19.25	20.42	17.41	17.93	18.32	18.85	20.02
	12H	17.87	18.34	18.81	19.28	20.46	17.47	17.93	18.40	18.88	20.06
8H	4H	17.36	17.88	18.28	18.80	19.98	17.01	17.53	17.93	18.45	19.62
	6H	17.97	18.40	18.91	19.36	20.53	17.62	18.05	18.56	19.01	20.18
	8H	18.18	18.55	19.13	19.51	20.70	17.82	18.20	18.77	19.16	20.34
	12H	18.30	18.63	19.25	19.58	20.82	17.93	18.26	18.88	19.21	20.45
12H	4H	17.35	17.82	18.29	18.76	19.94	17.01	17.47	17.94	18.42	19.59
	6H	18.00	18.38	18.95	19.33	20.52	17.66	18.03	18.61	18.99	20.18
	8H	18.23	18.56	19.18	19.51	20.75	17.88	18.21	18.83	19.16	20.40