

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907902

Luminaire Tested: DFN2DIP-HX2F0-030D040US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907902
REPORT IS A COMBINATION OF REPORTS P899173 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-030D040US840-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6574.3 lumens
Efficiency: N/A
Efficacy: 120.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 54.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

Luminous Intensity Polar Plot

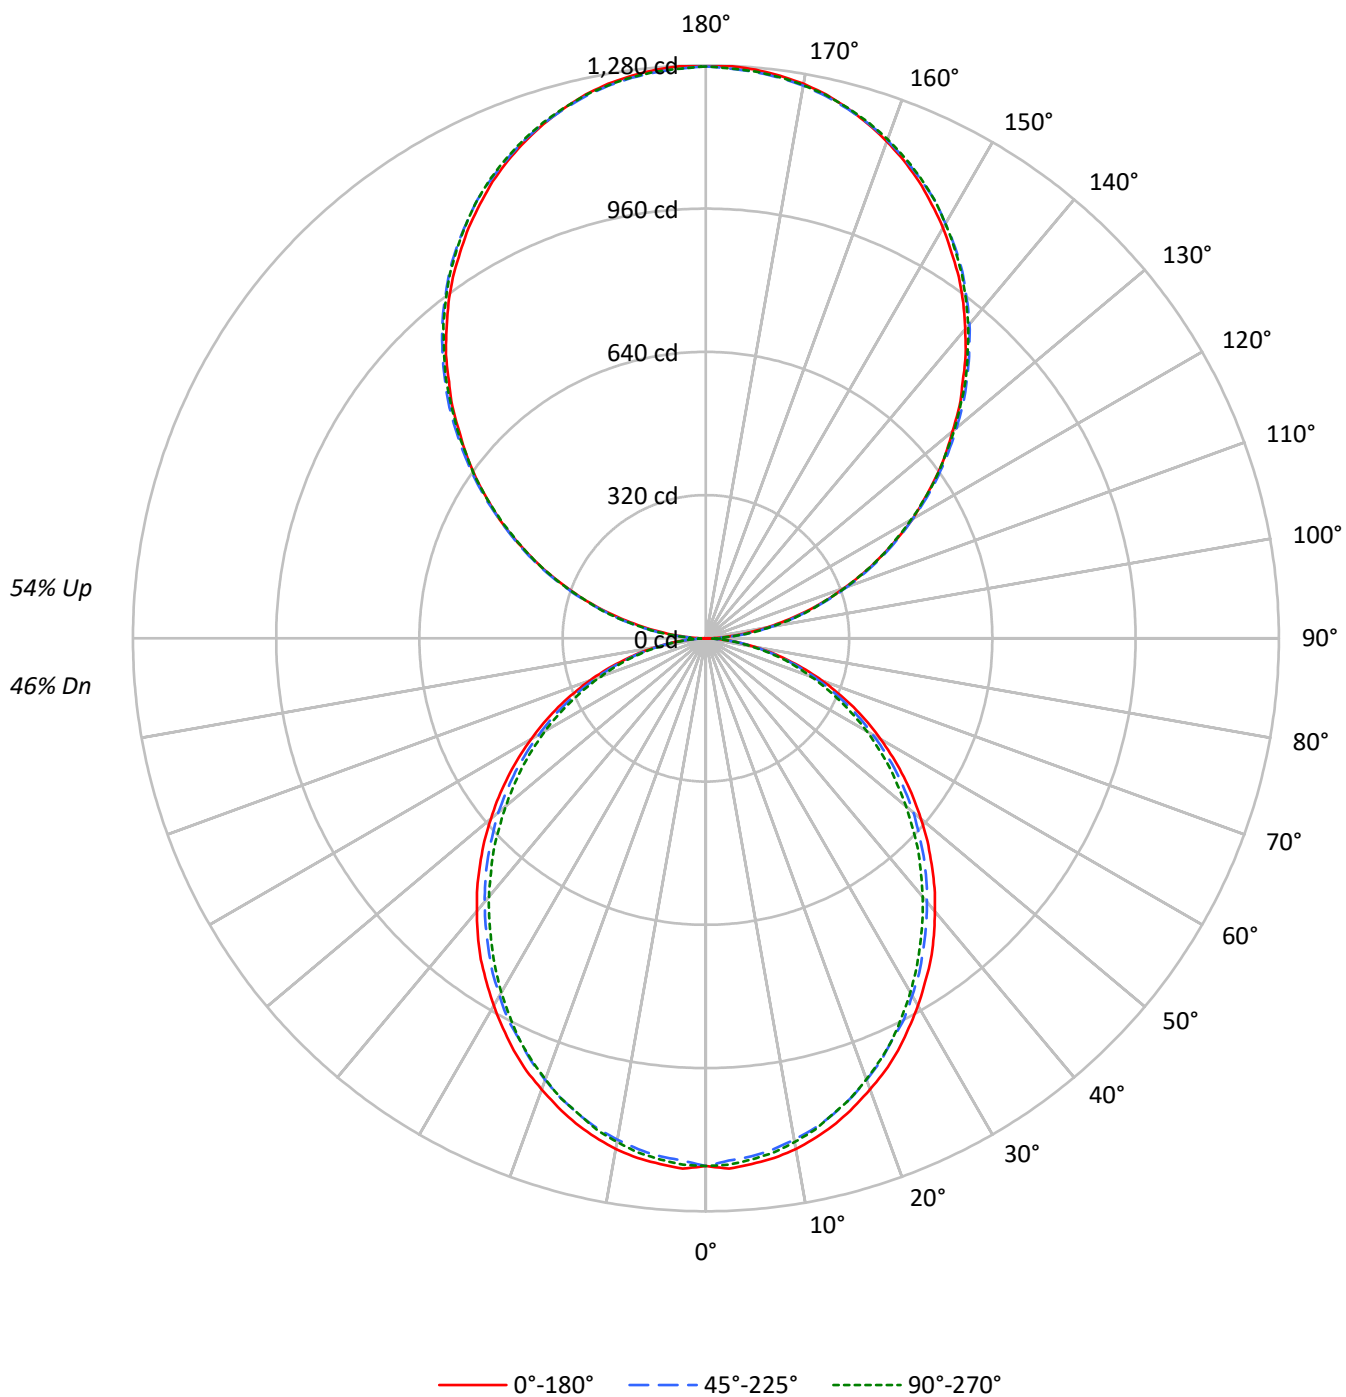

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52			46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44			38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37			32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32			27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27			23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24			20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21			18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19			16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17			14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15			13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14			12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2777	2777	2777
5°	2777	2732	2752
10°	2751	2689	2710
15°	2706	2638	2646
20°	2647	2570	2582
25°	2588	2490	2508
30°	2515	2415	2415
35°	2446	2328	2318
40°	2361	2239	2225
45°	2277	2150	2129
50°	2184	2056	2019
55°	2087	1948	1916
60°	1977	1821	1799
65°	1856	1688	1660
70°	1702	1526	1510
75°	1491	1332	1364
80°	1234	1084	1101
85°	839	680	682

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2277 cd/sqm

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.7
10°-20°	312.2	4.7
20°-30°	458.8	7.0
30°-40°	532.8	8.1
40°-50°	532.2	8.1
50°-60°	464.1	7.1
60°-70°	343.1	5.2
70°-80°	194.1	3.0
80°-90°	54.8	0.8
90°-100°	79.1	1.2
100°-110°	251.2	3.8
110°-120°	429.8	6.5
120°-130°	565.3	8.6
130°-140°	634.5	9.7
140°-150°	622.2	9.5
150°-160°	522.0	7.9
160°-170°	346.2	5.3
170°-180°	121.0	1.8
0°-30°	881.9	13.4
0°-40°	1414.7	21.5
0°-60°	2411.0	36.7
0°-90°	3003.0	45.7
90°-120°	760.1	11.6
90°-150°	2582.2	39.3
90°-180°	3571.0	54.3
0°-180°	6574.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	1	14	38	35	37	6
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P907902

CATALOG NUMBER: DFN2DIP-HX2F0-030D040US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.27	11.09	11.26	12.10	13.43	9.85	10.67	10.84	11.67	13.01
	3H	11.90	12.64	12.91	13.65	15.01	11.44	12.18	12.44	13.19	14.55
	4H	12.47	13.17	13.49	14.19	15.55	12.01	12.71	13.03	13.73	15.09
	6H	12.85	13.49	13.88	14.52	15.89	12.39	13.03	13.42	14.06	15.43
	8H	12.94	13.56	13.98	14.59	15.96	12.49	13.10	13.52	14.14	15.51
	12H	12.98	13.56	14.02	14.60	15.99	12.52	13.10	13.56	14.13	15.53
4H	2H	10.72	11.42	11.74	12.43	13.79	10.38	11.08	11.40	12.09	13.45
	3H	12.55	13.13	13.58	14.18	15.55	12.17	12.75	13.20	13.80	15.17
	4H	13.24	13.78	14.28	14.81	16.21	12.85	13.38	13.89	14.42	15.82
	6H	13.73	14.19	14.78	15.25	16.64	13.34	13.80	14.39	14.86	16.25
	8H	13.87	14.30	14.92	15.35	16.76	13.47	13.90	14.52	14.96	16.36
	12H	13.93	14.32	15.00	15.38	16.80	13.52	13.91	14.59	14.98	16.39
8H	4H	13.43	13.85	14.47	14.91	16.32	13.07	13.50	14.12	14.56	15.96
	6H	14.03	14.38	15.10	15.48	16.88	13.67	14.03	14.75	15.12	16.53
	8H	14.23	14.54	15.31	15.62	17.04	13.87	14.19	14.95	15.26	16.69
	12H	14.34	14.62	15.43	15.69	17.16	13.97	14.25	15.06	15.32	16.79
12H	4H	13.41	13.80	14.47	14.86	16.28	13.06	13.45	14.13	14.52	15.93
	6H	14.05	14.36	15.13	15.44	16.87	13.71	14.02	14.79	15.10	16.52
	8H	14.27	14.55	15.36	15.62	17.09	13.93	14.20	15.01	15.28	16.74