

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907936

Luminaire Tested: DFN2DIP-HX2F0-050D020US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907936
REPORT IS A COMBINATION OF REPORTS P899158 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-050D020US840-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6079.4 lumens
Efficiency: N/A
Efficacy: 96.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 62.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLLFLL

Luminous Intensity Polar Plot

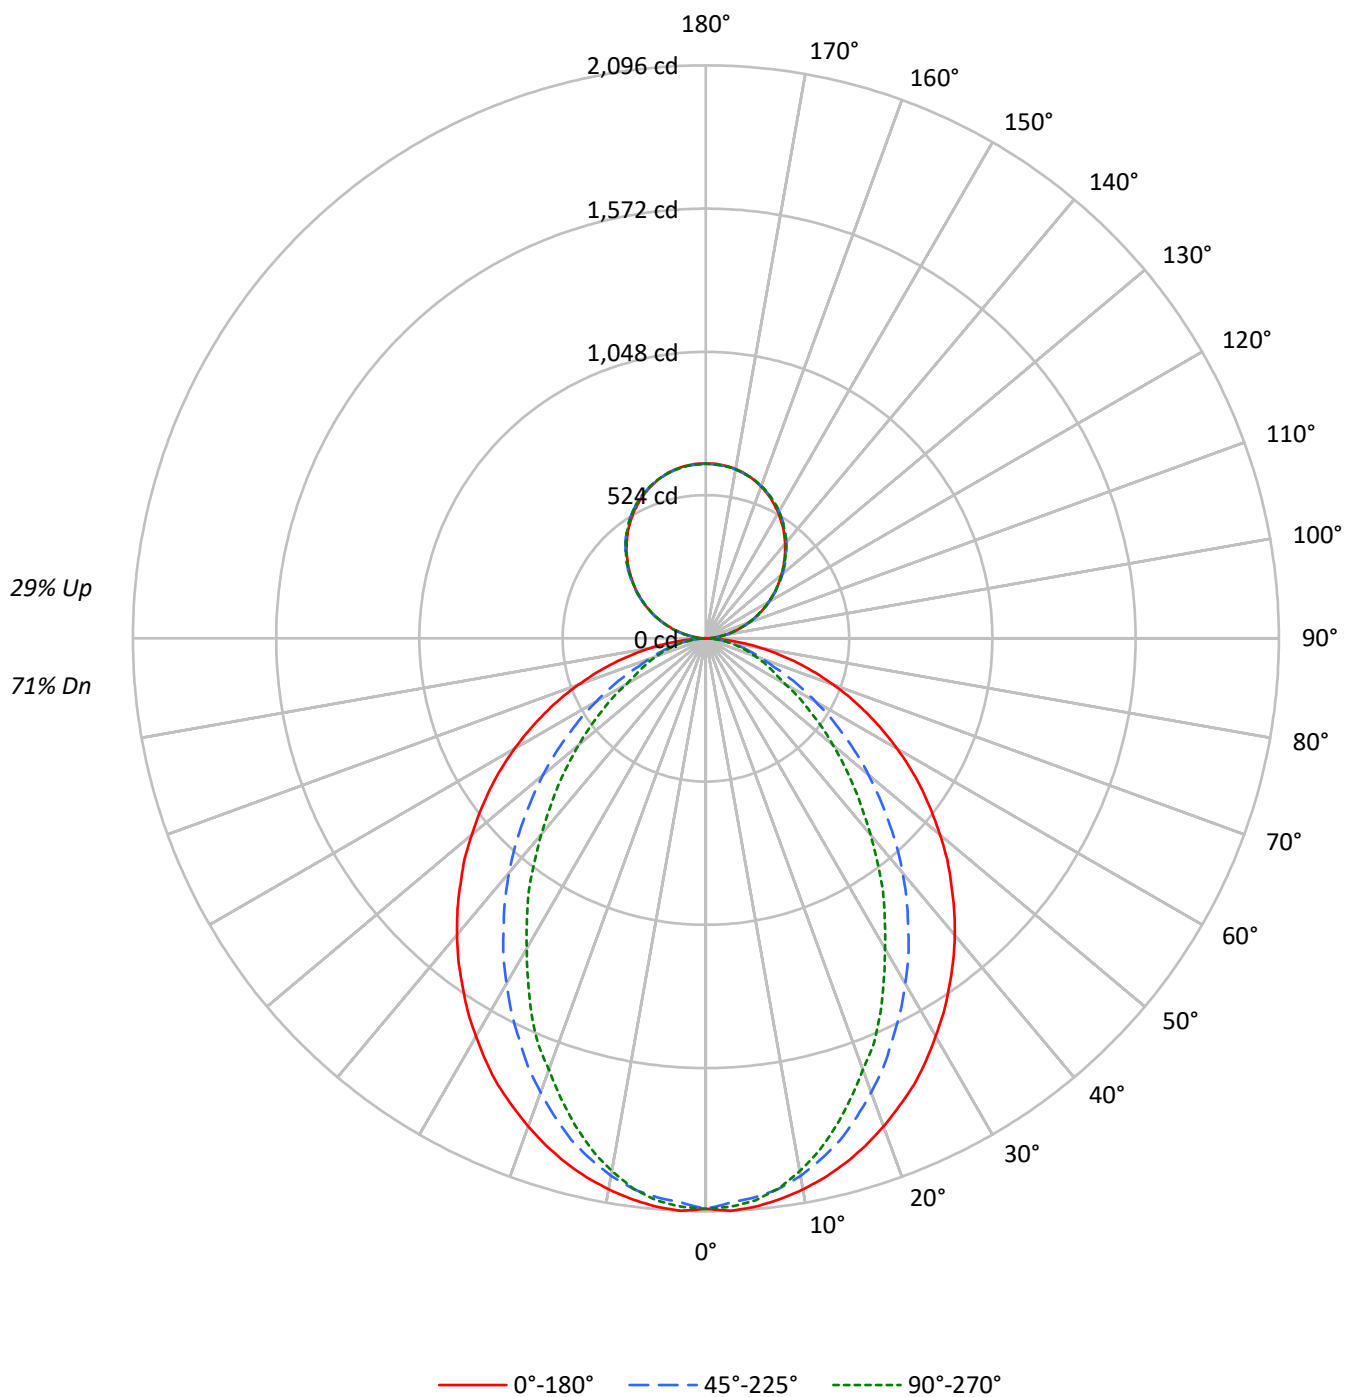

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	112	112	112	112	106	106	106	106	95	95	95		85	85	85		75
1	103	99	95	92	97	94	90	88	84	82	79		76	74	72		67
2	94	87	81	76	89	83	78	73	75	71	67		67	64	61		60
3	87	77	70	64	82	74	67	62	67	61	57		60	56	53		54
4	80	69	61	55	75	66	59	53	60	54	49		54	49	46		49
5	74	62	54	48	69	59	52	46	54	48	43		49	44	40		44
6	68	56	48	42	64	54	46	41	49	43	38		44	39	36		40
7	63	51	43	37	60	49	41	36	45	38	34		41	36	32		37
8	59	47	39	33	56	45	37	32	41	35	31		37	32	29		34
9	55	43	35	30	52	41	34	29	38	32	28		35	30	26		32
10	52	39	32	27	49	38	31	27	35	29	25		32	27	24		30

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4917	4917	4917
5°	4917	4827	4861
10°	4861	4721	4694
15°	4786	4554	4441
20°	4690	4328	4134
25°	4591	4077	3838
30°	4461	3820	3465
35°	4333	3546	3138
40°	4203	3263	2765
45°	4053	2951	2426
50°	3896	2637	2097
55°	3732	2303	1781
60°	3542	1955	1457
65°	3322	1604	1302
70°	3057	1276	1166
75°	2721	1103	1042
80°	2239	893	877
85°	1466	552	616

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4053 cd/sqm

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.6	3.2
10°-20°	536.9	8.8
20°-30°	753.8	12.4
30°-40°	821.7	13.5
40°-50°	755.2	12.4
50°-60°	593.1	9.8
60°-70°	386.1	6.4
70°-80°	198.7	3.3
80°-90°	52.6	0.9
90°-100°	39.5	0.7
100°-110°	125.6	2.1
110°-120°	214.9	3.5
120°-130°	282.7	4.6
130°-140°	317.3	5.2
140°-150°	311.1	5.1
150°-160°	261.0	4.3
160°-170°	173.1	2.8
170°-180°	60.5	1.0
0°-30°	1486.3	24.4
0°-40°	2308.0	38.0
0°-60°	3656.4	60.1
0°-90°	4293.8	70.6
90°-120°	380.0	6.3
90°-150°	1291.1	21.2
90°-180°	1786.0	29.4
0°-180°	6079.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2087	2087	2087	2087	2087	
5°	2087	2078	2053	2070	2064	198
15°	1985	1964	1900	1864	1845	559
25°	1802	1741	1617	1539	1511	829
35°	1552	1456	1290	1171	1129	972
45°	1269	1143	944	810	765	980
55°	965	818	614	500	465	862
65°	652	499	329	264	259	646
75°	348	215	151	138	136	368
85°	81	42	36	36	36	93
90°	1	7	19	18	18	6
95°	28	34	34	34	34	31
105°	116	117	119	120	120	122
115°	216	219	218	217	216	213
125°	314	318	317	315	315	280
135°	406	412	413	412	411	314
145°	493	496	500	500	498	308
155°	563	565	566	569	568	259
165°	613	612	612	616	613	173
175°	638	636	635	639	636	61
180°	639	639	639	639	639	

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2086.9	2086.9	2086.9	2086.9	2086.9
2.5°	2096.3	2086.9	2066.1	2085.1	2081.2
5°	2086.9	2077.5	2052.9	2069.8	2064.3
7.5°	2069.8	2058.6	2032.2	2039.6	2030.1
10°	2047.2	2034.0	1996.3	1990.5	1979.2
12.5°	2018.9	2002.0	1950.9	1939.6	1918.7
15°	1984.9	1964.1	1900.0	1864.1	1845.2
17.5°	1945.2	1915.0	1835.6	1794.1	1763.8
20°	1900.0	1862.1	1767.7	1720.6	1678.9
22.5°	1850.9	1807.4	1697.8	1633.7	1605.4
25°	1801.7	1741.2	1616.6	1539.2	1510.8
27.5°	1743.2	1678.9	1541.1	1452.3	1408.9
30°	1680.9	1609.0	1457.9	1361.7	1310.6
32.5°	1620.4	1533.5	1378.8	1265.4	1218.1
35°	1552.5	1456.1	1290.0	1170.9	1129.3
37.5°	1486.3	1382.4	1206.9	1076.4	1029.4
40°	1416.4	1303.2	1119.8	985.8	936.8
42.5°	1344.7	1223.9	1033.1	893.2	846.2
45°	1269.2	1142.6	944.3	810.1	764.8
47.5°	1197.4	1063.4	859.4	725.2	683.7
50°	1118.1	984.0	776.3	645.8	606.3
52.5°	1040.6	898.9	696.9	572.3	536.4
55°	965.0	817.7	613.7	500.5	464.6
57.5°	887.7	736.6	540.2	434.4	404.1
60°	808.3	657.2	462.6	366.5	336.2
62.5°	730.9	579.9	396.6	306.0	290.9
65°	651.6	498.6	328.6	264.5	258.7
67.5°	576.0	423.0	264.5	232.3	226.6
70°	496.8	349.4	219.0	200.2	192.6
72.5°	421.2	281.3	183.2	168.1	164.3
75°	347.5	215.2	151.1	137.8	136.0
77.5°	273.9	152.9	119.1	111.4	107.6
80°	205.8	109.6	90.6	83.1	83.1
82.5°	143.5	73.7	62.3	58.5	58.5
85°	81.2	41.5	35.9	35.9	35.9
87.5°	30.3	15.0	15.0	13.2	13.2
90°	0.6	7.0	18.9	17.7	18.3
92.5°	11.9	16.2	16.8	17.4	17.4
95°	28.1	33.5	34.4	34.4	33.5
97.5°	46.8	51.8	53.9	53.9	53.9
100°	68.4	72.8	74.3	74.3	73.7
102.5°	91.1	94.3	96.4	97.0	96.4
105°	115.9	117.4	118.7	119.6	119.6
107.5°	140.6	142.9	142.9	143.3	140.6
110°	164.5	167.5	167.5	167.5	166.0

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	190.3	193.5	193.0	191.4	190.3
115°	215.7	218.7	217.8	217.2	215.7
117.5°	241.0	245.2	242.5	241.0	239.3
120°	266.3	270.5	266.3	266.3	264.6
122.5°	289.4	294.8	292.2	290.6	289.4
125°	313.7	318.5	317.0	315.3	314.7
127.5°	337.4	343.4	341.2	338.9	337.4
130°	359.5	366.5	365.5	364.4	362.2
132.5°	384.4	389.8	390.1	387.5	385.9
135°	405.8	411.7	412.8	412.3	410.7
137.5°	429.6	434.4	435.5	435.1	432.7
140°	450.6	455.4	458.2	458.2	456.1
142.5°	472.2	477.0	478.6	479.1	477.0
145°	492.6	496.4	499.6	500.1	498.0
147.5°	510.9	515.7	518.1	519.0	516.8
150°	529.8	533.0	535.1	536.8	535.1
152.5°	546.5	549.8	552.5	554.6	552.5
155°	563.3	564.8	566.5	569.3	567.5
157.5°	577.7	578.9	579.9	583.7	581.0
160°	590.7	591.8	592.4	595.6	593.3
162.5°	602.6	602.6	603.1	606.8	604.1
165°	612.8	612.2	612.2	616.0	613.4
167.5°	622.0	620.3	620.3	624.1	621.5
170°	628.9	627.4	626.8	630.7	627.4
172.5°	633.8	632.2	631.7	635.5	632.2
175°	637.6	636.1	634.9	638.7	635.5
177.5°	639.7	638.2	637.0	640.3	637.0
180°	638.7	638.7	638.7	638.7	638.7

TEST NUMBER: P907936

CATALOG NUMBER: DFN2DIP-HX2F0-050D020US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.28	15.32	15.05	16.10	17.04	10.27	11.30	11.03	12.08	13.03
	3H	15.95	16.88	16.73	17.67	18.64	11.45	12.38	12.23	13.17	14.15
	4H	16.55	17.42	17.35	18.22	19.21	11.90	12.77	12.70	13.57	14.56
	6H	16.96	17.77	17.77	18.58	19.58	12.22	13.02	13.03	13.83	14.83
	8H	17.09	17.85	17.90	18.68	19.68	12.31	13.07	13.12	13.90	14.90
	12H	17.14	17.87	17.97	18.69	19.72	12.35	13.08	13.17	13.90	14.92
4H	2H	14.32	15.19	15.12	15.99	16.98	10.87	11.74	11.67	12.54	13.53
	3H	16.14	16.86	16.95	17.70	18.70	12.22	12.94	13.03	13.78	14.78
	4H	16.82	17.48	17.65	18.31	19.34	12.76	13.42	13.59	14.25	15.28
	6H	17.32	17.89	18.17	18.75	19.79	13.17	13.74	14.02	14.60	15.64
	8H	17.49	18.02	18.34	18.87	19.92	13.30	13.83	14.14	14.68	15.73
	12H	17.58	18.06	18.45	18.93	19.98	13.36	13.84	14.23	14.71	15.76
8H	4H	16.80	17.33	17.65	18.18	19.23	13.04	13.57	13.89	14.42	15.47
	6H	17.35	17.78	18.22	18.68	19.73	13.54	13.98	14.42	14.88	15.93
	8H	17.55	17.94	18.43	18.83	19.89	13.72	14.11	14.61	15.00	16.07
	12H	17.68	18.02	18.56	18.90	20.02	13.84	14.18	14.72	15.06	16.18
12H	4H	16.76	17.24	17.63	18.11	19.16	13.05	13.53	13.92	14.40	15.46
	6H	17.32	17.71	18.21	18.60	19.67	13.59	13.98	14.47	14.87	15.93
	8H	17.53	17.88	18.42	18.76	19.88	13.79	14.13	14.68	15.01	16.14

END OF REPORT