

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907962

Luminaire Tested: DFN2DIP-HX2F0-060D040US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907962
REPORT IS A COMBINATION OF REPORTS P899179 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D040US840-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9573.5 lumens
Efficiency: N/A
Efficacy: 107.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFLL

Luminous Intensity Polar Plot

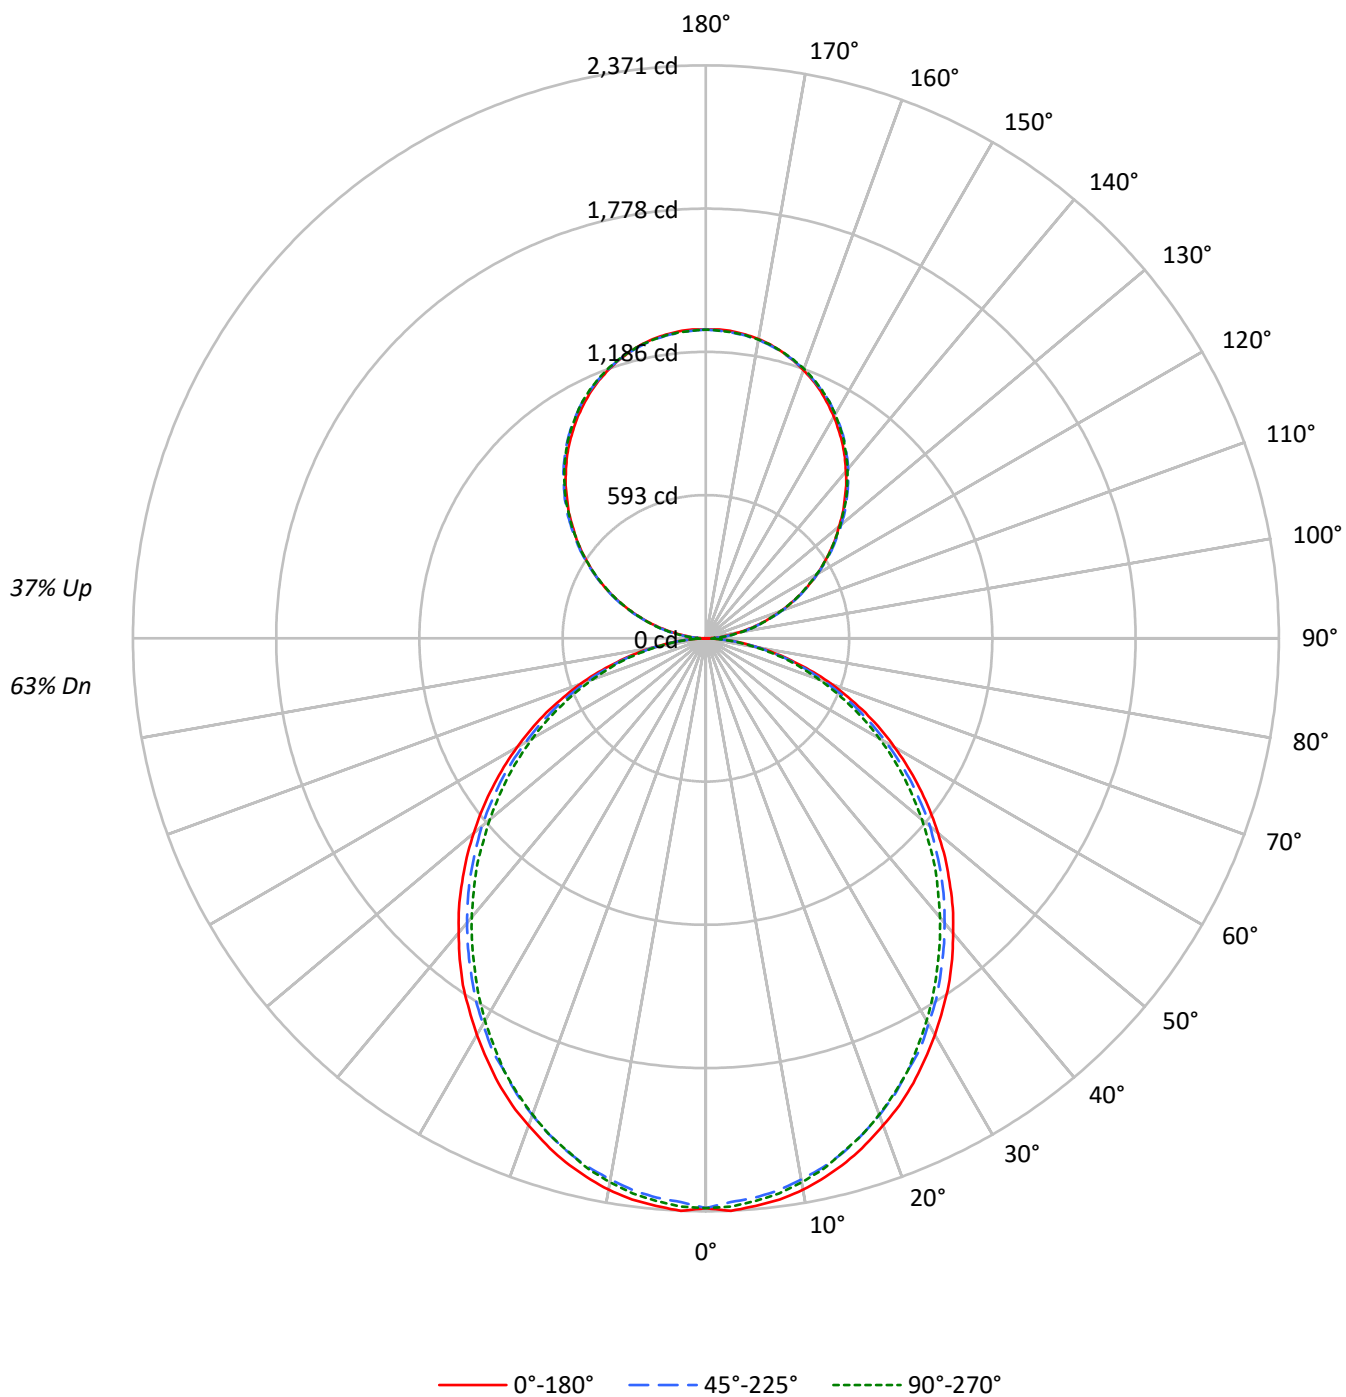

TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5555	5555	5555
5°	5555	5464	5504
10°	5501	5377	5419
15°	5411	5276	5293
20°	5293	5140	5164
25°	5175	4980	5016
30°	5030	4830	4831
35°	4892	4655	4636
40°	4722	4478	4449
45°	4554	4300	4258
50°	4368	4112	4038
55°	4174	3896	3832
60°	3953	3642	3597
65°	3711	3376	3320
70°	3404	3051	3020
75°	2981	2663	2729
80°	2468	2167	2201
85°	1675	1361	1363

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4554 cd/sqm

TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	2.3
10°-20°	624.4	6.5
20°-30°	917.5	9.6
30°-40°	1065.7	11.1
40°-50°	1064.4	11.1
50°-60°	928.1	9.7
60°-70°	686.1	7.2
70°-80°	388.2	4.1
80°-90°	106.1	1.1
90°-100°	79.1	0.8
100°-110°	251.2	2.6
110°-120°	429.8	4.5
120°-130°	565.3	5.9
130°-140°	634.5	6.6
140°-150°	622.2	6.5
150°-160°	522.0	5.5
160°-170°	346.2	3.6
170°-180°	121.0	1.3
0°-30°	1763.8	18.4
0°-40°	2829.5	29.6
0°-60°	4821.9	50.4
0°-90°	6002.2	62.7
90°-120°	760.1	7.9
90°-150°	2582.2	27.0
90°-180°	3571.0	37.3
0°-180°	9573.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	1	14	38	35	37	9
95°	56	67	69	69	67	63
105°	232	235	237	239	239	245
115°	431	438	436	434	431	427
125°	627	637	634	630	629	561
135°	812	823	826	825	822	627
145°	985	993	999	1000	996	616
155°	1126	1130	1133	1138	1135	519
165°	1226	1224	1224	1232	1227	346
175°	1275	1272	1270	1278	1271	121
180°	1278	1278	1278	1278	1278	

TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	1.1	13.8	37.8	35.4	36.6
92.5°	23.8	32.3	33.5	34.6	34.6
95°	56.2	67.1	69.0	69.0	67.1
97.5°	93.6	103.6	107.9	107.9	107.9
100°	136.7	145.6	148.7	148.7	147.5
102.5°	182.2	188.7	193.0	194.1	193.0
105°	231.9	234.9	237.2	239.1	239.1
107.5°	281.1	285.8	285.8	286.5	281.1
110°	328.9	335.1	335.1	335.1	332.0



TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	380.5	387.1	385.9	382.8	380.5
115°	431.3	437.6	435.6	434.4	431.3
117.5°	481.8	490.3	484.9	481.8	478.8
120°	532.7	541.1	532.7	532.7	529.2
122.5°	578.9	589.7	584.3	581.2	578.9
125°	627.4	637.0	634.0	630.5	629.3
127.5°	674.8	686.7	682.5	677.8	674.8
130°	719.0	733.0	731.0	728.7	724.5
132.5°	768.7	779.5	780.3	774.9	771.8
135°	811.5	823.4	825.8	824.6	821.5
137.5°	859.3	868.9	870.8	870.0	865.5
140°	901.2	910.9	916.3	916.3	912.0
142.5°	944.4	954.0	957.0	958.3	954.0
145°	985.2	992.9	999.1	1000.3	996.0
147.5°	1021.8	1031.4	1036.0	1037.9	1033.7
150°	1059.6	1066.1	1070.4	1073.8	1070.4
152.5°	1093.1	1099.5	1105.0	1109.2	1105.0
155°	1126.5	1129.6	1133.1	1138.5	1135.0
157.5°	1155.5	1157.7	1159.6	1167.4	1162.0
160°	1181.2	1183.6	1184.7	1191.2	1186.6
162.5°	1205.1	1205.1	1206.3	1213.6	1208.2
165°	1225.6	1224.4	1224.4	1232.0	1226.7
167.5°	1244.1	1240.5	1240.5	1248.3	1242.8
170°	1257.9	1254.8	1253.6	1261.3	1254.8
172.5°	1267.5	1264.5	1263.2	1271.0	1264.5
175°	1275.3	1272.1	1269.8	1277.5	1271.0
177.5°	1279.5	1276.4	1274.0	1280.6	1274.0
180°	1277.5	1277.5	1277.5	1277.5	1277.5

TEST NUMBER: P907962

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.19	15.18	15.03	16.04	17.12	13.76	14.75	14.60	15.61	16.69
	3H	15.83	16.72	16.68	17.59	18.70	15.37	16.26	16.22	17.13	18.24
	4H	16.41	17.25	17.28	18.13	19.24	15.95	16.79	16.82	17.67	18.78
	6H	16.80	17.57	17.68	18.45	19.58	16.34	17.11	17.22	18.00	19.12
	8H	16.89	17.63	17.78	18.53	19.66	16.44	17.17	17.33	18.08	19.20
	12H	16.94	17.64	17.83	18.54	19.69	16.48	17.18	17.37	18.07	19.23
4H	2H	14.65	15.49	15.53	16.37	17.49	14.32	15.15	15.19	16.03	17.15
	3H	16.50	17.20	17.39	18.11	19.24	16.12	16.82	17.00	17.73	18.86
	4H	17.20	17.84	18.10	18.75	19.90	16.81	17.45	17.70	18.35	19.51
	6H	17.70	18.25	18.61	19.18	20.34	17.31	17.86	18.22	18.79	19.95
	8H	17.84	18.36	18.76	19.28	20.45	17.44	17.96	18.36	18.88	20.06
	12H	17.91	18.37	18.84	19.32	20.49	17.50	17.97	18.44	18.91	20.09
8H	4H	17.40	17.91	18.31	18.84	20.01	17.05	17.56	17.96	18.49	19.66
	6H	18.00	18.43	18.95	19.40	20.57	17.65	18.08	18.59	19.05	20.22
	8H	18.21	18.59	19.16	19.55	20.73	17.85	18.23	18.80	19.19	20.38
	12H	18.33	18.66	19.29	19.61	20.85	17.96	18.30	18.92	19.25	20.48
12H	4H	17.39	17.85	18.32	18.80	19.97	17.04	17.51	17.98	18.45	19.63
	6H	18.03	18.41	18.98	19.37	20.56	17.69	18.07	18.64	19.03	20.21
	8H	18.26	18.59	19.21	19.54	20.78	17.92	18.25	18.87	19.20	20.44