

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910690

Luminaire Tested: DFN2DIP-HX2F0-060D040US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910690
REPORT IS A COMBINATION OF REPORTS P899179 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D040US850-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10513.2 lumens
Efficiency: N/A
Efficacy: 118.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFLL

Luminous Intensity Polar Plot

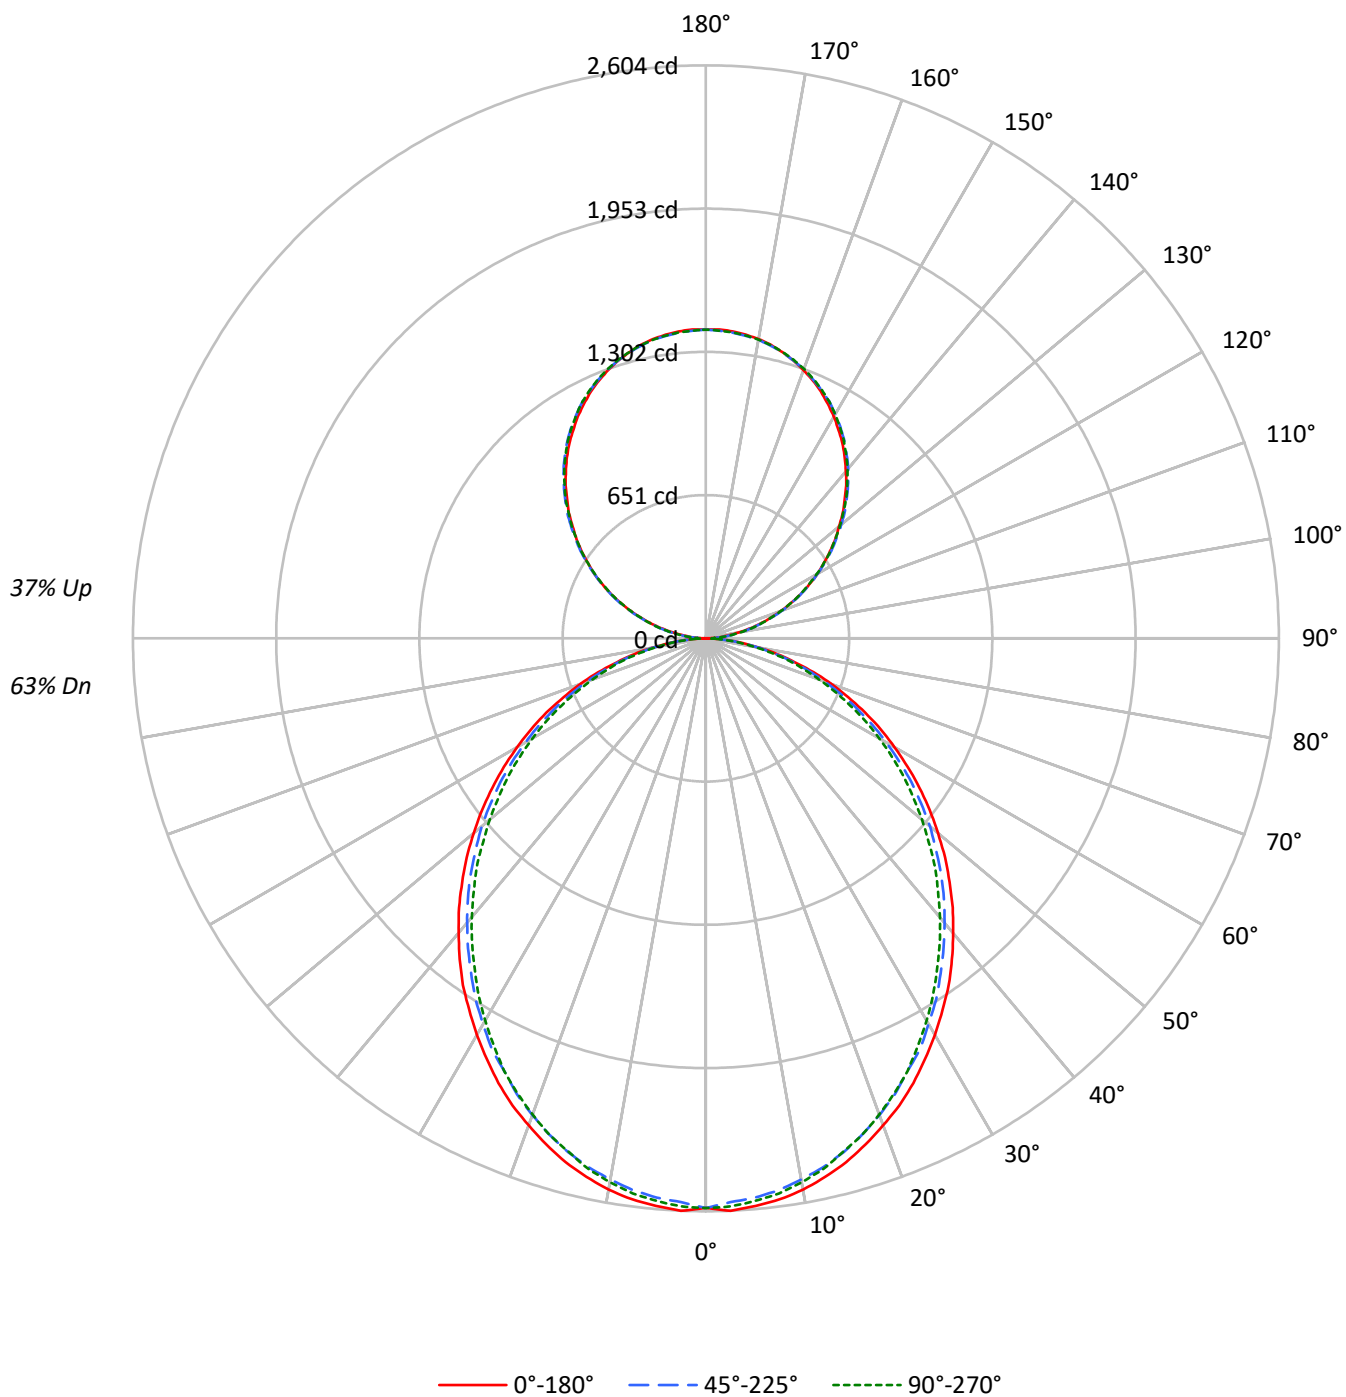

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	79	79	79	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	66	60	59	57
2	92	84	78	72	86	79	73	69	70	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	58	61	56	52	54	50	46	47	44	41
4	77	66	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	38	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6100	6100	6100
5°	6100	6001	6044
10°	6041	5905	5951
15°	5942	5794	5813
20°	5813	5644	5671
25°	5684	5468	5508
30°	5524	5304	5305
35°	5372	5112	5091
40°	5186	4918	4886
45°	5001	4722	4676
50°	4797	4516	4434
55°	4584	4279	4208
60°	4342	3999	3950
65°	4076	3706	3646
70°	3738	3350	3316
75°	3274	2924	2996
80°	2711	2380	2418
85°	1839	1493	1497

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5001 cd/sqm

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	243.7	2.3
10°-20°	685.6	6.5
20°-30°	1007.6	9.6
30°-40°	1170.3	11.1
40°-50°	1168.8	11.1
50°-60°	1019.2	9.7
60°-70°	753.4	7.2
70°-80°	426.3	4.1
80°-90°	116.5	1.1
90°-100°	86.8	0.8
100°-110°	275.8	2.6
110°-120°	472.0	4.5
120°-130°	620.8	5.9
130°-140°	696.8	6.6
140°-150°	683.3	6.5
150°-160°	573.2	5.5
160°-170°	380.1	3.6
170°-180°	132.9	1.3
0°-30°	1937.0	18.4
0°-40°	3107.2	29.6
0°-60°	5295.3	50.4
0°-90°	6591.4	62.7
90°-120°	834.7	7.9
90°-150°	2835.6	27.0
90°-180°	3922.0	37.3
0°-180°	10513.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2589	2589	2589	2589	2589	
5°	2589	2579	2552	2572	2567	246
15°	2465	2450	2417	2428	2415	694
25°	2231	2211	2168	2173	2168	1026
35°	1925	1900	1860	1845	1832	1202
45°	1566	1549	1511	1484	1474	1209
55°	1185	1170	1140	1110	1098	1060
65°	799	784	759	737	724	790
75°	418	413	401	386	391	446
85°	102	100	97	90	87	114
90°	1	15	42	39	40	10
95°	62	74	76	76	74	69
105°	255	258	260	263	263	269
115°	474	480	478	477	474	469
125°	689	700	696	692	691	616
135°	891	904	907	906	902	689
145°	1082	1090	1097	1098	1094	676
155°	1237	1240	1244	1250	1246	569
165°	1346	1345	1345	1353	1347	380
175°	1400	1397	1394	1403	1396	133
180°	1403	1403	1403	1403	1403	

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2589.1	2589.1	2589.1	2589.1	2589.1
2.5°	2604.2	2591.7	2564.2	2589.1	2584.3
5°	2589.1	2579.3	2551.8	2571.7	2566.9
7.5°	2571.7	2556.9	2529.4	2549.5	2544.5
10°	2544.5	2527.1	2497.1	2517.0	2509.6
12.5°	2507.0	2492.1	2462.3	2474.7	2469.7
15°	2464.6	2449.9	2417.4	2427.5	2415.1
17.5°	2412.4	2397.7	2365.2	2377.5	2365.2
20°	2355.1	2340.3	2305.4	2312.8	2303.1
22.5°	2298.1	2275.6	2243.1	2243.1	2238.1
25°	2230.6	2210.9	2168.5	2173.3	2168.5
27.5°	2155.9	2138.5	2106.2	2098.9	2086.5
30°	2081.5	2061.3	2024.1	2016.7	2006.6
32.5°	2001.6	1986.9	1947.0	1931.9	1921.9
35°	1924.6	1899.7	1859.8	1844.7	1832.3
37.5°	1837.4	1814.9	1775.1	1757.5	1745.1
40°	1747.8	1727.7	1687.9	1665.7	1655.6
42.5°	1660.6	1640.5	1601.0	1575.9	1561.0
45°	1566.1	1548.6	1511.1	1484.0	1473.9
47.5°	1473.9	1456.4	1416.6	1389.1	1374.3
50°	1376.7	1364.3	1329.5	1294.5	1282.1
52.5°	1282.1	1264.7	1232.4	1205.0	1187.6
55°	1185.2	1170.1	1140.3	1110.4	1098.0
57.5°	1088.0	1075.6	1043.1	1013.3	1003.2
60°	990.8	981.0	946.2	918.7	911.3
62.5°	896.2	878.8	853.9	829.1	819.1
65°	799.3	784.3	759.4	736.9	724.5
67.5°	699.7	687.0	664.8	647.4	637.3
70°	607.5	597.5	575.0	557.6	547.8
72.5°	512.9	502.9	490.5	473.1	465.7
75°	418.1	413.4	400.7	385.9	390.9
77.5°	333.6	323.6	318.5	311.2	303.8
80°	249.1	246.4	241.4	234.0	229.0
82.5°	169.3	169.3	166.9	156.9	156.9
85°	101.9	99.6	97.1	89.5	87.2
87.5°	44.9	39.9	34.8	27.5	24.8
90°	1.2	15.2	41.5	38.9	40.1
92.5°	26.2	35.5	36.8	38.0	38.0
95°	61.8	73.6	75.7	75.7	73.6
97.5°	102.8	113.8	118.4	118.4	118.4
100°	150.2	159.9	163.2	163.2	162.0
102.5°	200.1	207.3	211.9	213.1	211.9
105°	254.6	258.0	260.5	262.6	262.6
107.5°	308.7	313.8	313.8	314.6	308.7
110°	361.2	368.0	368.0	368.0	364.6

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	417.9	425.1	423.7	420.4	417.9
115°	473.7	480.5	478.3	477.1	473.7
117.5°	529.1	538.4	532.5	529.1	525.8
120°	585.0	594.2	585.0	585.0	581.1
122.5°	635.7	647.5	641.7	638.2	635.7
125°	689.0	699.6	696.2	692.3	691.1
127.5°	741.0	754.1	749.5	744.4	741.0
130°	789.6	804.9	802.8	800.3	795.6
132.5°	844.2	856.0	856.9	850.9	847.6
135°	891.2	904.3	906.8	905.5	902.2
137.5°	943.6	954.2	956.3	955.4	950.4
140°	989.7	1000.3	1006.2	1006.2	1001.5
142.5°	1037.1	1047.7	1051.0	1052.3	1047.7
145°	1081.9	1090.4	1097.1	1098.5	1093.8
147.5°	1122.1	1132.6	1137.7	1139.8	1135.2
150°	1163.6	1170.8	1175.4	1179.2	1175.4
152.5°	1200.4	1207.5	1213.5	1218.1	1213.5
155°	1237.1	1240.5	1244.3	1250.3	1246.4
157.5°	1268.9	1271.4	1273.5	1282.0	1276.0
160°	1297.2	1299.7	1301.0	1308.2	1303.1
162.5°	1323.4	1323.4	1324.7	1332.7	1326.8
165°	1345.9	1344.6	1344.6	1353.0	1347.1
167.5°	1366.2	1362.3	1362.3	1370.8	1364.8
170°	1381.4	1377.9	1376.7	1385.1	1377.9
172.5°	1391.9	1388.6	1387.2	1395.8	1388.6
175°	1400.4	1397.0	1394.5	1402.9	1395.8
177.5°	1405.1	1401.7	1399.1	1406.3	1399.1
180°	1402.9	1402.9	1402.9	1402.9	1402.9

TEST NUMBER: P910690

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.51	15.50	15.35	16.36	17.44	14.09	15.08	14.93	15.94	17.02
	3H	16.16	17.04	17.01	17.92	19.02	15.70	16.58	16.55	17.46	18.56
	4H	16.73	17.57	17.60	18.45	19.57	16.27	17.11	17.14	17.99	19.11
	6H	17.12	17.89	18.00	18.78	19.91	16.66	17.43	17.54	18.32	19.45
	8H	17.22	17.96	18.11	18.86	19.99	16.76	17.50	17.65	18.40	19.53
	12H	17.26	17.96	18.16	18.86	20.02	16.80	17.50	17.70	18.40	19.55
4H	2H	14.98	15.82	15.85	16.70	17.81	14.64	15.48	15.51	16.36	17.47
	3H	16.83	17.53	17.71	18.44	19.57	16.44	17.14	17.33	18.05	19.18
	4H	17.53	18.17	18.42	19.07	20.23	17.13	17.77	18.03	18.68	19.83
	6H	18.03	18.58	18.94	19.51	20.67	17.63	18.18	18.54	19.11	20.27
	8H	18.17	18.68	19.08	19.61	20.78	17.77	18.29	18.68	19.21	20.38
	12H	18.23	18.70	19.17	19.64	20.82	17.83	18.29	18.76	19.24	20.41
8H	4H	17.72	18.24	18.64	19.16	20.33	17.37	17.89	18.29	18.81	19.98
	6H	18.33	18.76	19.27	19.72	20.89	17.98	18.41	18.92	19.37	20.54
	8H	18.54	18.91	19.49	19.87	21.06	18.18	18.56	19.13	19.52	20.70
	12H	18.66	18.99	19.61	19.94	21.18	18.29	18.62	19.24	19.57	20.81
12H	4H	17.71	18.18	18.65	19.12	20.30	17.37	17.83	18.30	18.78	19.95
	6H	18.36	18.73	19.31	19.69	20.88	18.01	18.39	18.97	19.35	20.54
	8H	18.59	18.92	19.54	19.87	21.11	18.24	18.57	19.19	19.52	20.76

END OF REPORT