

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913376

Luminaire Tested: DFN2DIP-HX2F0-040D030US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913376
REPORT IS A COMBINATION OF REPORTS P899166 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D030US927-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4796.6 lumens
Efficiency: N/A
Efficacy: 83.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 57.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLLFLL

Luminous Intensity Polar Plot

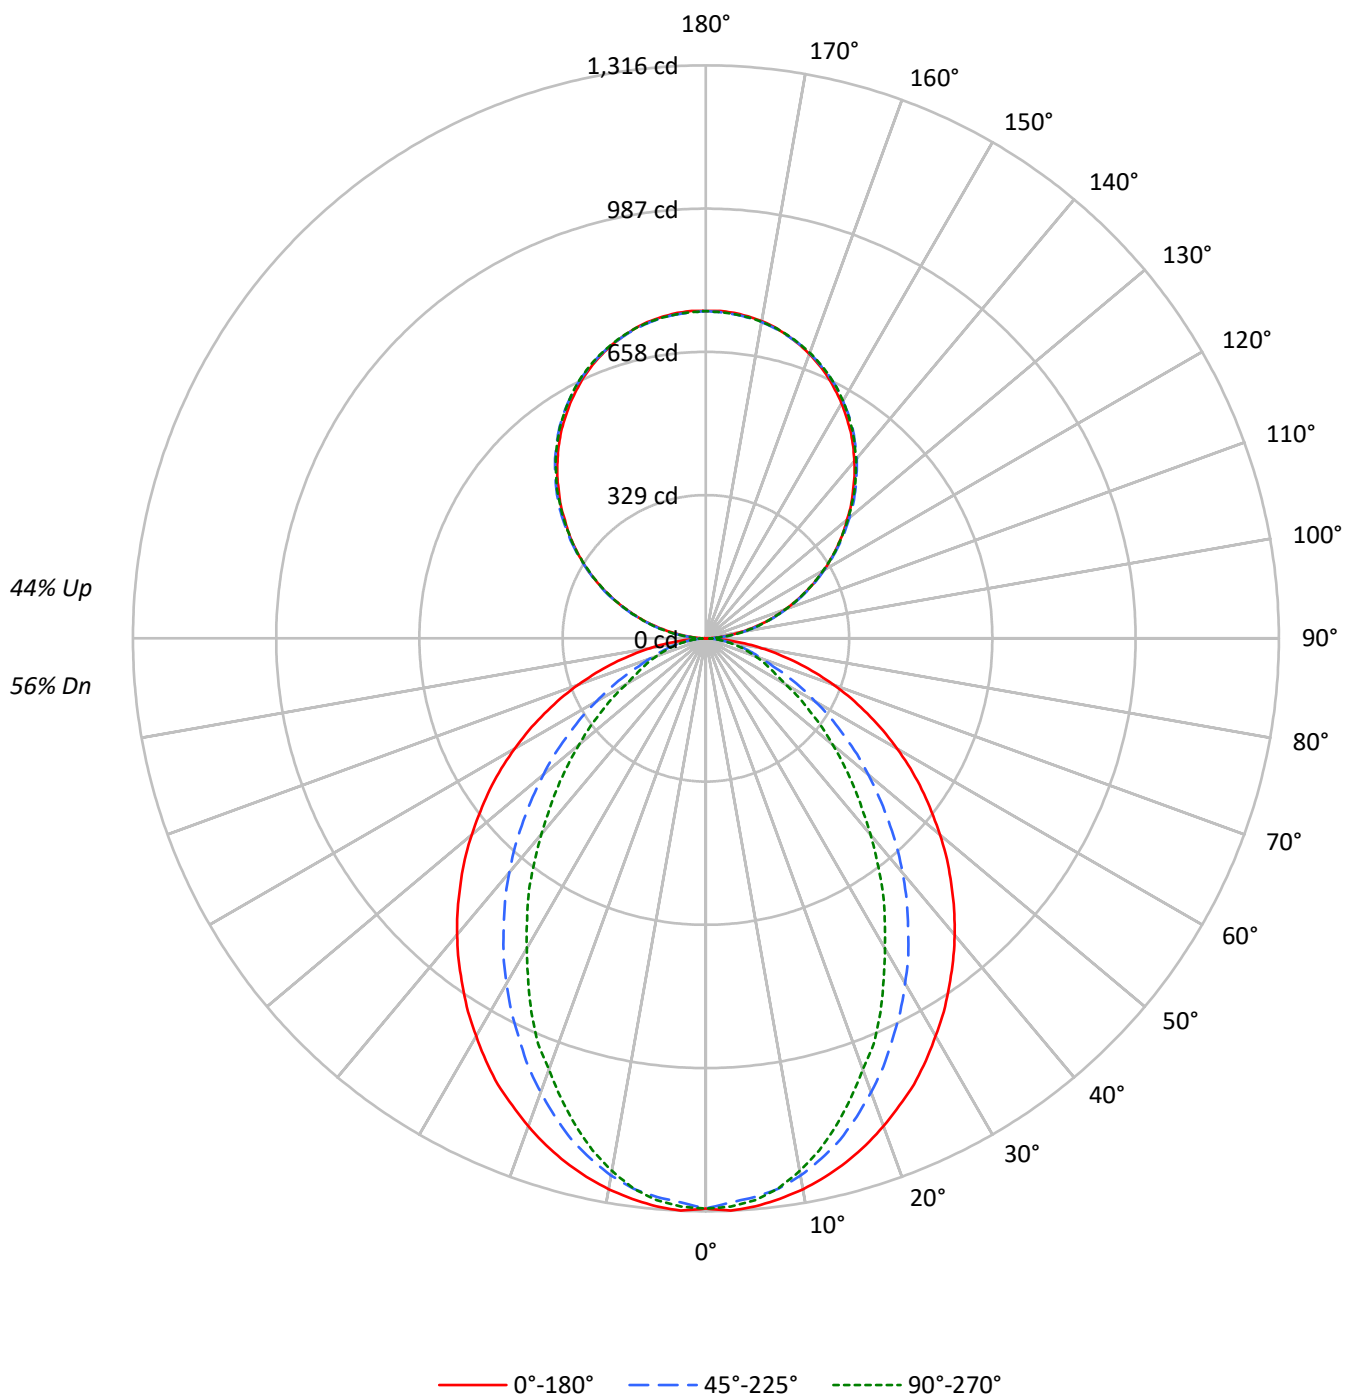

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	55	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	49	47	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	30
6	65	53	46	40	61	50	43	38	44	38	34	38	34	31	33	30	27
7	61	48	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3086	3086	3086
5°	3086	3029	3051
10°	3050	2963	2946
15°	3003	2858	2787
20°	2943	2716	2594
25°	2881	2558	2408
30°	2800	2397	2175
35°	2719	2225	1969
40°	2638	2048	1735
45°	2543	1852	1523
50°	2445	1655	1316
55°	2342	1445	1118
60°	2222	1227	915
65°	2085	1006	817
70°	1918	801	731
75°	1707	692	655
80°	1405	560	551
85°	919	346	386

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2543 cd/sqm

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	122.7	2.6
10°-20°	336.9	7.0
20°-30°	473.1	9.9
30°-40°	515.7	10.8
40°-50°	473.9	9.9
50°-60°	372.2	7.8
60°-70°	242.3	5.1
70°-80°	124.7	2.6
80°-90°	34.0	0.7
90°-100°	46.5	1.0
100°-110°	147.8	3.1
110°-120°	252.9	5.3
120°-130°	332.6	6.9
130°-140°	373.3	7.8
140°-150°	366.1	7.6
150°-160°	307.1	6.4
160°-170°	203.7	4.2
170°-180°	71.2	1.5
0°-30°	932.7	19.4
0°-40°	1448.4	30.2
0°-60°	2294.6	47.8
0°-90°	2695.5	56.2
90°-120°	447.2	9.3
90°-150°	1519.2	31.7
90°-180°	2101.0	43.8
0°-180°	4796.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1310	1310	1310	1310	1310	
5°	1310	1304	1288	1299	1296	124
15°	1246	1233	1192	1170	1158	351
25°	1131	1093	1014	966	948	520
35°	974	914	810	735	709	610
45°	796	717	593	508	480	615
55°	606	513	385	314	292	541
65°	409	313	206	166	162	405
75°	218	135	95	86	85	231
85°	51	26	22	22	22	58
90°	1	8	22	21	22	5
95°	33	40	41	41	40	37
105°	136	138	140	141	141	144
115°	254	257	256	256	254	251
125°	369	375	373	371	370	330
135°	477	484	486	485	483	369
145°	580	584	588	588	586	362
155°	663	665	667	670	668	305
165°	721	720	720	725	722	203
175°	750	748	747	752	748	71
180°	752	752	752	752	752	

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1309.6	1309.6	1309.6	1309.6	1309.6
2.5°	1315.6	1309.6	1296.6	1308.5	1306.1
5°	1309.6	1303.7	1288.2	1298.9	1295.5
7.5°	1298.9	1291.9	1275.3	1279.9	1274.1
10°	1284.8	1276.4	1252.8	1249.1	1242.1
12.5°	1267.0	1256.3	1224.2	1217.2	1204.1
15°	1245.6	1232.6	1192.3	1169.8	1158.0
17.5°	1220.8	1201.7	1151.9	1125.9	1106.9
20°	1192.3	1168.5	1109.3	1079.7	1053.6
22.5°	1161.5	1134.2	1065.4	1025.2	1007.5
25°	1130.7	1092.7	1014.5	966.0	948.1
27.5°	1094.0	1053.6	967.1	911.4	884.1
30°	1054.9	1009.7	914.9	854.5	822.5
32.5°	1016.9	962.3	865.2	794.1	764.4
35°	974.3	913.8	809.5	734.8	708.7
37.5°	932.8	867.5	757.3	675.5	645.9
40°	888.9	817.8	702.8	618.7	587.9
42.5°	843.8	768.0	648.3	560.5	531.0
45°	796.5	717.0	592.6	508.4	480.0
47.5°	751.5	667.3	539.3	455.1	429.0
50°	701.6	617.5	487.1	405.3	380.5
52.5°	653.0	564.1	437.4	359.1	336.6
55°	605.6	513.2	385.2	314.1	291.6
57.5°	557.1	462.2	339.0	272.6	253.7
60°	507.2	412.4	290.3	230.0	211.0
62.5°	458.8	363.9	248.8	192.0	182.6
65°	408.9	312.8	206.2	166.0	162.3
67.5°	361.6	265.5	166.0	145.8	142.2
70°	311.7	219.3	137.4	125.6	120.8
72.5°	264.4	176.6	114.9	105.5	103.1
75°	218.0	135.1	94.8	86.5	85.4
77.5°	171.9	95.9	74.7	69.9	67.5
80°	129.1	68.8	56.8	52.2	52.2
82.5°	90.1	46.3	39.1	36.7	36.7
85°	50.9	26.1	22.5	22.5	22.5
87.5°	19.0	9.4	9.4	8.3	8.3
90°	0.7	8.2	22.2	20.8	21.5
92.5°	14.0	19.0	19.7	20.4	20.4
95°	33.1	39.5	40.6	40.6	39.5
97.5°	55.1	60.9	63.5	63.5	63.5
100°	80.4	85.6	87.5	87.5	86.8
102.5°	107.2	111.1	113.5	114.2	113.5
105°	136.4	138.2	139.6	140.7	140.7
107.5°	165.4	168.1	168.1	168.6	165.4
110°	193.5	197.2	197.2	197.2	195.4

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	223.9	227.8	227.0	225.2	223.9
115°	253.8	257.4	256.3	255.6	253.8
117.5°	283.4	288.4	285.3	283.4	281.6
120°	313.4	318.4	313.4	313.4	311.3
122.5°	340.6	346.9	343.7	341.9	340.6
125°	369.2	374.8	373.0	370.9	370.3
127.5°	397.0	404.0	401.6	398.8	397.0
130°	423.0	431.2	430.1	428.7	426.2
132.5°	452.3	458.6	459.1	455.9	454.1
135°	477.4	484.4	485.8	485.1	483.3
137.5°	505.5	511.2	512.3	511.9	509.1
140°	530.2	535.9	539.1	539.1	536.5
142.5°	555.6	561.3	563.1	563.8	561.3
145°	579.6	584.2	587.8	588.4	586.0
147.5°	601.2	606.8	609.5	610.7	608.2
150°	623.4	627.2	629.7	631.8	629.7
152.5°	643.1	646.9	650.1	652.6	650.1
155°	662.8	664.6	666.6	669.8	667.8
157.5°	679.8	681.1	682.3	686.8	683.7
160°	695.0	696.3	697.0	700.8	698.1
162.5°	709.0	709.0	709.7	714.0	710.8
165°	721.0	720.3	720.3	724.8	721.7
167.5°	731.9	729.8	729.8	734.4	731.2
170°	740.1	738.2	737.6	742.1	738.2
172.5°	745.7	743.9	743.2	747.7	743.9
175°	750.3	748.5	747.1	751.6	747.7
177.5°	752.7	750.9	749.6	753.4	749.6
180°	751.6	751.6	751.6	751.6	751.6

TEST NUMBER: P913376

CATALOG NUMBER: DFN2DIP-HX2F0-040D030US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.48	12.37	12.39	13.29	14.47	7.47	8.35	8.38	9.27	10.46
	3H	13.14	13.93	14.06	14.86	16.07	8.64	9.43	9.56	10.37	11.57
	4H	13.73	14.48	14.67	15.42	16.64	9.08	9.83	10.02	10.77	11.98
	6H	14.14	14.83	15.09	15.77	17.00	9.39	10.08	10.34	11.02	12.25
	8H	14.26	14.91	15.21	15.87	17.10	9.48	10.13	10.43	11.09	12.32
	12H	14.31	14.93	15.27	15.88	17.14	9.51	10.14	10.47	11.09	12.34
4H	2H	11.50	12.25	12.45	13.19	14.41	8.05	8.80	9.00	9.74	10.95
	3H	13.31	13.93	14.26	14.90	16.13	9.39	10.01	10.34	10.98	12.21
	4H	13.99	14.55	14.95	15.51	16.77	9.92	10.49	10.89	11.45	12.71
	6H	14.48	14.97	15.45	15.95	17.21	10.33	10.82	11.30	11.80	13.06
	8H	14.64	15.10	15.62	16.08	17.34	10.45	10.90	11.42	11.88	13.15
	12H	14.73	15.13	15.72	16.13	17.40	10.51	10.92	11.50	11.91	13.19
8H	4H	13.95	14.41	14.93	15.39	16.65	10.19	10.65	11.17	11.63	12.90
	6H	14.49	14.87	15.49	15.89	17.16	10.69	11.07	11.69	12.09	13.35
	8H	14.69	15.02	15.70	16.03	17.32	10.87	11.20	11.88	12.21	13.49
	12H	14.82	15.11	15.83	16.11	17.44	10.98	11.27	11.99	12.27	13.60
12H	4H	13.91	14.32	14.90	15.31	16.59	10.20	10.61	11.19	11.60	12.88
	6H	14.47	14.80	15.48	15.81	17.09	10.73	11.06	11.74	12.07	13.36
	8H	14.67	14.96	15.68	15.97	17.30	10.93	11.22	11.94	12.22	13.56

END OF REPORT