

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913409

Luminaire Tested: DFN2DIP-HX2F0-050D060US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913409
REPORT IS A COMBINATION OF REPORTS P900718 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-050D060US927-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8072.3 lumens
Efficiency: N/A
Efficacy: 84.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLLONL

Luminous Intensity Polar Plot

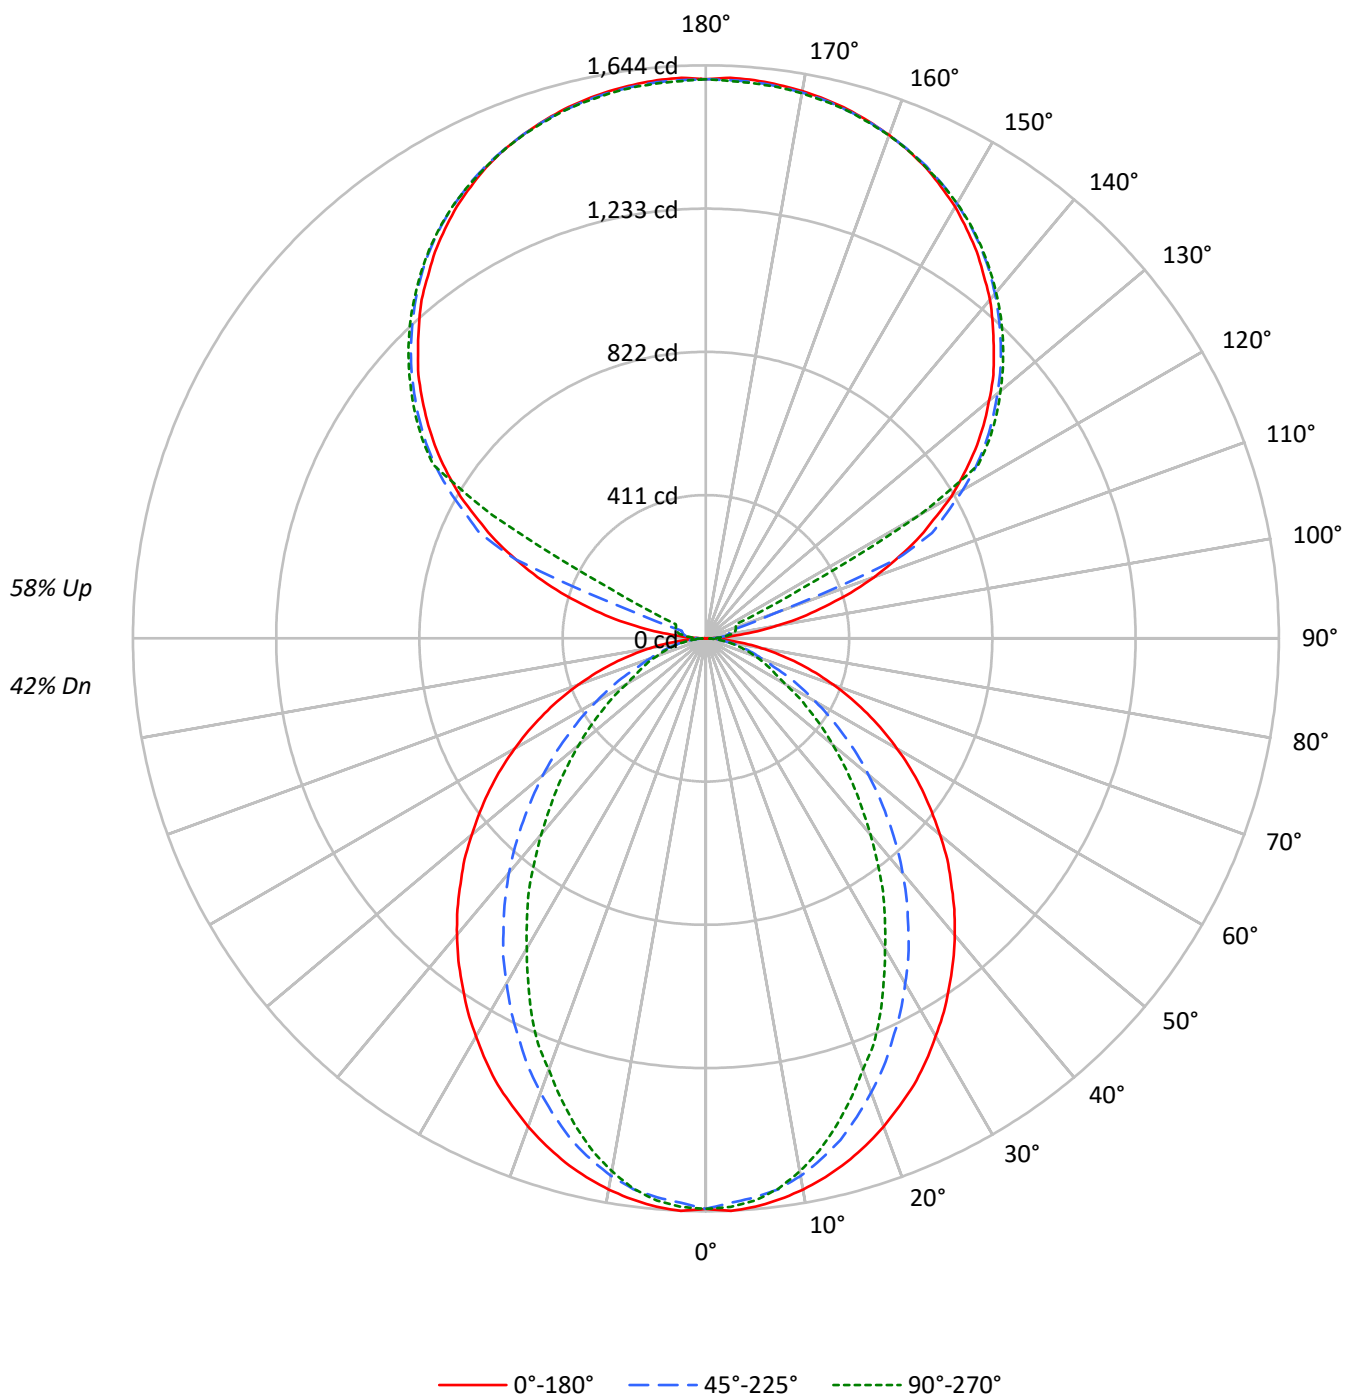

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3857	3857	3857
5°	3857	3787	3813
10°	3813	3703	3682
15°	3754	3572	3484
20°	3679	3395	3243
25°	3601	3198	3010
30°	3499	2997	2718
35°	3399	2781	2461
40°	3297	2559	2169
45°	3179	2315	1903
50°	3056	2068	1645
55°	2928	1806	1397
60°	2779	1534	1143
65°	2606	1258	1022
70°	2398	1001	915
75°	2135	865	818
80°	1756	701	688
85°	1150	432	482

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3179 cd/sqm

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	153.4	1.9
10°-20°	421.2	5.2
20°-30°	591.3	7.3
30°-40°	644.6	8.0
40°-50°	592.4	7.3
50°-60°	465.3	5.8
60°-70°	302.9	3.8
70°-80°	155.9	1.9
80°-90°	42.6	0.5
90°-100°	52.9	0.7
100°-110°	197.2	2.4
110°-120°	523.0	6.5
120°-130°	867.4	10.7
130°-140°	921.3	11.4
140°-150°	856.3	10.6
150°-160°	688.4	8.5
160°-170°	443.6	5.5
170°-180°	152.7	1.9
0°-30°	1165.9	14.4
0°-40°	1810.5	22.4
0°-60°	2868.2	35.5
0°-90°	3369.6	41.7
90°-120°	773.0	9.6
90°-150°	3418.0	42.3
90°-180°	4703.0	58.3
0°-180°	8072.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1637	1637	1637	1637	1637	
5°	1637	1630	1610	1624	1619	155
15°	1557	1541	1490	1462	1448	439
25°	1413	1366	1268	1207	1185	650
35°	1218	1142	1012	918	886	762
45°	996	896	741	636	600	769
55°	757	641	481	393	364	676
65°	511	391	258	208	203	507
75°	273	169	118	108	107	288
85°	64	33	28	28	28	73
90°	1	14	23	29	31	8
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1637.0	1637.0	1637.0	1637.0	1637.0
2.5°	1644.4	1637.0	1620.7	1635.6	1632.6
5°	1637.0	1629.7	1610.3	1623.7	1619.3
7.5°	1623.7	1614.9	1594.1	1600.0	1592.5
10°	1605.9	1595.5	1566.0	1561.5	1552.6
12.5°	1583.7	1570.4	1530.3	1521.5	1505.1
15°	1557.0	1540.7	1490.4	1462.3	1447.5
17.5°	1525.9	1502.2	1439.9	1407.4	1383.6
20°	1490.4	1460.7	1386.6	1349.7	1317.0
22.5°	1451.9	1417.8	1331.8	1281.5	1259.3
25°	1413.3	1365.9	1268.1	1207.4	1185.1
27.5°	1367.5	1317.0	1208.9	1139.2	1105.2
30°	1318.6	1262.2	1143.7	1068.2	1028.1
32.5°	1271.1	1202.9	1081.6	992.6	955.5
35°	1217.8	1142.2	1011.9	918.5	885.9
37.5°	1165.9	1084.4	946.7	844.4	807.5
40°	1111.1	1022.3	878.4	773.3	734.8
42.5°	1054.9	960.0	810.4	700.7	663.8
45°	995.6	896.3	740.8	635.5	599.9
47.5°	939.3	834.2	674.1	568.9	536.3
50°	877.1	771.9	608.9	506.6	475.6
52.5°	816.3	705.1	546.7	448.9	420.8
55°	757.0	641.4	481.4	392.6	364.5
57.5°	696.3	577.8	423.7	340.8	317.0
60°	634.1	515.6	362.9	287.5	263.7
62.5°	573.4	454.9	311.1	240.0	228.2
65°	511.1	391.1	257.8	207.5	203.0
67.5°	451.9	331.8	207.5	182.2	177.8
70°	389.7	274.1	171.8	157.0	151.1
72.5°	330.4	220.7	143.7	131.9	128.9
75°	272.6	168.8	118.5	108.1	106.7
77.5°	214.8	119.9	93.4	87.4	84.4
80°	161.4	86.0	71.1	65.2	65.2
82.5°	112.6	57.8	48.9	45.9	45.9
85°	63.7	32.6	28.1	28.1	28.1
87.5°	23.8	11.8	11.8	10.4	10.4
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P913409

CATALOG NUMBER: DFN2DIP-HX2F0-050D060US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.88	11.65	11.91	12.68	14.07	6.86	7.63	7.89	8.66	10.05
	3H	12.53	13.21	13.57	14.25	15.66	8.03	8.71	9.07	9.76	11.16
	4H	13.11	13.76	14.17	14.81	16.22	8.46	9.11	9.52	10.16	11.57
	6H	13.51	14.11	14.57	15.16	16.58	8.77	9.36	9.83	10.41	11.84
	8H	13.63	14.19	14.69	15.26	16.68	8.85	9.41	9.91	10.48	11.90
	12H	13.67	14.21	14.75	15.27	16.72	8.88	9.42	9.95	10.48	11.92
4H	2H	10.88	11.53	11.94	12.58	13.99	7.43	8.08	8.49	9.13	10.54
	3H	12.68	13.22	13.75	14.29	15.72	8.76	9.30	9.83	10.37	11.80
	4H	13.35	13.84	14.42	14.91	16.36	9.29	9.78	10.36	10.85	12.30
	6H	13.84	14.26	14.92	15.35	16.79	9.69	10.11	10.77	11.20	12.64
	8H	14.00	14.39	15.08	15.47	16.93	9.80	10.20	10.89	11.28	12.74
	12H	14.08	14.43	15.17	15.53	16.99	9.86	10.21	10.96	11.31	12.77
8H	4H	13.31	13.70	14.39	14.78	16.24	9.55	9.95	10.63	11.03	12.48
	6H	13.84	14.17	14.95	15.29	16.75	10.04	10.37	11.15	11.49	12.95
	8H	14.04	14.33	15.16	15.43	16.91	10.22	10.51	11.33	11.61	13.09
	12H	14.16	14.42	15.28	15.51	17.03	10.32	10.57	11.44	11.67	13.19
12H	4H	13.26	13.61	14.36	14.71	16.17	9.55	9.91	10.65	11.00	12.46
	6H	13.82	14.10	14.93	15.21	16.68	10.09	10.37	11.20	11.48	12.95
	8H	14.02	14.27	15.13	15.37	16.88	10.28	10.53	11.39	11.63	13.14

END OF REPORT