

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913419

Luminaire Tested: DFN2DIP-HX2F0-060D040US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913419
REPORT IS A COMBINATION OF REPORTS P900699 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D040US927-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7842.6 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 88.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

Luminous Intensity Polar Plot

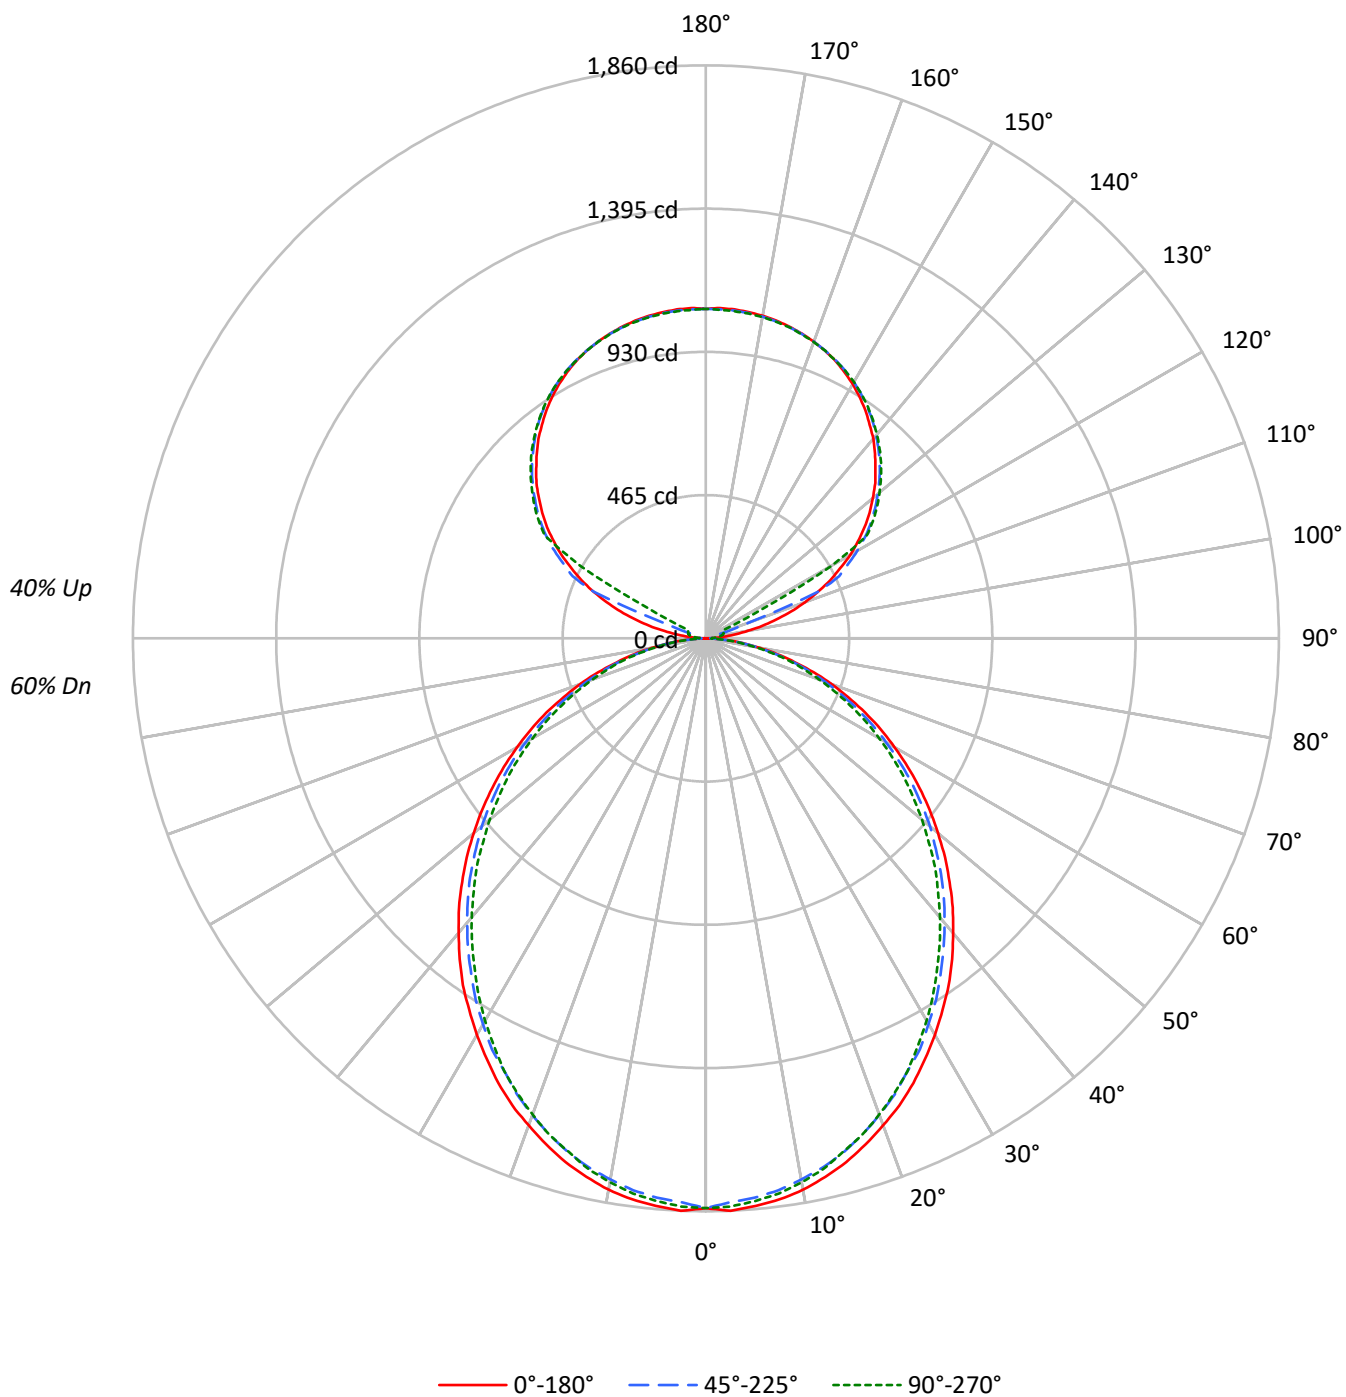

TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4357	4357	4357
5°	4357	4286	4318
10°	4315	4218	4251
15°	4245	4139	4152
20°	4152	4032	4051
25°	4060	3906	3935
30°	3946	3789	3790
35°	3837	3652	3637
40°	3705	3513	3490
45°	3572	3373	3340
50°	3427	3226	3167
55°	3274	3056	3006
60°	3101	2857	2822
65°	2911	2648	2604
70°	2670	2393	2368
75°	2339	2088	2140
80°	1936	1701	1727
85°	1314	1067	1070

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3572 cd/sqm

TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	174.1	2.2
10°-20°	489.8	6.2
20°-30°	719.8	9.2
30°-40°	836.0	10.7
40°-50°	834.9	10.6
50°-60°	728.0	9.3
60°-70°	538.2	6.9
70°-80°	304.5	3.9
80°-90°	82.2	1.0
90°-100°	35.2	0.4
100°-110°	131.5	1.7
110°-120°	348.6	4.4
120°-130°	578.2	7.4
130°-140°	614.2	7.8
140°-150°	570.9	7.3
150°-160°	458.9	5.9
160°-170°	295.7	3.8
170°-180°	101.8	1.3
0°-30°	1383.6	17.6
0°-40°	2219.6	28.3
0°-60°	3782.5	48.2
0°-90°	4707.4	60.0
90°-120°	515.3	6.6
90°-150°	2278.7	29.1
90°-180°	3135.0	40.0
0°-180°	7842.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1849	1849	1849	1849	1849	
5°	1849	1842	1823	1837	1834	176
15°	1760	1750	1727	1734	1725	496
25°	1593	1579	1549	1552	1549	733
35°	1375	1357	1328	1318	1309	858
45°	1119	1106	1079	1060	1053	863
55°	847	836	814	793	784	757
65°	571	560	542	526	518	564
75°	299	295	286	276	279	319
85°	73	71	69	64	62	81
90°	1	9	15	19	21	7
95°	50	25	30	34	33	60
105°	235	258	47	56	59	251
115°	445	458	477	119	64	438
125°	629	639	654	659	662	561
135°	778	791	798	806	804	601
145°	903	902	915	921	917	565
155°	994	988	997	1001	995	458
165°	1048	1043	1045	1051	1045	296
175°	1072	1066	1068	1073	1066	102
180°	1069	1069	1069	1069	1069	

TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1849.4	1849.4	1849.4	1849.4	1849.4
2.5°	1860.2	1851.3	1831.7	1849.4	1846.0
5°	1849.4	1842.5	1822.8	1837.0	1833.6
7.5°	1837.0	1826.5	1806.8	1821.1	1817.6
10°	1817.6	1805.1	1783.8	1797.9	1792.6
12.5°	1790.8	1780.2	1758.9	1767.8	1764.2
15°	1760.5	1750.0	1726.8	1734.0	1725.1
17.5°	1723.2	1712.7	1689.5	1698.3	1689.5
20°	1682.3	1671.7	1646.8	1652.1	1645.1
22.5°	1641.6	1625.5	1602.3	1602.3	1598.7
25°	1593.4	1579.3	1549.0	1552.4	1549.0
27.5°	1540.0	1527.6	1504.5	1499.3	1490.4
30°	1486.8	1472.4	1445.9	1440.6	1433.4
32.5°	1429.8	1419.3	1390.8	1380.0	1372.8
35°	1374.8	1357.0	1328.5	1317.7	1308.8
37.5°	1312.5	1296.4	1268.0	1255.4	1246.6
40°	1248.5	1234.1	1205.7	1189.9	1182.6
42.5°	1186.2	1171.9	1143.6	1125.7	1115.1
45°	1118.7	1106.2	1079.4	1060.0	1052.8
47.5°	1052.8	1040.4	1011.9	992.3	981.7
50°	983.4	974.5	949.7	924.7	915.8
52.5°	915.8	903.4	880.4	860.8	848.3
55°	846.6	835.8	814.5	793.2	784.3
57.5°	777.2	768.3	745.1	723.8	716.6
60°	707.7	700.8	675.9	656.2	650.9
62.5°	640.2	627.7	610.0	592.2	585.1
65°	570.9	560.2	542.5	526.4	517.5
67.5°	499.8	490.8	474.9	462.5	455.3
70°	434.0	426.8	410.7	398.3	391.3
72.5°	366.4	359.3	350.4	337.9	332.6
75°	298.7	295.3	286.2	275.7	279.2
77.5°	238.3	231.2	227.5	222.3	217.0
80°	177.9	176.0	172.5	167.2	163.6
82.5°	121.0	121.0	119.2	112.1	112.1
85°	72.8	71.1	69.4	63.9	62.3
87.5°	32.1	28.5	24.9	19.6	17.7
90°	0.7	9.3	15.4	19.4	20.8
92.5°	19.4	16.2	18.5	20.1	20.8
95°	50.2	24.7	30.1	34.1	33.3
97.5°	90.5	27.1	39.5	41.8	42.5
100°	137.0	31.0	44.1	50.2	51.8
102.5°	188.0	186.6	45.6	54.1	56.5
105°	235.2	258.5	47.2	55.7	58.8
107.5°	290.2	309.5	48.8	57.3	60.4
110°	342.9	359.0	135.5	58.1	61.1



TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	392.4	406.2	393.1	59.6	61.9
115°	444.9	458.0	477.4	119.1	63.5
117.5°	490.6	506.0	519.3	408.5	205.8
120°	541.7	553.3	567.2	576.5	472.1
122.5°	584.9	597.4	612.9	617.5	618.3
125°	629.1	639.2	653.9	659.3	661.6
127.5°	669.3	680.2	691.8	699.6	700.3
130°	707.3	719.7	728.1	736.6	735.9
132.5°	745.9	756.1	764.5	771.5	770.8
135°	778.5	790.9	797.8	805.6	804.1
137.5°	812.5	821.7	829.6	837.3	835.0
140°	845.7	852.0	860.5	867.4	863.6
142.5°	873.7	879.1	889.1	895.2	891.4
145°	903.1	902.3	915.4	920.8	916.9
147.5°	928.5	926.2	939.4	943.3	940.2
150°	953.3	947.9	960.4	965.0	961.1
152.5°	974.2	968.0	979.6	984.3	978.9
155°	994.3	987.5	996.7	1001.3	995.1
157.5°	1010.6	1004.4	1011.5	1016.8	1010.6
160°	1024.5	1019.9	1024.5	1029.1	1023.7
162.5°	1036.9	1032.3	1036.2	1041.6	1034.6
165°	1047.7	1043.1	1045.4	1050.8	1045.4
167.5°	1056.3	1051.5	1054.0	1059.4	1052.4
170°	1063.3	1058.6	1060.1	1065.6	1058.6
172.5°	1067.9	1063.3	1064.8	1070.2	1063.3
175°	1071.7	1066.3	1067.9	1073.2	1065.6
177.5°	1073.2	1067.9	1068.7	1074.1	1067.1
180°	1069.4	1069.4	1069.4	1069.4	1069.4

TEST NUMBER: P913419

CATALOG NUMBER: DFN2DIP-HX2F0-060D040US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.13	14.09	13.99	14.97	16.09	12.70	13.66	13.57	14.55	15.67
	3H	14.77	15.63	15.65	16.53	17.67	14.31	15.17	15.19	16.07	17.21
	4H	15.34	16.16	16.24	17.06	18.22	14.88	15.70	15.78	16.60	17.76
	6H	15.73	16.48	16.64	17.39	18.56	15.27	16.02	16.18	16.93	18.10
	8H	15.83	16.54	16.74	17.47	18.64	15.37	16.08	16.28	17.01	18.18
	12H	15.87	16.55	16.79	17.47	18.67	15.41	16.09	16.33	17.01	18.20
4H	2H	13.59	14.40	14.49	15.31	16.46	13.25	14.06	14.15	14.97	16.12
	3H	15.44	16.11	16.35	17.05	18.22	15.05	15.73	15.96	16.67	17.84
	4H	16.13	16.75	17.05	17.68	18.88	15.74	16.36	16.66	17.29	18.49
	6H	16.63	17.17	17.57	18.12	19.32	16.24	16.77	17.17	17.72	18.92
	8H	16.77	17.27	17.71	18.22	19.43	16.37	16.87	17.31	17.82	19.03
	12H	16.84	17.29	17.79	18.25	19.47	16.43	16.88	17.39	17.85	19.07
8H	4H	16.33	16.83	17.26	17.77	18.99	15.98	16.48	16.91	17.42	18.63
	6H	16.93	17.35	17.90	18.34	19.55	16.58	17.00	17.55	17.99	19.20
	8H	17.14	17.50	18.11	18.48	19.71	16.78	17.15	17.76	18.13	19.36
	12H	17.26	17.58	18.23	18.55	19.83	16.89	17.21	17.87	18.18	19.46
12H	4H	16.32	16.77	17.27	17.73	18.95	15.97	16.42	16.93	17.39	18.60
	6H	16.96	17.33	17.93	18.30	19.53	16.62	16.98	17.59	17.96	19.19
	8H	17.19	17.51	18.16	18.48	19.76	16.84	17.16	17.82	18.14	19.41