

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916060

Luminaire Tested: DFN2DIP-HX2F0-020D020US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916060
REPORT IS A COMBINATION OF REPORTS P899152 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-020D020US930-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2829.1 lumens
Efficiency: N/A
Efficacy: 92.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 30.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLLFLL

Luminous Intensity Polar Plot

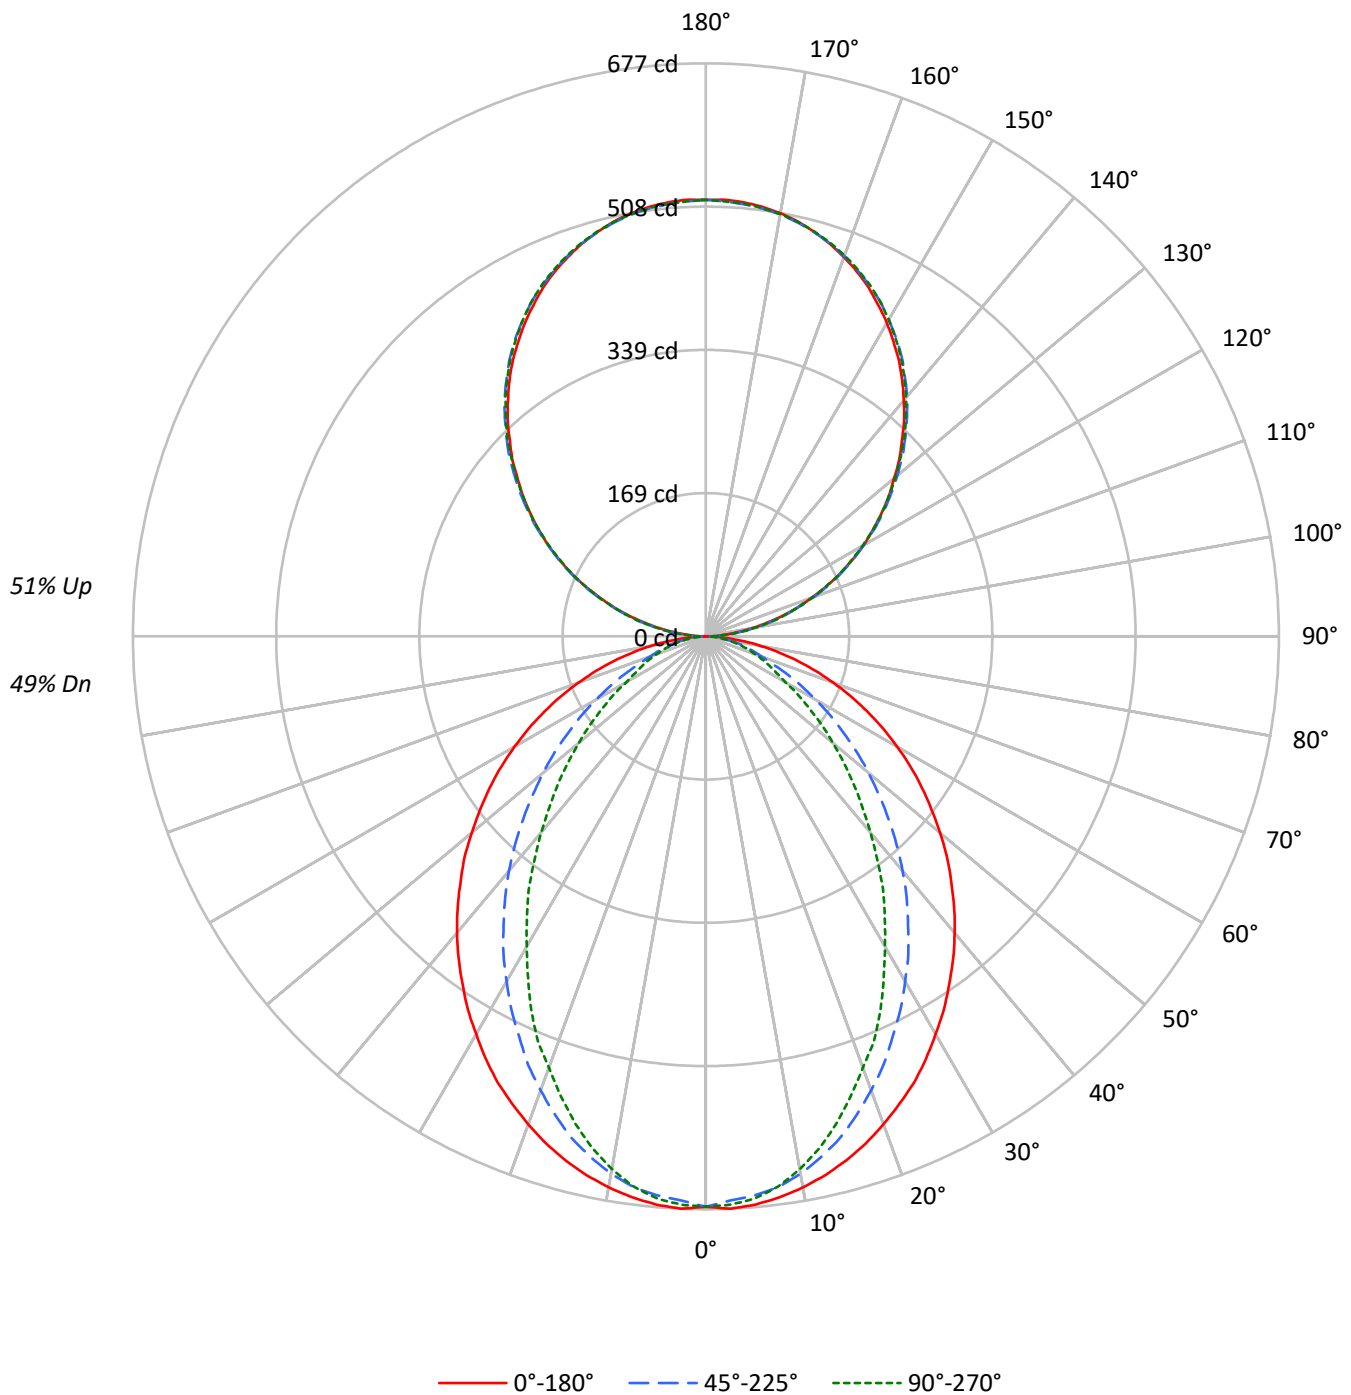

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1588	1588	1588
5°	1588	1559	1570
10°	1570	1525	1516
15°	1546	1470	1434
20°	1514	1398	1335
25°	1483	1316	1239
30°	1441	1234	1119
35°	1399	1145	1013
40°	1357	1054	893
45°	1309	953	784
50°	1258	852	677
55°	1205	744	575
60°	1144	631	471
65°	1073	518	421
70°	987	412	376
75°	879	356	337
80°	723	289	283
85°	473	178	199

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1309 cd/sqm

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.2	2.2
10°-20°	173.4	6.1
20°-30°	243.4	8.6
30°-40°	265.4	9.4
40°-50°	243.9	8.6
50°-60°	191.5	6.8
60°-70°	124.7	4.4
70°-80°	64.2	2.3
80°-90°	17.8	0.6
90°-100°	31.9	1.1
100°-110°	101.4	3.6
110°-120°	173.5	6.1
120°-130°	228.2	8.1
130°-140°	256.1	9.1
140°-150°	251.2	8.9
150°-160°	210.7	7.4
160°-170°	139.7	4.9
170°-180°	48.8	1.7
0°-30°	480.0	17.0
0°-40°	745.3	26.3
0°-60°	1180.8	41.7
0°-90°	1387.5	49.0
90°-120°	306.8	10.8
90°-150°	1042.3	36.8
90°-180°	1442.0	51.0
0°-180°	2829.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	674	674	674	674	674	
5°	674	671	663	668	667	64
15°	641	634	614	602	596	181
25°	582	562	522	497	488	268
35°	501	470	417	378	365	314
45°	410	369	305	262	247	317
55°	312	264	198	162	150	278
65°	210	161	106	85	84	209
75°	112	70	49	44	44	119
85°	26	13	12	12	12	30
90°	0	6	15	14	15	3
95°	23	27	28	28	27	25
105°	94	95	96	96	96	99
115°	174	177	176	175	174	172
125°	253	257	256	254	254	226
135°	328	332	333	333	332	253
145°	398	401	403	404	402	248
155°	455	456	457	460	458	209
165°	495	494	494	497	495	140
175°	515	514	513	516	513	49
180°	516	516	516	516	516	

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	673.9	673.9	673.9	673.9	673.9
2.5°	676.9	673.9	667.2	673.4	672.1
5°	673.9	670.9	662.9	668.5	666.6
7.5°	668.5	664.8	656.2	658.7	655.6
10°	661.1	656.8	644.7	642.8	639.2
12.5°	652.0	646.4	630.0	626.4	619.6
15°	641.0	634.2	613.5	601.9	595.9
17.5°	628.2	618.4	592.8	579.4	569.6
20°	613.5	601.3	570.9	555.6	542.2
22.5°	597.7	583.7	548.3	527.6	518.4
25°	581.9	562.3	522.0	497.1	487.9
27.5°	563.0	542.2	497.7	469.0	454.9
30°	542.8	519.6	470.8	439.8	423.2
32.5°	523.3	495.2	445.2	408.6	393.4
35°	501.3	470.3	416.6	378.1	364.7
37.5°	480.0	446.4	389.7	347.6	332.4
40°	457.4	420.9	361.7	318.4	302.5
42.5°	434.2	395.3	333.6	288.5	273.3
45°	409.9	368.9	305.0	261.6	247.0
47.5°	386.7	343.4	277.5	234.2	220.8
50°	361.1	317.8	250.7	208.6	195.8
52.5°	336.0	290.2	225.0	184.8	173.3
55°	311.6	264.1	198.2	161.7	150.0
57.5°	286.7	237.8	174.5	140.3	130.5
60°	261.1	212.2	149.4	118.4	108.6
62.5°	236.0	187.3	128.1	98.8	93.9
65°	210.4	161.0	106.2	85.4	83.6
67.5°	186.1	136.6	85.4	75.0	73.2
70°	160.4	112.8	70.7	64.7	62.2
72.5°	136.0	90.8	59.1	54.3	53.1
75°	112.2	69.5	48.8	44.5	43.9
77.5°	88.5	49.4	38.4	36.0	34.7
80°	66.4	35.4	29.3	26.8	26.8
82.5°	46.3	23.8	20.1	18.9	18.9
85°	26.2	13.4	11.6	11.6	11.6
87.5°	9.8	4.9	4.9	4.2	4.2
90°	0.5	5.6	15.2	14.3	14.8
92.5°	9.6	13.0	13.5	14.0	14.0
95°	22.7	27.1	27.8	27.8	27.1
97.5°	37.7	41.8	43.5	43.5	43.5
100°	55.2	58.8	60.0	60.0	59.5
102.5°	73.5	76.1	77.9	78.4	77.9
105°	93.6	94.8	95.8	96.5	96.5
107.5°	113.5	115.4	115.4	115.7	113.5
110°	132.8	135.3	135.3	135.3	134.0

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	153.6	156.2	155.8	154.5	153.6
115°	174.1	176.6	175.9	175.4	174.1
117.5°	194.5	198.0	195.8	194.5	193.2
120°	215.0	218.4	215.0	215.0	213.6
122.5°	233.7	238.0	235.9	234.6	233.7
125°	253.2	257.1	255.9	254.5	254.0
127.5°	272.4	277.2	275.5	273.6	272.4
130°	290.2	295.9	295.1	294.2	292.4
132.5°	310.3	314.7	314.9	312.8	311.5
135°	327.6	332.4	333.3	332.9	331.6
137.5°	346.8	350.7	351.6	351.2	349.4
140°	363.8	367.7	369.9	369.9	368.2
142.5°	381.2	385.1	386.4	386.8	385.1
145°	397.7	400.8	403.3	403.7	402.0
147.5°	412.5	416.4	418.2	419.0	417.3
150°	427.7	430.3	432.0	433.4	432.0
152.5°	441.2	443.8	446.0	447.8	446.0
155°	454.8	456.0	457.4	459.6	458.2
157.5°	466.4	467.3	468.1	471.2	469.0
160°	476.9	477.8	478.3	480.9	479.0
162.5°	486.5	486.5	486.9	489.9	487.7
165°	494.7	494.2	494.2	497.3	495.2
167.5°	502.1	500.8	500.8	503.9	501.7
170°	507.8	506.5	506.1	509.2	506.5
172.5°	511.7	510.4	510.0	513.1	510.4
175°	514.8	513.6	512.6	515.7	513.1
177.5°	516.5	515.3	514.3	516.9	514.3
180°	515.7	515.7	515.7	515.7	515.7

TEST NUMBER: P916060

CATALOG NUMBER: DFN2DIP-HX2F0-020D020US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.52	9.35	9.50	10.33	11.62	4.51	5.33	5.48	6.31	7.60
	3H	10.18	10.91	11.16	11.90	13.21	5.68	6.42	6.66	7.41	8.72
	4H	10.77	11.46	11.76	12.46	13.77	6.12	6.81	7.11	7.81	9.13
	6H	11.17	11.81	12.17	12.81	14.14	6.42	7.06	7.43	8.06	9.39
	8H	11.28	11.89	12.30	12.91	14.23	6.50	7.11	7.52	8.13	9.46
	12H	11.33	11.91	12.35	12.92	14.27	6.54	7.12	7.56	8.13	9.48
4H	2H	8.54	9.23	9.54	10.23	11.54	5.09	5.78	6.09	6.78	8.10
	3H	10.34	10.92	11.35	11.94	13.27	6.42	7.00	7.43	8.02	9.35
	4H	11.01	11.54	12.03	12.55	13.91	6.95	7.48	7.97	8.50	9.85
	6H	11.50	11.95	12.53	12.99	14.35	7.35	7.80	8.38	8.84	10.20
	8H	11.66	12.09	12.69	13.12	14.48	7.47	7.89	8.50	8.93	10.29
	12H	11.74	12.12	12.79	13.17	14.54	7.53	7.91	8.57	8.95	10.33
8H	4H	10.97	11.40	12.00	12.43	13.79	7.22	7.64	8.25	8.67	10.04
	6H	11.51	11.86	12.57	12.94	14.30	7.71	8.06	8.76	9.13	10.50
	8H	11.71	12.02	12.77	13.08	14.46	7.89	8.19	8.95	9.25	10.64
	12H	11.83	12.10	12.90	13.16	14.58	7.99	8.26	9.06	9.32	10.74
12H	4H	10.92	11.31	11.97	12.35	13.72	7.22	7.60	8.26	8.65	10.02
	6H	11.49	11.79	12.55	12.85	14.23	7.75	8.06	8.81	9.12	10.50
	8H	11.69	11.96	12.75	13.01	14.44	7.95	8.22	9.01	9.27	10.70

END OF REPORT