

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916082

Luminaire Tested: DFN2DIP-HX2F0-030D030US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916082
REPORT IS A COMBINATION OF REPORTS P899163 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-030D030US930-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4586.0 lumens
Efficiency: N/A
Efficacy: 97.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 47
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

Luminous Intensity Polar Plot

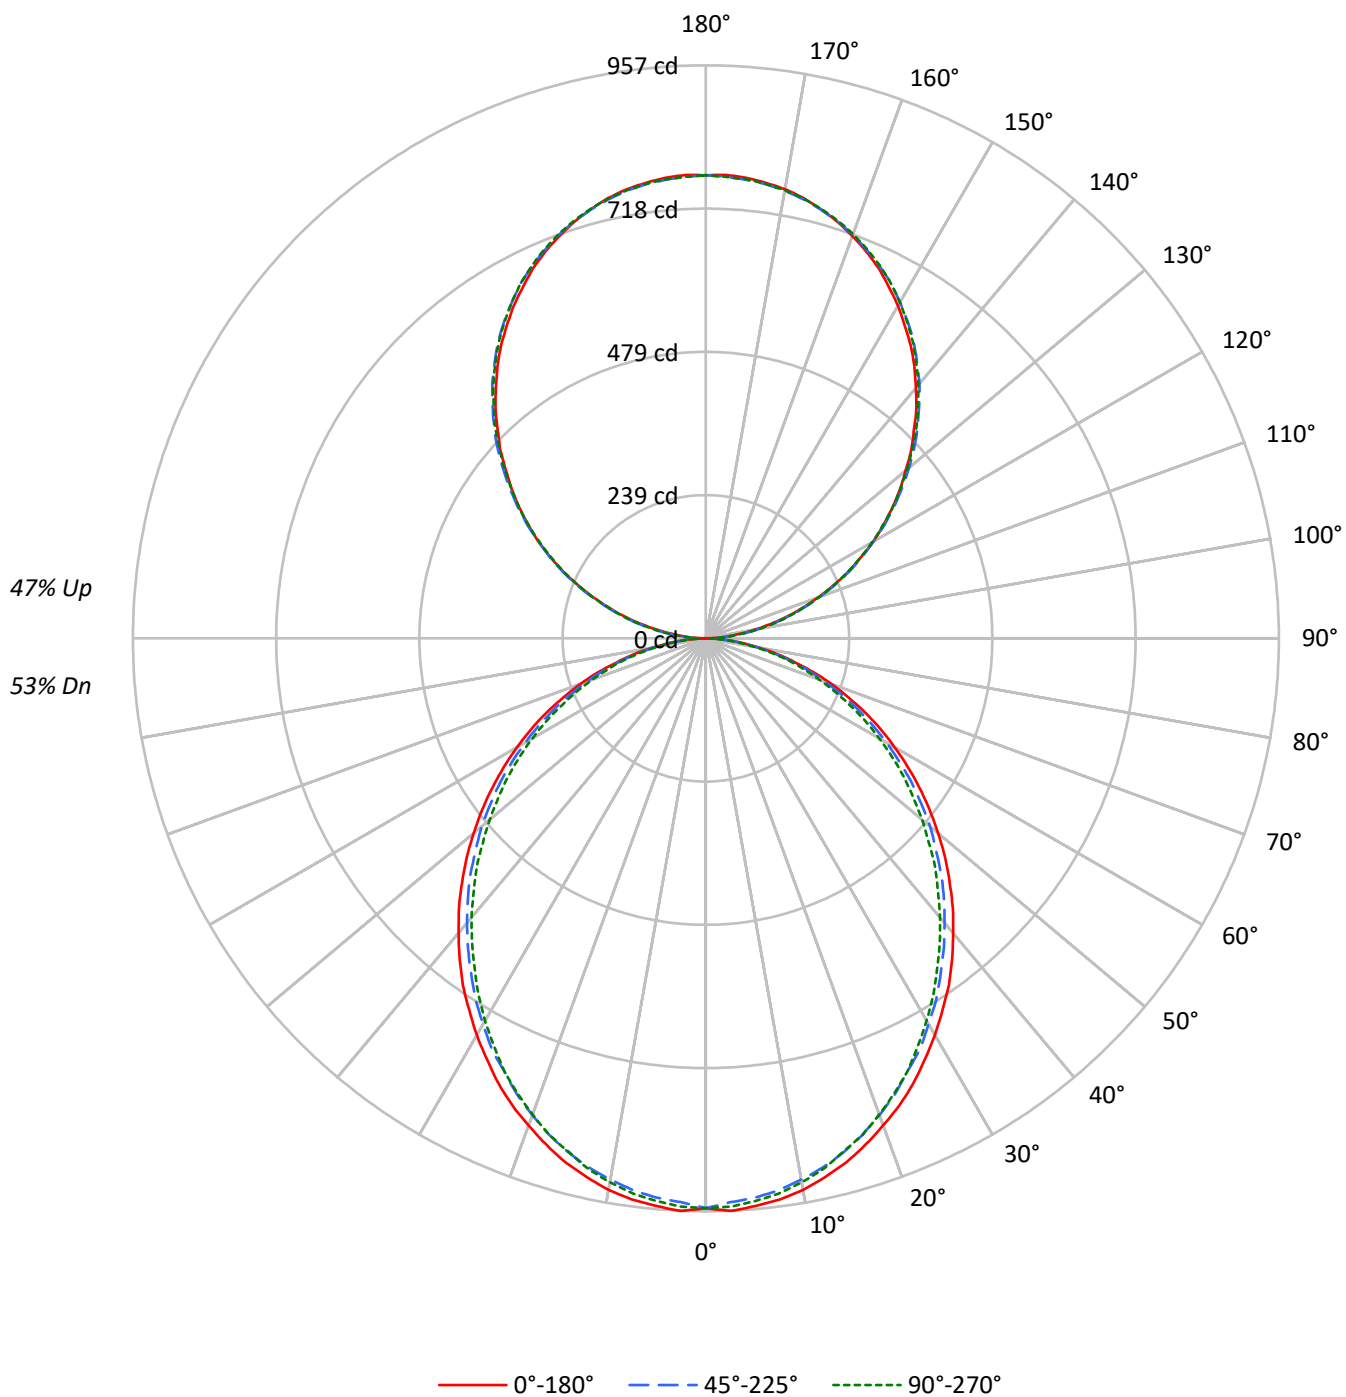

TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59
1	98	94	90	87	91	87	84	81	74	72	70	63	61	59	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	75	67	61	55	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	52	47	51	46	41	43	39	36	36	33	31
5	69	57	49	43	63	53	46	40	46	40	36	39	35	31	33	29	27
6	63	51	43	37	58	48	40	35	41	36	31	35	31	27	30	26	24
7	59	46	38	33	54	43	36	31	37	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	24	29	25	22	25	21	19
9	51	38	31	26	47	36	29	24	31	26	22	27	23	19	23	20	17
10	47	35	28	23	44	33	26	22	29	23	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2242	2242	2242
5°	2242	2206	2222
10°	2221	2171	2188
15°	2184	2130	2137
20°	2137	2075	2084
25°	2089	2010	2025
30°	2031	1949	1950
35°	1975	1879	1871
40°	1906	1808	1796
45°	1838	1736	1719
50°	1764	1660	1630
55°	1685	1573	1547
60°	1596	1470	1452
65°	1498	1363	1341
70°	1374	1232	1219
75°	1204	1075	1102
80°	997	875	889
85°	677	549	549

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1838 cd/sqm

TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	89.6	2.0
10°-20°	252.0	5.5
20°-30°	370.4	8.1
30°-40°	430.2	9.4
40°-50°	429.7	9.4
50°-60°	374.6	8.2
60°-70°	277.0	6.0
70°-80°	156.7	3.4
80°-90°	43.5	0.9
90°-100°	47.9	1.0
100°-110°	152.1	3.3
110°-120°	260.3	5.7
120°-130°	342.3	7.5
130°-140°	384.2	8.4
140°-150°	376.8	8.2
150°-160°	316.1	6.9
160°-170°	209.6	4.6
170°-180°	73.3	1.6
0°-30°	712.0	15.5
0°-40°	1142.2	24.9
0°-60°	1946.5	42.4
0°-90°	2423.6	52.8
90°-120°	460.2	10.0
90°-150°	1563.5	34.1
90°-180°	2162.0	47.1
0°-180°	4586.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	952	952	952	952	952	
5°	952	948	938	945	944	90
15°	906	901	889	892	888	255
25°	820	813	797	799	797	377
35°	707	698	684	678	674	442
45°	576	569	556	545	542	444
55°	436	430	419	408	404	390
65°	294	288	279	271	266	290
75°	154	152	147	142	144	164
85°	38	37	36	33	32	42
90°	1	8	23	21	22	4
95°	34	41	42	42	41	38
105°	140	142	144	145	145	148
115°	261	265	264	263	261	258
125°	380	386	384	382	381	339
135°	491	499	500	499	497	380
145°	597	601	605	606	603	373
155°	682	684	686	689	687	314
165°	742	741	741	746	743	209
175°	772	770	769	774	770	73
180°	774	774	774	774	774	

TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	951.7	951.7	951.7	951.7	951.7
2.5°	957.2	952.7	942.6	951.7	950.0
5°	951.7	948.1	938.0	945.3	943.5
7.5°	945.3	939.9	929.8	937.2	935.3
10°	935.3	928.9	917.9	925.2	922.5
12.5°	921.5	916.1	905.1	909.6	907.8
15°	906.0	900.6	888.6	892.3	887.7
17.5°	886.7	881.3	869.4	873.9	869.4
20°	865.7	860.2	847.4	850.1	846.5
22.5°	844.7	836.5	824.5	824.5	822.6
25°	819.9	812.7	797.1	798.9	797.1
27.5°	792.5	786.0	774.2	771.5	767.0
30°	765.1	757.7	744.0	741.3	737.6
32.5°	735.8	730.3	715.7	710.1	706.5
35°	707.4	698.3	683.6	678.1	673.5
37.5°	675.4	667.2	652.5	646.0	641.5
40°	642.5	635.1	620.4	612.3	608.6
42.5°	610.4	603.1	588.5	579.3	573.8
45°	575.7	569.2	555.5	545.4	541.8
47.5°	541.8	535.4	520.7	510.6	505.2
50°	506.1	501.5	488.7	475.9	471.3
52.5°	471.3	464.9	453.1	443.0	436.5
55°	435.7	430.2	419.1	408.2	403.7
57.5°	399.9	395.3	383.4	372.4	368.8
60°	364.2	360.6	347.8	337.7	335.0
62.5°	329.5	323.0	313.9	304.8	301.1
65°	293.8	288.3	279.2	270.9	266.4
67.5°	257.2	252.6	244.3	238.0	234.3
70°	223.3	219.6	211.4	205.0	201.4
72.5°	188.6	184.8	180.3	173.9	171.2
75°	153.7	152.0	147.3	141.9	143.7
77.5°	122.6	119.0	117.1	114.4	111.7
80°	91.6	90.6	88.7	86.0	84.2
82.5°	62.2	62.2	61.4	57.6	57.6
85°	37.5	36.6	35.7	32.9	32.0
87.5°	16.5	14.7	12.8	10.1	9.1
90°	0.7	8.4	22.8	21.4	22.2
92.5°	14.4	19.6	20.3	21.0	21.0
95°	34.1	40.6	41.7	41.7	40.6
97.5°	56.7	62.7	65.3	65.3	65.3
100°	82.8	88.1	90.0	90.0	89.4
102.5°	110.3	114.3	116.8	117.6	116.8
105°	140.4	142.3	143.7	144.8	144.8
107.5°	170.2	173.0	173.0	173.5	170.2
110°	199.2	202.9	202.9	202.9	201.1



TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	230.4	234.4	233.7	231.8	230.4
115°	261.2	264.9	263.7	263.1	261.2
117.5°	291.7	296.9	293.6	291.7	289.8
120°	322.5	327.7	322.5	322.5	320.4
122.5°	350.5	357.0	353.8	351.9	350.5
125°	379.9	385.7	383.8	381.7	381.1
127.5°	408.5	415.8	413.3	410.4	408.5
130°	435.4	443.8	442.6	441.2	438.6
132.5°	465.5	472.0	472.5	469.2	467.3
135°	491.4	498.6	500.0	499.3	497.4
137.5°	520.2	526.1	527.3	526.8	524.0
140°	545.7	551.5	554.8	554.8	552.2
142.5°	571.9	577.6	579.5	580.2	577.6
145°	596.6	601.2	605.0	605.6	603.1
147.5°	618.7	624.5	627.3	628.5	625.9
150°	641.6	645.6	648.1	650.2	648.1
152.5°	661.9	665.8	669.0	671.6	669.0
155°	682.2	684.0	686.1	689.3	687.3
157.5°	699.6	701.0	702.2	706.9	703.6
160°	715.3	716.6	717.4	721.3	718.5
162.5°	729.7	729.7	730.4	734.8	731.6
165°	742.1	741.4	741.4	746.0	742.7
167.5°	753.3	751.1	751.1	755.8	752.5
170°	761.7	759.8	759.1	763.8	759.8
172.5°	767.4	765.6	764.9	769.6	765.6
175°	772.2	770.3	768.9	773.6	769.6
177.5°	774.7	772.8	771.4	775.4	771.4
180°	773.6	773.6	773.6	773.6	773.6

TEST NUMBER: P916082

CATALOG NUMBER: DFN2DIP-HX2F0-030D030US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.20	11.09	11.13	12.04	13.27	9.78	10.66	10.71	11.61	12.84
	3H	11.84	12.63	12.78	13.59	14.84	11.38	12.17	12.32	13.13	14.38
	4H	12.41	13.16	13.37	14.12	15.39	11.95	12.70	12.91	13.67	14.93
	6H	12.79	13.48	13.76	14.45	15.73	12.33	13.03	13.30	13.99	15.27
	8H	12.89	13.55	13.86	14.53	15.81	12.43	13.09	13.40	14.08	15.35
	12H	12.93	13.56	13.91	14.53	15.83	12.46	13.09	13.45	14.07	15.37
4H	2H	10.65	11.41	11.62	12.37	13.63	10.31	11.07	11.28	12.03	13.29
	3H	12.49	13.12	13.47	14.11	15.39	12.11	12.74	13.08	13.73	15.01
	4H	13.19	13.76	14.17	14.75	16.05	12.79	13.37	13.78	14.36	15.66
	6H	13.68	14.18	14.68	15.19	16.49	13.29	13.78	14.28	14.79	16.09
	8H	13.82	14.28	14.82	15.29	16.60	13.42	13.89	14.42	14.89	16.20
	12H	13.88	14.30	14.90	15.32	16.64	13.48	13.90	14.49	14.92	16.23
8H	4H	13.38	13.84	14.37	14.84	16.16	13.03	13.49	14.02	14.49	15.80
	6H	13.98	14.36	15.00	15.41	16.72	13.63	14.01	14.65	15.06	16.37
	8H	14.18	14.52	15.21	15.55	16.88	13.83	14.17	14.86	15.20	16.53
	12H	14.30	14.60	15.33	15.62	17.00	13.93	14.23	14.96	15.25	16.63
12H	4H	13.36	13.78	14.38	14.80	16.12	13.02	13.44	14.03	14.45	15.77
	6H	14.00	14.34	15.03	15.37	16.70	13.66	14.00	14.69	15.03	16.36
	8H	14.23	14.53	15.26	15.55	16.93	13.88	14.18	14.92	15.21	16.58

END OF REPORT