

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916132

Luminaire Tested: DFN2DIP-HX2F0-050D050US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916132
REPORT IS A COMBINATION OF REPORTS P899188 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-050D050US930-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7072.7 lumens
Efficiency: N/A
Efficacy: 82.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLLFLL

Luminous Intensity Polar Plot

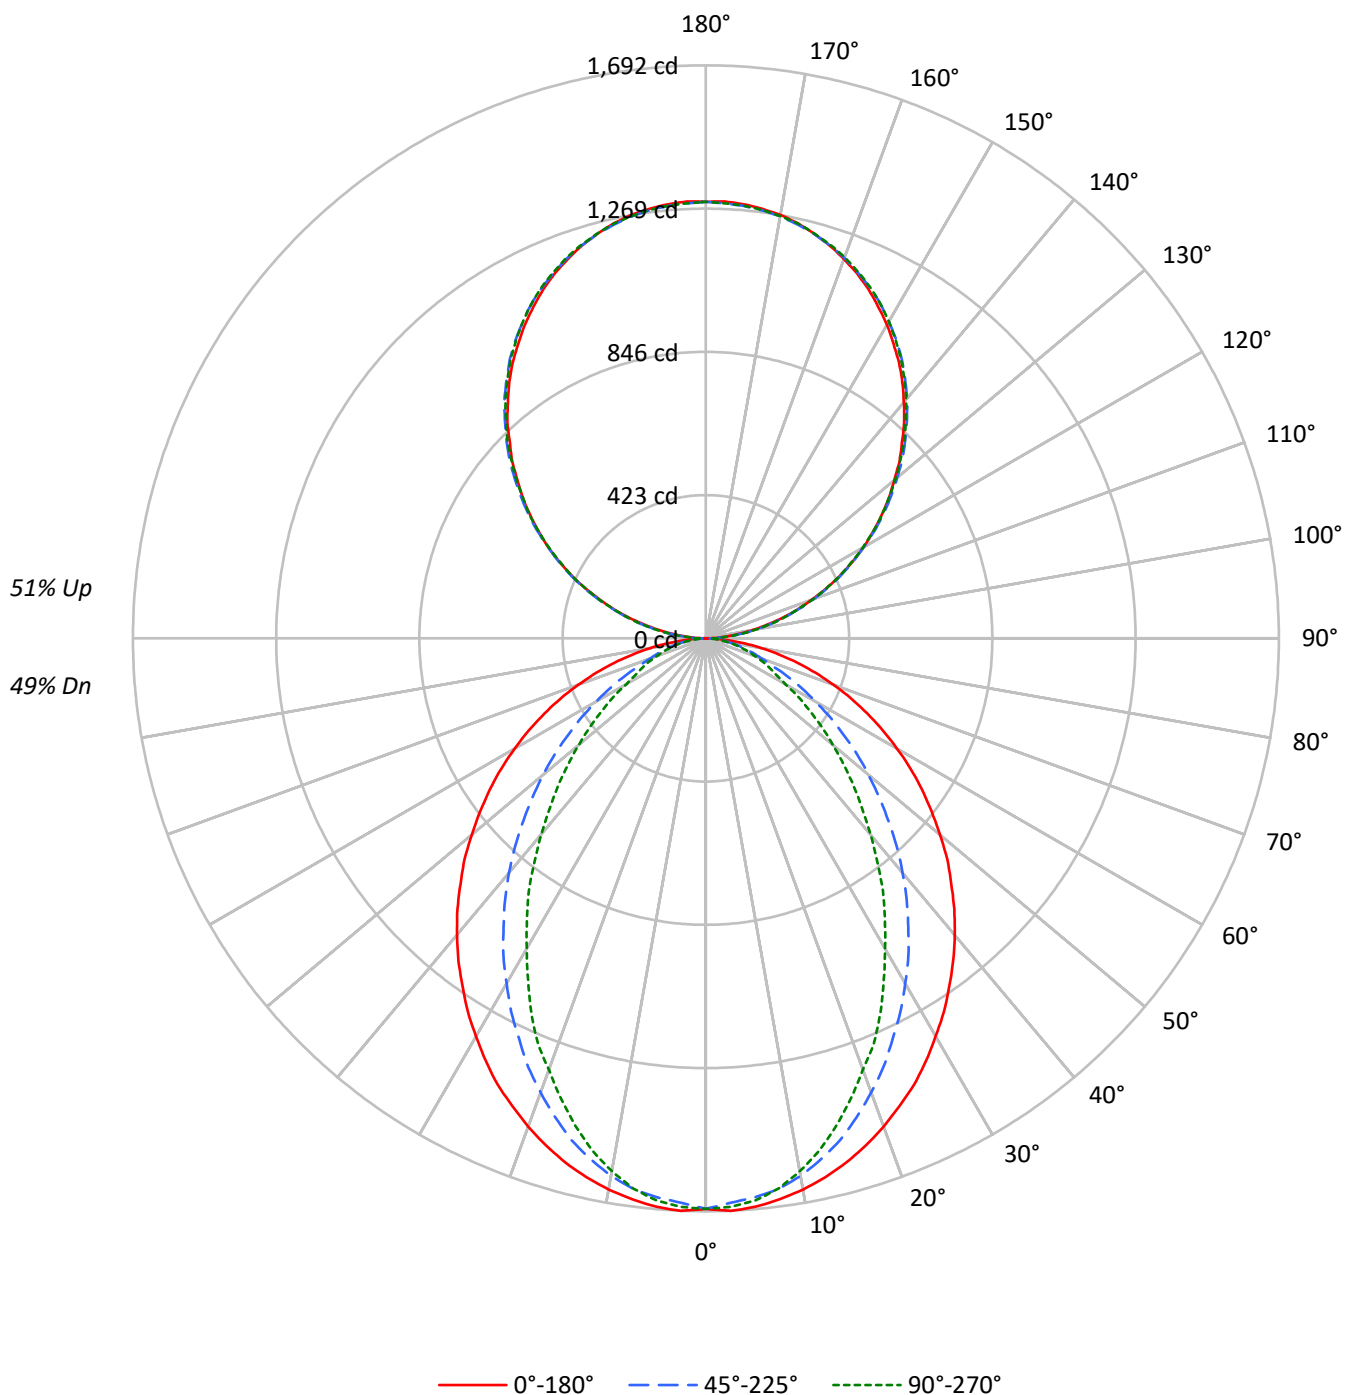

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3970	3970	3970
5°	3970	3897	3924
10°	3924	3811	3789
15°	3864	3676	3585
20°	3786	3494	3337
25°	3706	3291	3098
30°	3602	3084	2798
35°	3499	2863	2533
40°	3393	2634	2232
45°	3272	2382	1959
50°	3146	2129	1693
55°	3013	1859	1438
60°	2860	1579	1176
65°	2682	1295	1051
70°	2467	1030	941
75°	2197	890	842
80°	1808	721	708
85°	1182	444	496

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3272 cd/sqm

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.9	2.2
10°-20°	433.5	6.1
20°-30°	608.6	8.6
30°-40°	663.4	9.4
40°-50°	609.7	8.6
50°-60°	478.8	6.8
60°-70°	311.7	4.4
70°-80°	160.4	2.3
80°-90°	44.6	0.6
90°-100°	79.8	1.1
100°-110°	253.5	3.6
110°-120°	433.8	6.1
120°-130°	570.5	8.1
130°-140°	640.4	9.1
140°-150°	627.9	8.9
150°-160°	526.8	7.4
160°-170°	349.3	4.9
170°-180°	122.1	1.7
0°-30°	1200.0	17.0
0°-40°	1863.4	26.3
0°-60°	2951.9	41.7
0°-90°	3468.7	49.0
90°-120°	767.0	10.8
90°-150°	2605.8	36.8
90°-180°	3604.0	51.0
0°-180°	7072.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1685	1685	1685	1685	1685	
5°	1685	1677	1657	1671	1667	160
15°	1602	1586	1534	1505	1490	452
25°	1455	1406	1305	1243	1220	669
35°	1253	1176	1042	945	912	784
45°	1025	922	762	654	617	791
55°	779	660	496	404	375	696
65°	526	402	265	214	209	521
75°	280	174	122	111	110	297
85°	66	34	29	29	29	75
90°	1	14	38	36	37	7
95°	57	68	70	70	68	63
105°	234	237	240	241	241	247
115°	435	442	440	438	435	431
125°	633	643	640	636	635	566
135°	819	831	833	832	829	633
145°	994	1002	1008	1009	1005	621
155°	1137	1140	1144	1149	1145	523
165°	1237	1236	1236	1243	1238	349
175°	1287	1284	1282	1289	1283	122
180°	1289	1289	1289	1289	1289	

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1684.8	1684.8	1684.8	1684.8	1684.8
2.5°	1692.4	1684.8	1668.0	1683.3	1680.2
5°	1684.8	1677.2	1657.3	1671.0	1666.6
7.5°	1671.0	1662.0	1640.6	1646.7	1639.0
10°	1652.8	1642.1	1611.7	1607.0	1597.9
12.5°	1629.9	1616.2	1575.0	1565.9	1549.1
15°	1602.5	1585.7	1533.9	1505.0	1489.7
17.5°	1570.4	1546.1	1482.0	1448.5	1424.0
20°	1533.9	1503.3	1427.1	1389.1	1355.4
22.5°	1494.3	1459.1	1370.7	1318.9	1296.1
25°	1454.6	1405.7	1305.1	1242.7	1219.7
27.5°	1407.4	1355.4	1244.1	1172.5	1137.4
30°	1357.1	1299.0	1177.0	1099.3	1058.1
32.5°	1308.2	1238.0	1113.1	1021.6	983.4
35°	1253.4	1175.6	1041.5	945.3	911.7
37.5°	1200.0	1116.1	974.4	869.0	831.0
40°	1143.5	1052.1	904.1	795.9	756.3
42.5°	1085.7	988.1	834.1	721.1	683.1
45°	1024.7	922.4	762.4	654.0	617.4
47.5°	966.7	858.5	693.8	585.5	552.0
50°	902.7	794.4	626.7	521.4	489.5
52.5°	840.1	725.7	562.6	462.0	433.1
55°	779.1	660.1	495.5	404.1	375.1
57.5°	716.6	594.7	436.1	350.7	326.3
60°	652.6	530.6	373.5	295.9	271.4
62.5°	590.1	468.1	320.2	247.0	234.9
65°	526.0	402.5	265.3	213.5	208.9
67.5°	465.0	341.5	213.5	187.5	183.0
70°	401.0	282.1	176.8	161.6	155.5
72.5°	340.1	227.1	147.9	135.7	132.6
75°	280.5	173.7	122.0	111.3	109.8
77.5°	221.1	123.4	96.1	89.9	86.8
80°	166.2	88.5	73.1	67.1	67.1
82.5°	115.9	59.5	50.3	47.2	47.2
85°	65.5	33.5	28.9	28.9	28.9
87.5°	24.5	12.1	12.1	10.7	10.7
90°	1.1	14.0	38.1	35.8	36.9
92.5°	24.1	32.6	33.8	35.0	35.0
95°	56.7	67.7	69.5	69.5	67.7
97.5°	94.4	104.5	108.8	108.8	108.8
100°	137.9	146.9	150.0	150.0	148.9
102.5°	183.8	190.5	194.7	195.9	194.7
105°	234.0	237.1	239.5	241.3	241.3
107.5°	283.7	288.4	288.4	289.2	283.7
110°	331.9	338.2	338.2	338.2	335.0

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	384.0	390.6	389.5	386.4	384.0
115°	435.3	441.6	439.6	438.5	435.3
117.5°	486.2	494.8	489.3	486.2	483.1
120°	537.5	546.1	537.5	537.5	534.0
122.5°	584.2	595.1	589.6	586.5	584.2
125°	633.2	642.9	639.8	636.3	635.1
127.5°	680.9	693.0	688.8	684.0	680.9
130°	725.7	739.6	737.7	735.4	731.1
132.5°	775.8	786.7	787.5	782.0	778.9
135°	819.0	831.0	833.3	832.2	829.1
137.5°	867.2	876.9	878.8	878.0	873.3
140°	909.5	919.2	924.6	924.6	920.4
142.5°	953.0	962.8	965.9	967.0	962.8
145°	994.3	1002.0	1008.2	1009.4	1005.1
147.5°	1031.2	1040.9	1045.5	1047.5	1043.2
150°	1069.3	1075.9	1080.1	1083.6	1080.1
152.5°	1103.1	1109.7	1115.1	1119.4	1115.1
155°	1136.9	1140.0	1143.5	1148.9	1145.4
157.5°	1166.0	1168.3	1170.3	1178.1	1172.6
160°	1192.0	1194.4	1195.6	1202.2	1197.5
162.5°	1216.2	1216.2	1217.3	1224.7	1219.3
165°	1236.8	1235.6	1235.6	1243.4	1237.9
167.5°	1255.4	1251.9	1251.9	1259.7	1254.3
170°	1269.4	1266.3	1265.2	1272.9	1266.3
172.5°	1279.1	1276.0	1274.9	1282.6	1276.0
175°	1286.9	1283.8	1281.5	1289.2	1282.6
177.5°	1291.2	1288.1	1285.7	1292.3	1285.7
180°	1289.2	1289.2	1289.2	1289.2	1289.2

TEST NUMBER: P916132

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US930-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.71	12.53	12.68	13.51	14.80	7.69	8.51	8.66	9.49	10.78
	3H	13.36	14.10	14.34	15.09	16.40	8.86	9.60	9.85	10.59	11.90
	4H	13.95	14.65	14.95	15.64	16.96	9.30	10.00	10.30	10.99	12.31
	6H	14.35	14.99	15.36	15.99	17.32	9.61	10.25	10.61	11.24	12.57
	8H	14.47	15.08	15.48	16.09	17.42	9.69	10.30	10.70	11.31	12.64
	12H	14.52	15.10	15.54	16.11	17.46	9.72	10.30	10.74	11.31	12.66
4H	2H	11.72	12.42	12.72	13.41	14.73	8.27	8.97	9.27	9.96	11.28
	3H	13.52	14.10	14.53	15.12	16.45	9.60	10.18	10.61	11.20	12.53
	4H	14.19	14.72	15.21	15.74	17.09	10.13	10.66	11.15	11.68	13.03
	6H	14.68	15.14	15.71	16.18	17.53	10.53	10.99	11.56	12.03	13.38
	8H	14.85	15.27	15.88	16.30	17.67	10.65	11.08	11.68	12.11	13.47
	12H	14.93	15.31	15.98	16.36	17.73	10.71	11.09	11.76	12.14	13.51
8H	4H	14.16	14.58	15.19	15.61	16.98	10.40	10.82	11.43	11.85	13.22
	6H	14.70	15.05	15.75	16.12	17.48	10.89	11.24	11.95	12.32	13.68
	8H	14.90	15.20	15.96	16.26	17.64	11.07	11.38	12.13	12.44	13.82
	12H	15.02	15.29	16.08	16.34	17.77	11.17	11.45	12.24	12.50	13.92
12H	4H	14.11	14.49	15.16	15.54	16.91	10.40	10.78	11.45	11.83	13.20
	6H	14.67	14.98	15.73	16.04	17.42	10.94	11.24	12.00	12.30	13.68
	8H	14.87	15.14	15.94	16.20	17.62	11.13	11.40	12.19	12.45	13.88

END OF REPORT