

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918792

Luminaire Tested: DFN2DIP-HX2F0-020D030US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918792
REPORT IS A COMBINATION OF REPORTS P899162 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-020D030US935-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3749.6 lumens
Efficiency: N/A
Efficacy: 101.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 37
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLLFLL

Luminous Intensity Polar Plot

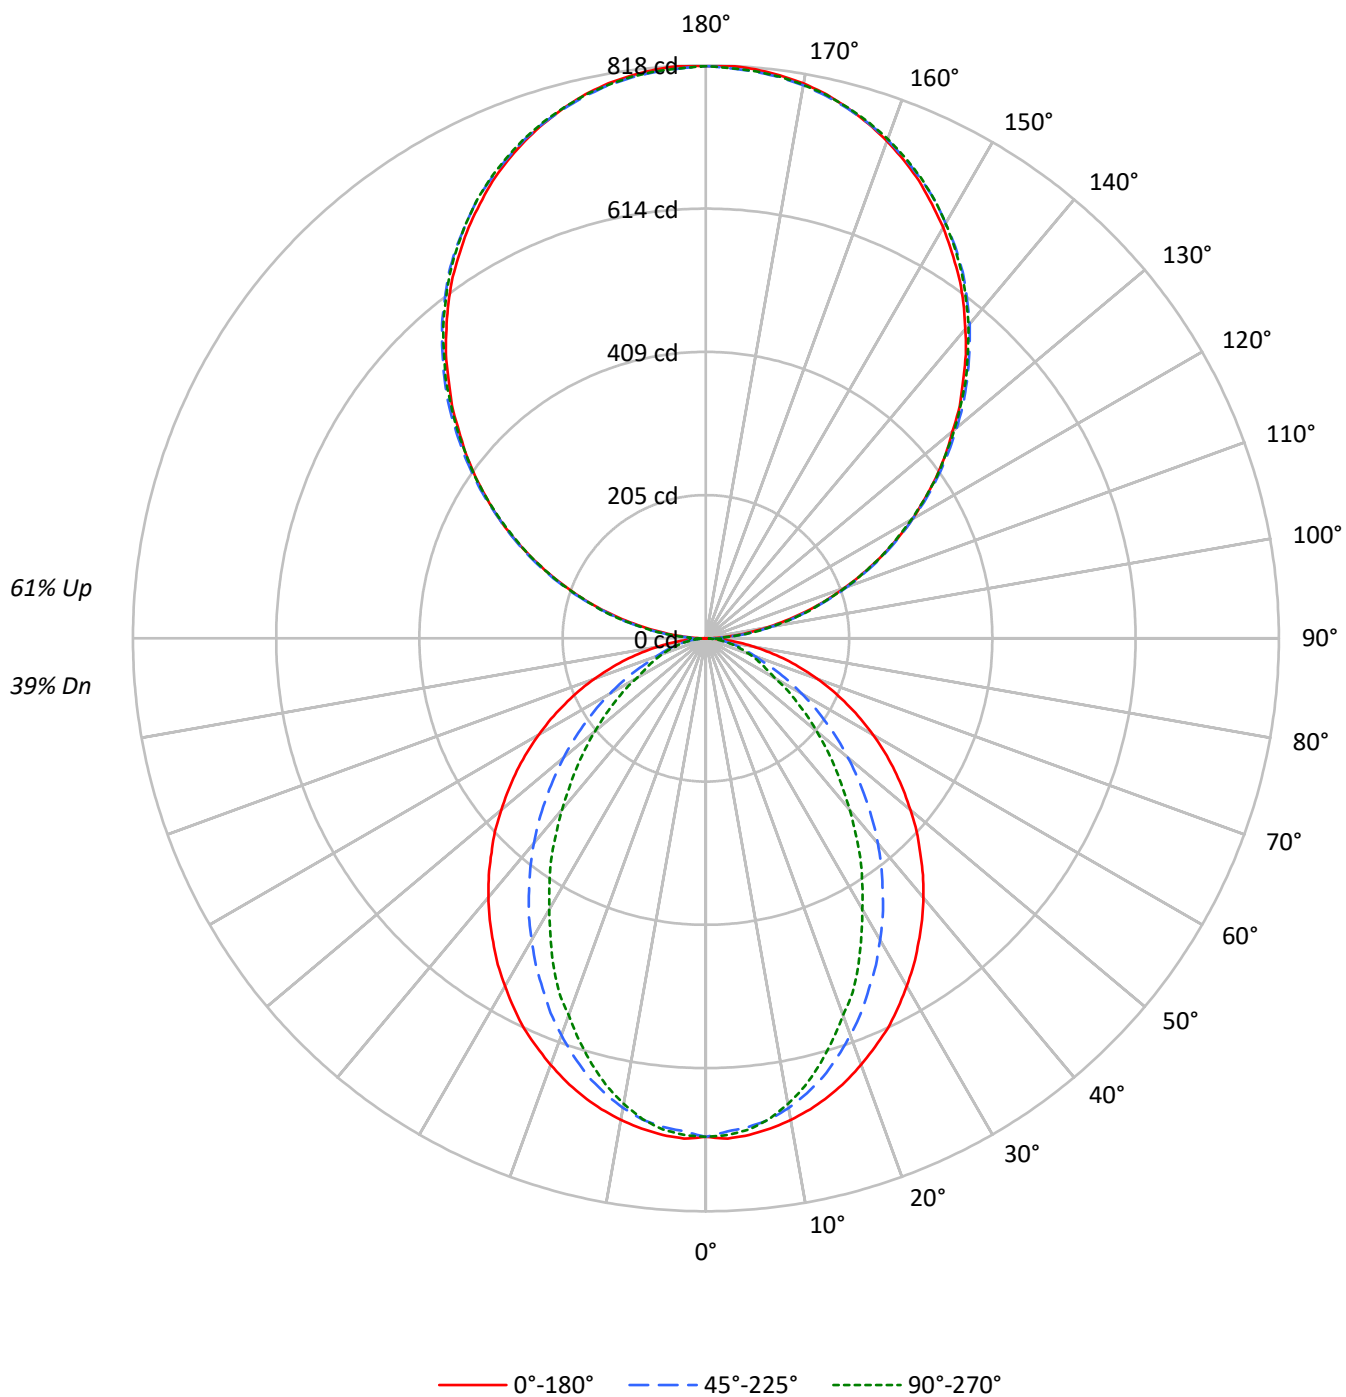

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	51	41	40	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	66	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	24	22
6	62	51	43	37	56	46	40	35	39	33	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	30	35	30	26	29	25	22	22	20	18
8	53	41	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1677	1677	1677
5°	1677	1646	1658
10°	1658	1610	1601
15°	1632	1553	1515
20°	1599	1476	1410
25°	1566	1390	1309
30°	1521	1303	1182
35°	1478	1209	1070
40°	1433	1113	943
45°	1382	1006	827
50°	1329	900	715
55°	1273	785	607
60°	1208	667	497
65°	1133	547	444
70°	1042	435	398
75°	928	376	356
80°	764	305	299
85°	498	188	209

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1382 cd/sqm

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	66.7	1.8
10°-20°	183.1	4.9
20°-30°	257.1	6.9
30°-40°	280.2	7.5
40°-50°	257.6	6.9
50°-60°	202.3	5.4
60°-70°	131.7	3.5
70°-80°	67.8	1.8
80°-90°	19.6	0.5
90°-100°	50.6	1.3
100°-110°	160.6	4.3
110°-120°	274.9	7.3
120°-130°	361.5	9.6
130°-140°	405.7	10.8
140°-150°	397.9	10.6
150°-160°	333.8	8.9
160°-170°	221.3	5.9
170°-180°	77.4	2.1
0°-30°	506.9	13.5
0°-40°	787.1	21.0
0°-60°	1247.0	33.3
0°-90°	1466.0	39.1
90°-120°	486.0	13.0
90°-150°	1651.1	44.0
90°-180°	2284.0	60.9
0°-180°	3749.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	712	712	712	712	712	
5°	712	708	700	706	704	67
15°	677	670	648	636	629	191
25°	614	594	551	525	515	283
35°	529	497	440	399	385	331
45°	433	390	322	276	261	334
55°	329	279	209	171	158	294
65°	222	170	112	90	88	220
75°	118	73	52	47	46	125
85°	28	14	12	12	12	32
90°	1	9	24	23	23	4
95°	36	43	44	44	43	40
105°	148	150	152	153	153	156
115°	276	280	278	278	276	273
125°	401	407	405	403	402	358
135°	519	526	528	527	525	401
145°	630	635	639	640	637	394
155°	720	722	724	728	726	332
165°	784	783	783	788	784	221
175°	816	814	812	817	813	77
180°	817	817	817	817	817	

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	711.7	711.7	711.7	711.7	711.7
2.5°	714.9	711.7	704.6	711.1	709.8
5°	711.7	708.5	700.1	705.9	704.0
7.5°	705.9	702.1	693.0	695.6	692.3
10°	698.2	693.6	680.8	678.8	675.0
12.5°	688.5	682.7	665.3	661.5	654.4
15°	676.9	669.8	647.9	635.7	629.3
17.5°	663.4	653.1	626.0	611.8	601.6
20°	647.9	635.0	602.9	586.8	572.6
22.5°	631.2	616.4	579.0	557.2	547.5
25°	614.5	593.8	551.3	525.0	515.2
27.5°	594.5	572.6	525.6	495.2	480.4
30°	573.3	548.7	497.2	464.4	446.9
32.5°	552.6	523.0	470.2	431.5	415.4
35°	529.4	496.6	440.0	399.3	385.1
37.5°	506.9	471.4	411.6	367.1	351.0
40°	483.0	444.4	381.9	336.2	319.4
42.5°	458.6	417.4	352.3	304.6	288.6
45°	432.8	389.6	322.1	276.3	260.8
47.5°	408.4	362.7	293.1	247.3	233.2
50°	381.3	335.6	264.8	220.2	206.8
52.5°	354.8	306.5	237.6	195.2	183.0
55°	329.1	278.9	209.3	170.7	158.4
57.5°	302.7	251.2	184.3	148.2	137.8
60°	275.7	224.1	157.8	125.0	114.7
62.5°	249.3	197.8	135.3	104.4	99.2
65°	222.2	170.0	112.1	90.2	88.3
67.5°	196.5	144.2	90.2	79.2	77.3
70°	169.4	119.2	74.6	68.3	65.7
72.5°	143.6	95.9	62.4	57.3	56.1
75°	118.5	73.4	51.5	47.0	46.4
77.5°	93.4	52.2	40.6	38.0	36.7
80°	70.2	37.4	30.9	28.3	28.3
82.5°	48.9	25.1	21.3	20.0	20.0
85°	27.6	14.1	12.2	12.2	12.2
87.5°	10.3	5.2	5.2	4.5	4.5
90°	0.8	8.9	24.1	22.6	23.4
92.5°	15.2	20.7	21.4	22.1	22.1
95°	36.0	42.9	44.1	44.1	42.9
97.5°	59.8	66.2	69.0	69.0	69.0
100°	87.4	93.1	95.1	95.1	94.4
102.5°	116.5	120.7	123.4	124.2	123.4
105°	148.3	150.2	151.7	152.9	152.9
107.5°	179.8	182.7	182.7	183.2	179.8
110°	210.3	214.3	214.3	214.3	212.3

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	243.3	247.5	246.8	244.8	243.3
115°	275.9	279.7	278.5	277.8	275.9
117.5°	308.1	313.5	310.0	308.1	306.1
120°	340.6	346.0	340.6	340.6	338.4
122.5°	370.1	377.0	373.6	371.6	370.1
125°	401.2	407.3	405.4	403.1	402.4
127.5°	431.4	439.1	436.4	433.4	431.4
130°	459.8	468.6	467.4	466.0	463.2
132.5°	491.5	498.4	498.9	495.5	493.5
135°	518.9	526.5	528.0	527.3	525.3
137.5°	549.4	555.6	556.8	556.4	553.4
140°	576.3	582.5	585.9	585.9	583.2
142.5°	603.9	610.0	612.0	612.8	610.0
145°	630.0	634.9	638.9	639.5	636.9
147.5°	653.4	659.5	662.5	663.7	661.0
150°	677.5	681.7	684.4	686.6	684.4
152.5°	699.0	703.1	706.5	709.3	706.5
155°	720.4	722.3	724.5	728.0	725.8
157.5°	738.8	740.3	741.6	746.5	743.0
160°	755.4	756.8	757.6	761.7	758.8
162.5°	770.6	770.6	771.4	776.0	772.6
165°	783.7	782.9	782.9	787.8	784.4
167.5°	795.5	793.2	793.2	798.1	794.7
170°	804.3	802.4	801.7	806.6	802.4
172.5°	810.5	808.6	807.8	812.7	808.6
175°	815.5	813.5	812.0	816.9	812.7
177.5°	818.1	816.1	814.7	818.9	814.7
180°	816.9	816.9	816.9	816.9	816.9

TEST NUMBER: P918792

CATALOG NUMBER: DFN2DIP-HX2F0-020D030US935-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.69	8.44	8.74	9.49	10.91	3.68	4.43	4.73	5.48	6.90
	3H	9.34	10.01	10.40	11.07	12.51	4.84	5.51	5.90	6.57	8.01
	4H	9.93	10.56	11.00	11.62	13.07	5.28	5.91	6.35	6.97	8.42
	6H	10.32	10.91	11.41	11.97	13.43	5.58	6.16	6.66	7.23	8.69
	8H	10.44	10.99	11.52	12.07	13.53	5.66	6.21	6.75	7.30	8.75
	12H	10.49	11.01	11.58	12.09	13.56	5.69	6.22	6.78	7.30	8.77
4H	2H	7.70	8.33	8.78	9.39	10.84	4.25	4.88	5.33	5.95	7.39
	3H	9.49	10.02	10.58	11.11	12.57	5.57	6.10	6.66	7.19	8.65
	4H	10.16	10.64	11.25	11.72	13.20	6.10	6.58	7.19	7.66	9.15
	6H	10.65	11.06	11.75	12.16	13.64	6.50	6.91	7.60	8.01	9.49
	8H	10.81	11.19	11.91	12.29	13.78	6.61	7.00	7.71	8.10	9.59
	12H	10.88	11.23	12.00	12.34	13.84	6.67	7.02	7.78	8.12	9.62
8H	4H	10.12	10.50	11.22	11.60	13.09	6.36	6.75	7.46	7.84	9.33
	6H	10.65	10.97	11.77	12.11	13.60	6.85	7.17	7.97	8.31	9.79
	8H	10.85	11.13	11.98	12.25	13.76	7.03	7.31	8.16	8.43	9.93
	12H	10.97	11.22	12.10	12.33	13.88	7.13	7.38	8.26	8.49	10.04
12H	4H	10.06	10.41	11.18	11.52	13.02	6.36	6.71	7.47	7.82	9.31
	6H	10.63	10.91	11.75	12.03	13.53	6.89	7.17	8.02	8.29	9.80
	8H	10.83	11.07	11.96	12.19	13.73	7.09	7.33	8.22	8.45	9.99

END OF REPORT