

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918802

Luminaire Tested: DFN2DIP-HX2F0-020D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918802
REPORT IS A COMBINATION OF REPORTS P899191 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-020D060US935-FLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6276.7 lumens
Efficiency: N/A
Efficacy: 98.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 63.6
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFLL

Luminous Intensity Polar Plot

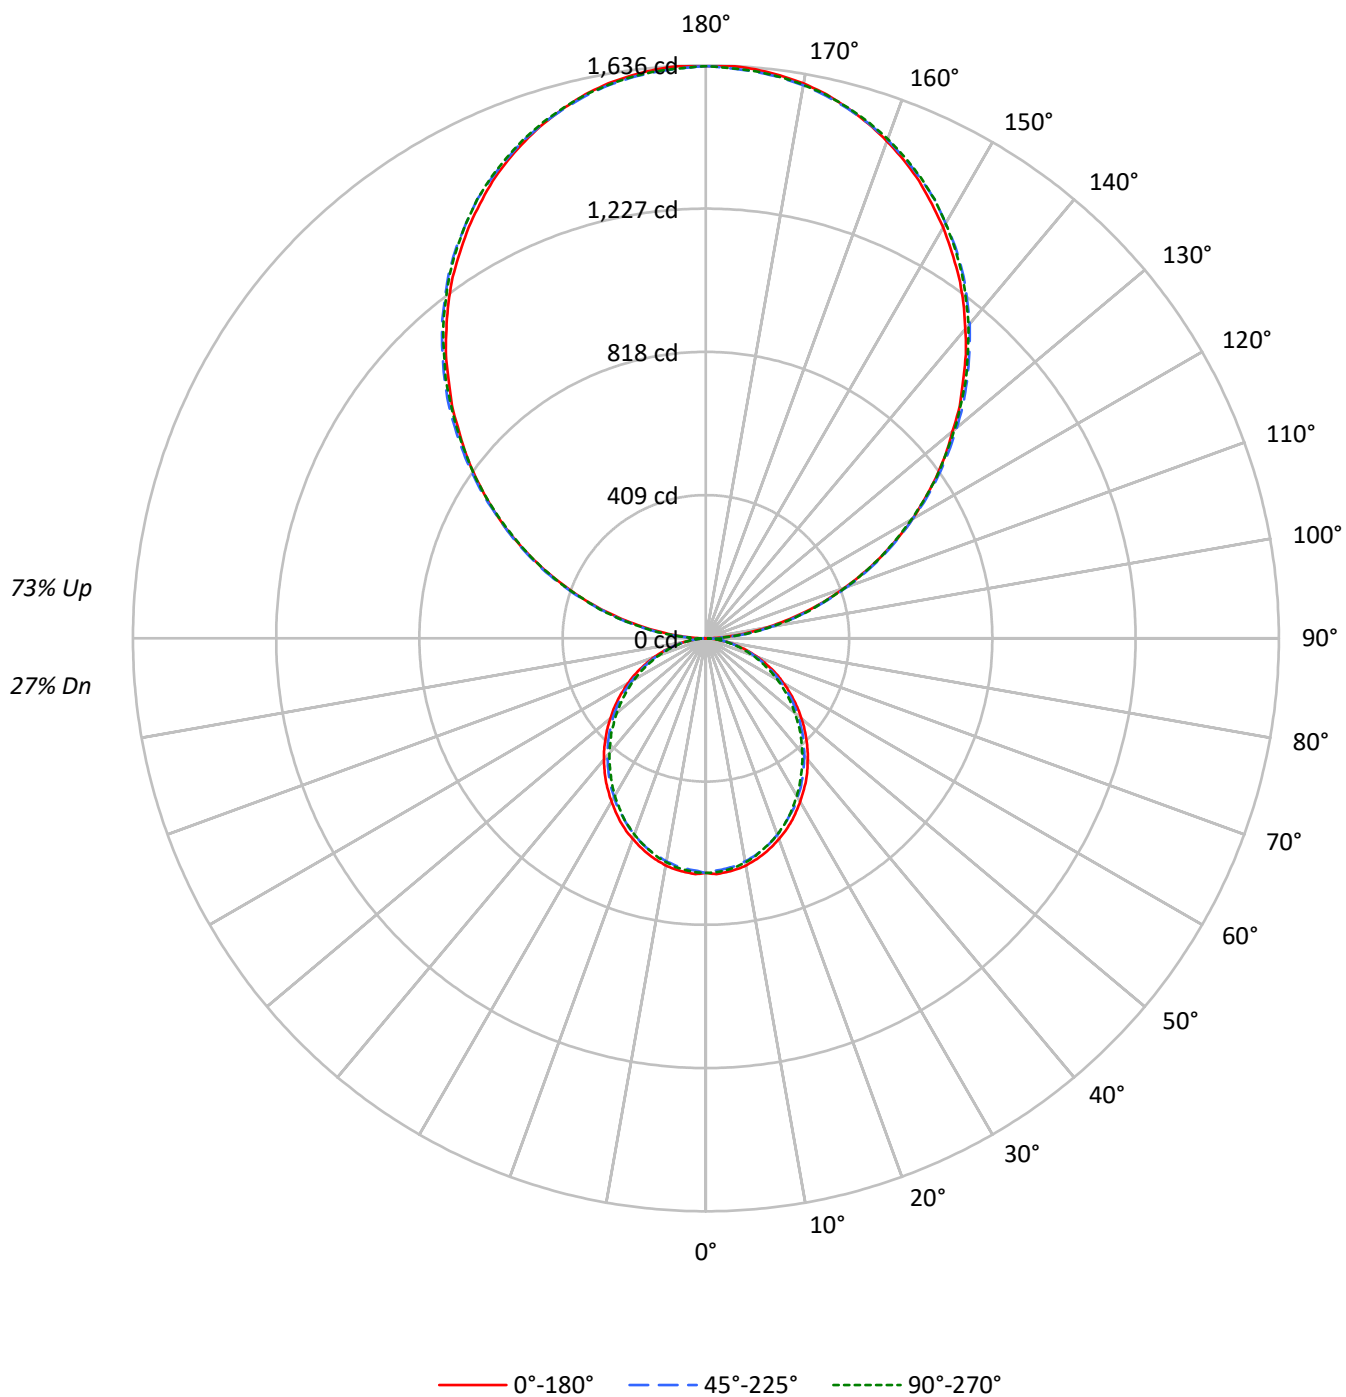

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	52	52	52	35	35	35
1	93	88	85	81	83	79	76	73	62	60	58	46	44	43	31	30	30
2	84	77	71	66	75	69	64	60	54	51	48	40	38	36	27	26	25
3	77	68	61	55	68	61	55	50	48	44	40	35	33	30	24	23	21
4	70	60	52	47	62	54	47	42	42	38	34	32	29	26	22	20	18
5	64	53	45	40	57	48	41	36	38	33	29	28	25	22	19	17	16
6	59	48	40	34	53	43	36	31	34	29	25	25	22	20	18	16	14
7	55	43	35	30	49	39	32	27	31	26	22	23	20	17	16	14	12
8	51	39	31	26	45	35	28	24	28	23	20	21	18	15	15	13	11
9	47	35	28	23	42	32	26	21	25	21	17	19	16	14	14	11	10
10	44	32	25	21	39	29	23	19	23	19	16	18	15	12	13	10	9

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1579	1579	1579
5°	1579	1553	1564
10°	1563	1528	1540
15°	1538	1499	1504
20°	1504	1461	1468
25°	1471	1415	1426
30°	1429	1373	1373
35°	1390	1323	1318
40°	1342	1273	1264
45°	1294	1222	1210
50°	1242	1169	1147
55°	1186	1107	1089
60°	1123	1035	1022
65°	1054	960	944
70°	967	867	858
75°	847	757	776
80°	702	616	625
85°	475	386	388

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2193 cd/sqm

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.1	1.0
10°-20°	177.4	2.8
20°-30°	260.8	4.2
30°-40°	302.9	4.8
40°-50°	302.5	4.8
50°-60°	263.8	4.2
60°-70°	195.0	3.1
70°-80°	110.3	1.8
80°-90°	33.7	0.5
90°-100°	101.1	1.6
100°-110°	321.2	5.1
110°-120°	549.7	8.8
120°-130°	723.0	11.5
130°-140°	811.5	12.9
140°-150°	795.8	12.7
150°-160°	667.5	10.6
160°-170°	442.7	7.1
170°-180°	154.7	2.5
0°-30°	501.3	8.0
0°-40°	804.1	12.8
0°-60°	1370.4	21.8
0°-90°	1709.4	27.2
90°-120°	972.0	15.5
90°-150°	3302.3	52.6
90°-180°	4567.0	72.8
0°-180°	6276.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	670	670	670	670	670	
5°	670	668	660	666	664	64
15°	638	634	626	628	625	180
25°	577	572	561	562	561	266
35°	498	492	481	477	474	311
45°	405	401	391	384	381	313
55°	307	303	295	287	284	274
65°	207	203	197	191	188	205
75°	108	107	104	100	101	116
85°	26	26	25	23	23	29
90°	2	18	48	45	47	6
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	670.0	670.0	670.0	670.0	670.0
2.5°	673.9	670.7	663.6	670.0	668.8
5°	670.0	667.5	660.4	665.6	664.3
7.5°	665.6	661.7	654.6	659.8	658.5
10°	658.5	654.0	646.3	651.3	649.5
12.5°	648.8	645.0	637.2	640.4	639.1
15°	637.8	634.0	625.6	628.2	625.0
17.5°	624.3	620.5	612.1	615.3	612.1
20°	609.5	605.6	596.6	598.6	596.0
22.5°	594.7	588.9	580.5	580.5	579.2
25°	577.3	572.1	561.2	562.4	561.2
27.5°	557.9	553.4	545.1	543.2	539.9
30°	538.6	533.5	523.8	521.9	519.3
32.5°	518.0	514.2	503.9	500.0	497.4
35°	498.1	491.6	481.3	477.4	474.2
37.5°	475.5	469.7	459.3	454.9	451.6
40°	452.3	447.1	436.8	431.1	428.4
42.5°	429.7	424.6	414.3	407.9	404.0
45°	405.3	400.8	391.1	384.0	381.4
47.5°	381.4	376.9	366.6	359.5	355.7
50°	356.3	353.1	344.1	335.0	331.8
52.5°	331.8	327.3	318.9	311.9	307.4
55°	306.7	302.8	295.1	287.4	284.1
57.5°	281.5	278.4	269.9	262.3	259.6
60°	256.4	253.9	244.9	237.7	235.8
62.5°	232.0	227.4	221.0	214.6	212.0
65°	206.8	202.9	196.6	190.7	187.5
67.5°	181.1	177.8	172.0	167.6	165.0
70°	157.2	154.6	148.8	144.3	141.8
72.5°	132.8	130.2	126.9	122.4	120.5
75°	108.2	107.0	103.7	99.9	101.2
77.5°	86.4	83.8	82.4	80.5	78.6
80°	64.5	63.8	62.5	60.5	59.2
82.5°	43.8	43.8	43.2	40.6	40.6
85°	26.3	25.7	25.1	23.2	22.6
87.5°	11.6	10.3	9.0	7.1	6.5
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P918802

CATALOG NUMBER: DFN2DIP-HX2F0-020D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.11	6.80	7.24	7.92	9.49	5.69	6.38	6.82	7.50	9.06
	3H	7.73	8.35	8.87	9.48	11.06	7.27	7.89	8.41	9.02	10.60
	4H	8.30	8.88	9.44	10.01	11.60	7.84	8.42	8.99	9.55	11.14
	6H	8.67	9.21	9.82	10.34	11.94	8.21	8.75	9.36	9.88	11.48
	8H	8.76	9.27	9.92	10.42	12.01	8.30	8.81	9.46	9.96	11.55
	12H	8.79	9.28	9.95	10.42	12.03	8.33	8.82	9.49	9.96	11.57
4H	2H	6.54	7.13	7.70	8.26	9.84	6.20	6.79	7.36	7.92	9.50
	3H	8.36	8.85	9.52	10.01	11.60	7.98	8.47	9.14	9.63	11.22
	4H	9.05	9.50	10.21	10.64	12.26	8.66	9.11	9.82	10.25	11.87
	6H	9.53	9.92	10.70	11.09	12.69	9.14	9.52	10.30	10.69	12.29
	8H	9.67	10.02	10.83	11.18	12.81	9.27	9.63	10.44	10.79	12.41
	12H	9.72	10.04	10.90	11.21	12.84	9.31	9.64	10.50	10.81	12.44
8H	4H	9.22	9.58	10.39	10.74	12.36	8.87	9.23	10.04	10.39	12.01
	6H	9.82	10.11	11.00	11.31	12.93	9.46	9.76	10.65	10.96	12.58
	8H	10.02	10.28	11.21	11.46	13.10	9.66	9.92	10.85	11.10	12.74
	12H	10.12	10.35	11.32	11.53	13.20	9.76	9.98	10.95	11.16	12.83
12H	4H	9.20	9.52	10.38	10.69	12.32	8.85	9.18	10.04	10.35	11.98
	6H	9.84	10.10	11.03	11.28	12.92	9.50	9.76	10.69	10.94	12.58
	8H	10.05	10.28	11.25	11.46	13.13	9.71	9.94	10.90	11.11	12.78

END OF REPORT