

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918844

Luminaire Tested: DFN2DIP-HX2F0-040D060US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918844
REPORT IS A COMBINATION OF REPORTS P899196 AND P896039
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D060US935-RLLFLL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7499.3 lumens
Efficiency: N/A
Efficacy: 88.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 84.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLLFLL

Luminous Intensity Polar Plot

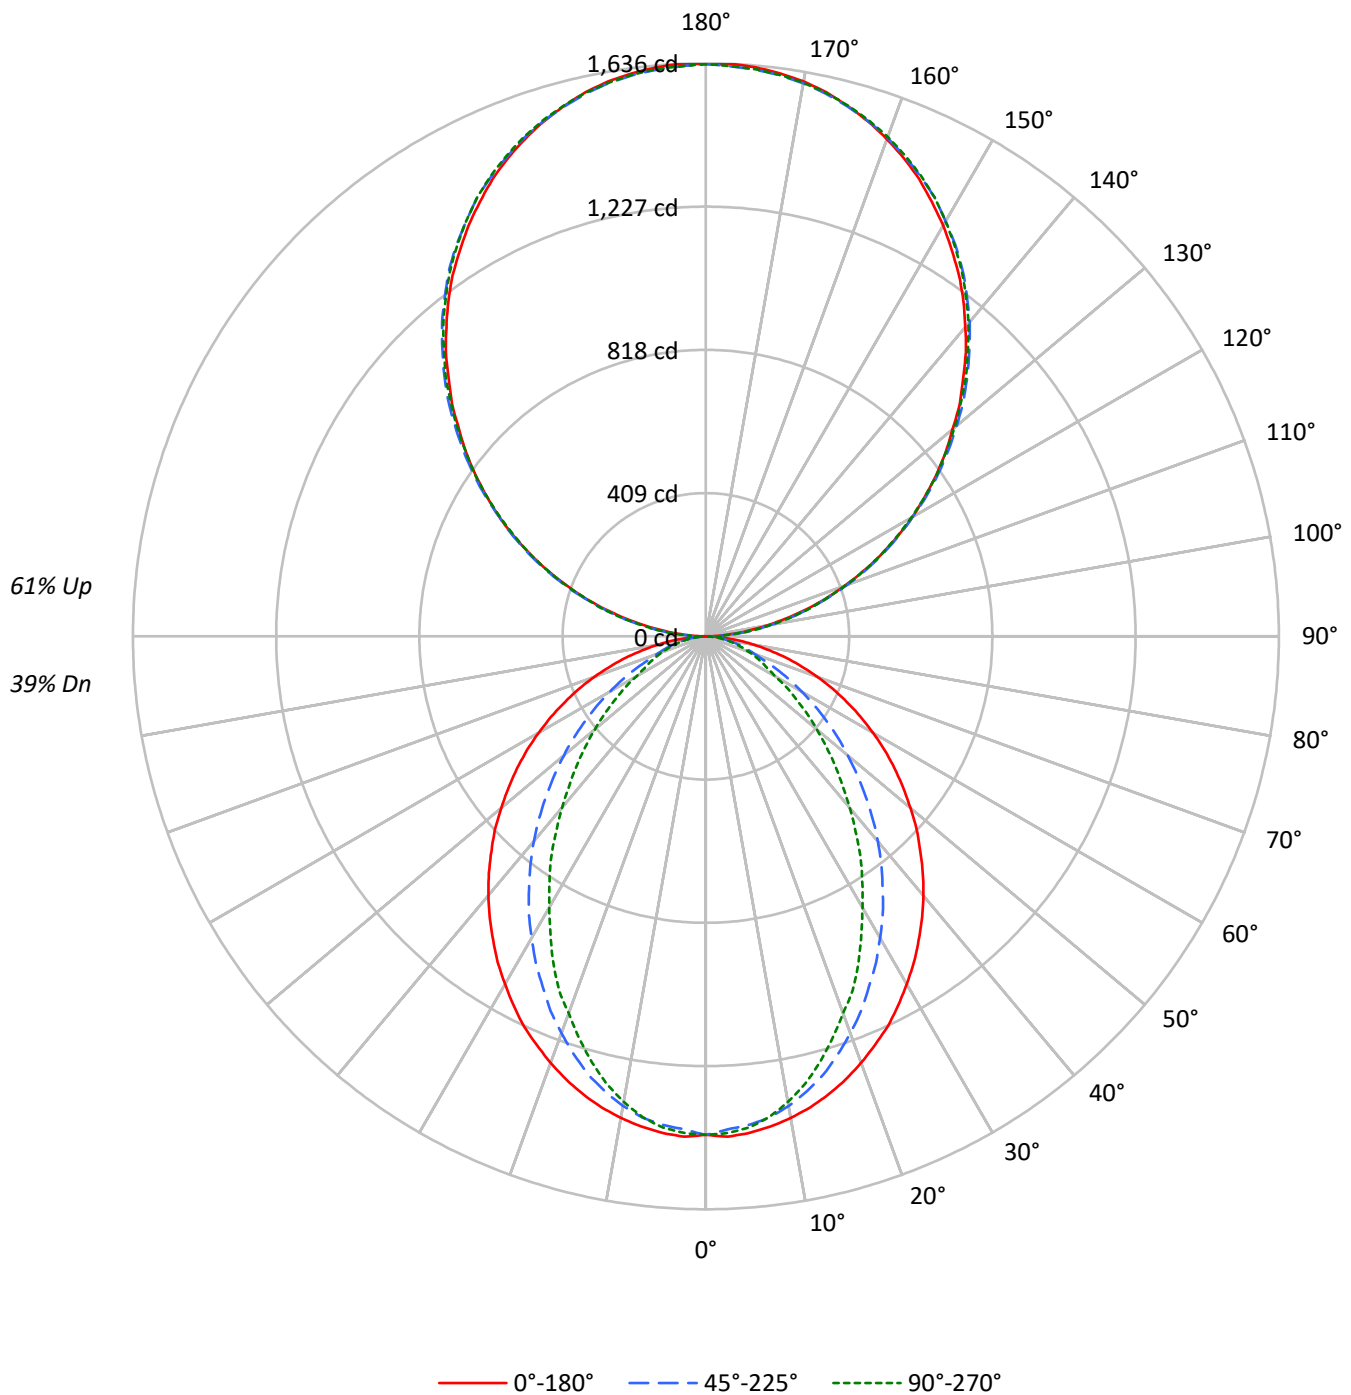

TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	51	41	40	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	66	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	24	22
6	62	51	43	37	56	46	40	35	39	33	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	30	35	30	26	29	25	22	22	20	18
8	53	41	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3354	3354	3354
5°	3354	3293	3316
10°	3315	3220	3201
15°	3264	3106	3029
20°	3199	2952	2820
25°	3131	2780	2617
30°	3043	2606	2364
35°	2956	2419	2140
40°	2867	2226	1886
45°	2764	2013	1655
50°	2657	1798	1430
55°	2545	1571	1215
60°	2416	1334	994
65°	2266	1094	888
70°	2085	871	795
75°	1855	752	711
80°	1527	608	599
85°	1000	377	421

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2764 cd/sqm

TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	133.4	1.8
10°-20°	366.2	4.9
20°-30°	514.2	6.9
30°-40°	560.5	7.5
40°-50°	515.1	6.9
50°-60°	404.5	5.4
60°-70°	263.3	3.5
70°-80°	135.6	1.8
80°-90°	39.2	0.5
90°-100°	101.1	1.3
100°-110°	321.2	4.3
110°-120°	549.7	7.3
120°-130°	723.0	9.6
130°-140°	811.5	10.8
140°-150°	795.8	10.6
150°-160°	667.5	8.9
160°-170°	442.7	5.9
170°-180°	154.7	2.1
0°-30°	1013.8	13.5
0°-40°	1574.2	21.0
0°-60°	2493.9	33.3
0°-90°	2932.0	39.1
90°-120°	972.0	13.0
90°-150°	3302.3	44.0
90°-180°	4567.0	60.9
0°-180°	7499.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1423	1423	1423	1423	1423	
5°	1423	1417	1400	1412	1408	135
15°	1354	1340	1296	1271	1259	382
25°	1229	1188	1103	1050	1030	565
35°	1059	993	880	799	770	663
45°	866	779	644	553	522	668
55°	658	558	419	341	317	588
65°	444	340	224	180	176	441
75°	237	147	103	94	93	251
85°	55	28	24	24	24	64
90°	2	18	48	45	47	7
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1423.4	1423.4	1423.4	1423.4	1423.4
2.5°	1429.9	1423.4	1409.2	1422.2	1419.5
5°	1423.4	1416.9	1400.2	1411.8	1408.0
7.5°	1411.8	1404.1	1386.1	1391.1	1384.7
10°	1396.4	1387.3	1361.6	1357.6	1350.0
12.5°	1377.1	1365.5	1330.6	1322.9	1308.7
15°	1353.8	1339.6	1295.9	1271.4	1258.6
17.5°	1326.8	1306.1	1252.0	1223.7	1203.1
20°	1295.9	1270.1	1205.7	1173.5	1145.1
22.5°	1262.4	1232.8	1158.0	1114.2	1095.0
25°	1228.9	1187.7	1102.6	1049.9	1030.4
27.5°	1189.0	1145.1	1051.1	990.6	960.9
30°	1146.5	1097.4	994.4	928.8	894.0
32.5°	1105.3	1045.9	940.4	863.1	830.8
35°	1058.9	993.2	879.9	798.7	770.2
37.5°	1013.8	942.9	823.1	734.2	702.1
40°	966.1	888.9	763.9	672.4	638.9
42.5°	917.1	834.7	704.6	609.2	577.1
45°	865.6	779.3	644.1	552.6	521.7
47.5°	816.7	725.3	586.2	494.6	466.3
50°	762.6	671.1	529.4	440.5	413.5
52.5°	709.7	613.1	475.4	390.3	365.8
55°	658.2	557.8	418.6	341.4	316.9
57.5°	605.5	502.4	368.4	296.3	275.7
60°	551.3	448.2	315.6	249.9	229.4
62.5°	498.6	395.5	270.4	208.7	198.5
65°	444.4	340.0	224.1	180.4	176.4
67.5°	393.0	288.5	180.4	158.4	154.5
70°	338.8	238.3	149.4	136.6	131.3
72.5°	287.3	191.9	124.9	114.7	112.1
75°	236.9	146.8	103.1	94.0	92.8
77.5°	186.8	104.3	81.2	76.0	73.4
80°	140.3	74.7	61.7	56.7	56.7
82.5°	97.9	50.3	42.5	39.9	39.9
85°	55.4	28.3	24.5	24.5	24.5
87.5°	20.7	10.2	10.2	9.0	9.0
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8



TEST NUMBER: P918844

CATALOG NUMBER: DFN2DIP-HX2F0-040D060US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.10	10.85	11.15	11.90	13.32	6.08	6.83	7.14	7.88	9.31
	3H	11.75	12.42	12.81	13.48	14.92	7.25	7.92	8.31	8.98	10.42
	4H	12.33	12.97	13.41	14.03	15.48	7.68	8.32	8.76	9.38	10.83
	6H	12.73	13.32	13.81	14.38	15.84	7.99	8.57	9.07	9.64	11.09
	8H	12.84	13.40	13.93	14.48	15.93	8.07	8.62	9.15	9.70	11.16
	12H	12.89	13.42	13.98	14.50	15.97	8.10	8.63	9.19	9.70	11.18
4H	2H	10.11	10.74	11.18	11.80	13.25	6.65	7.29	7.73	8.35	9.80
	3H	11.90	12.43	12.98	13.52	14.98	7.98	8.51	9.06	9.60	11.05
	4H	12.57	13.05	13.66	14.13	15.61	8.51	8.99	9.60	10.07	11.55
	6H	13.05	13.47	14.15	14.57	16.05	8.90	9.32	10.00	10.42	11.90
	8H	13.21	13.60	14.31	14.70	16.19	9.02	9.41	10.12	10.50	11.99
	12H	13.29	13.64	14.41	14.75	16.25	9.07	9.42	10.19	10.53	12.03
8H	4H	12.53	12.91	13.62	14.01	15.50	8.77	9.15	9.87	10.25	11.74
	6H	13.06	13.38	14.18	14.52	16.00	9.26	9.58	10.38	10.72	12.20
	8H	13.26	13.54	14.39	14.66	16.17	9.44	9.72	10.56	10.83	12.34
	12H	13.38	13.62	14.51	14.74	16.28	9.54	9.78	10.67	10.90	12.44
12H	4H	12.47	12.82	13.59	13.93	15.43	8.76	9.11	9.88	10.22	11.72
	6H	13.03	13.31	14.16	14.43	15.94	9.30	9.58	10.43	10.70	12.21
	8H	13.23	13.48	14.36	14.59	16.14	9.49	9.74	10.62	10.85	12.40

END OF REPORT