

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918871

Luminaire Tested: DFN2DIP-HX2F0-060D030US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918871
REPORT IS A COMBINATION OF REPORTS P900689 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D030US935-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7671.5 lumens
Efficiency: N/A
Efficacy: 94.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 81.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

Luminous Intensity Polar Plot

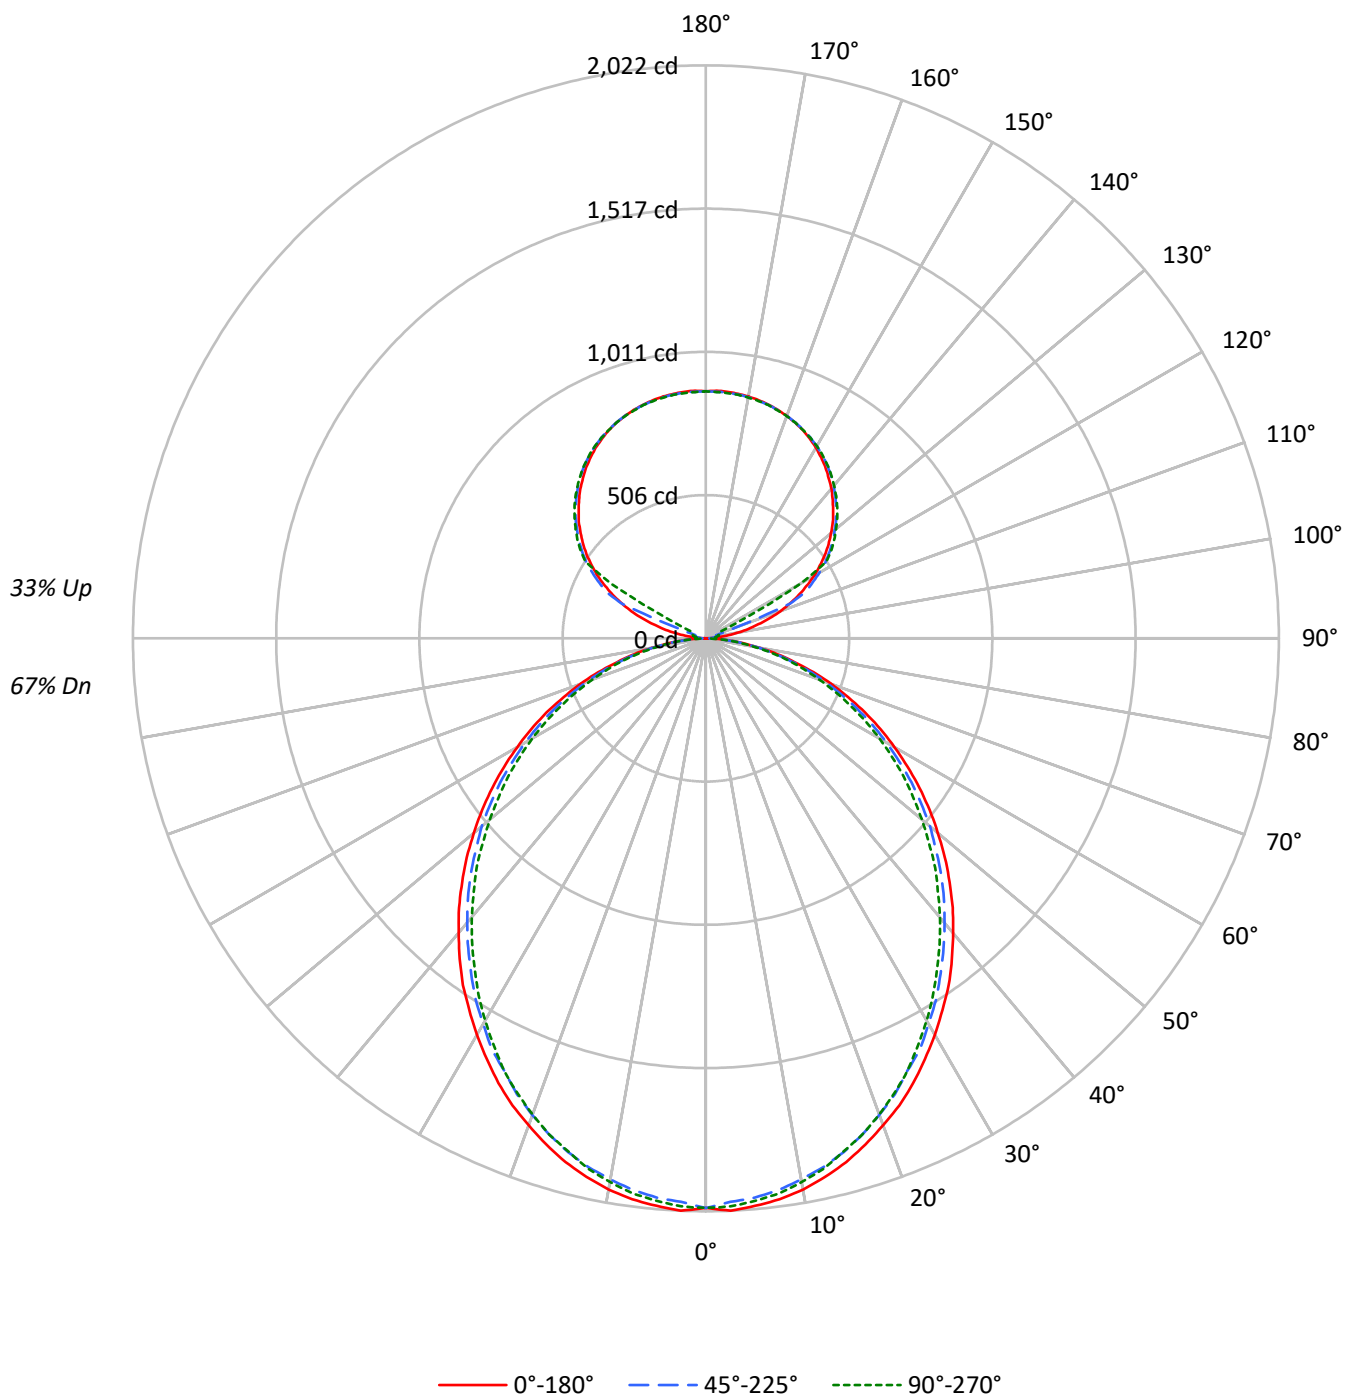

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	105	105	105	105	93	93	93	82	82	82	71	71	71
1	102	97	93	90	95	92	88	85	81	79	76	72	70	68	63	62	60
2	92	85	79	73	87	80	75	70	71	67	63	63	60	57	56	53	51
3	84	75	67	61	79	71	64	58	63	58	53	56	52	48	49	46	43
4	77	66	58	52	72	63	55	50	56	50	45	50	45	41	44	40	37
5	71	59	51	44	67	56	48	43	50	44	39	45	40	36	40	36	33
6	66	53	45	39	62	50	43	37	45	39	34	41	35	32	36	32	29
7	61	48	40	34	57	46	38	33	41	35	30	37	32	28	33	29	26
8	56	44	36	30	53	42	34	29	38	31	27	34	29	25	30	26	23
9	53	40	32	27	50	38	31	26	35	29	24	31	26	23	28	24	21
10	49	37	29	24	46	35	28	24	32	26	22	29	24	20	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4736	4736	4736
5°	4736	4659	4693
10°	4690	4585	4621
15°	4614	4498	4513
20°	4513	4382	4403
25°	4413	4246	4277
30°	4289	4118	4119
35°	4171	3969	3952
40°	4026	3818	3794
45°	3882	3666	3630
50°	3724	3506	3442
55°	3558	3322	3267
60°	3370	3105	3067
65°	3164	2878	2831
70°	2902	2601	2574
75°	2542	2270	2326
80°	2104	1848	1877
85°	1428	1159	1162

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3882 cd/sqm

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.5
10°-20°	532.3	6.9
20°-30°	782.3	10.2
30°-40°	908.6	11.8
40°-50°	907.5	11.8
50°-60°	791.3	10.3
60°-70°	584.9	7.6
70°-80°	330.9	4.3
80°-90°	88.9	1.2
90°-100°	28.7	0.4
100°-110°	107.2	1.4
110°-120°	284.2	3.7
120°-130°	471.3	6.1
130°-140°	500.7	6.5
140°-150°	465.3	6.1
150°-160°	374.1	4.9
160°-170°	241.1	3.1
170°-180°	83.0	1.1
0°-30°	1503.8	19.6
0°-40°	2412.4	31.4
0°-60°	4111.1	53.6
0°-90°	5115.9	66.7
90°-120°	420.1	5.5
90°-150°	1857.5	24.2
90°-180°	2556.0	33.3
0°-180°	7671.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	8	13	16	17	7
95°	41	20	24	28	27	49
105°	192	211	38	45	48	205
115°	363	373	389	97	52	357
125°	513	521	533	537	539	457
135°	635	645	650	657	655	490
145°	736	736	746	751	747	460
155°	810	805	812	816	811	373
165°	854	850	852	857	852	241
175°	874	869	870	875	869	83
180°	872	872	872	872	872	

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	0.6	7.6	12.6	15.8	17.0
92.5°	15.8	13.3	15.2	16.4	17.0
95°	41.0	20.1	24.5	27.8	27.1
97.5°	73.8	22.1	32.1	34.1	34.7
100°	111.7	25.2	36.0	41.0	42.3
102.5°	153.3	152.1	37.2	44.1	46.1
105°	191.7	210.7	38.5	45.4	48.0
107.5°	236.5	252.3	39.8	46.7	49.2
110°	279.5	292.7	110.4	47.4	49.9

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	319.9	331.1	320.5	48.6	50.5
115°	362.7	373.4	389.2	97.1	51.7
117.5°	399.9	412.5	423.3	333.0	167.8
120°	441.5	451.0	462.4	469.9	384.8
122.5°	476.8	487.0	499.6	503.3	504.0
125°	512.8	521.0	533.0	537.4	539.3
127.5°	545.6	554.4	564.0	570.2	570.8
130°	576.5	586.7	593.6	600.5	599.9
132.5°	608.0	616.3	623.2	628.9	628.3
135°	634.6	644.7	650.3	656.7	655.4
137.5°	662.3	669.9	676.2	682.5	680.6
140°	689.4	694.5	701.4	707.1	704.0
142.5°	712.2	716.6	724.8	729.8	726.7
145°	736.2	735.5	746.2	750.6	747.4
147.5°	756.9	755.0	765.8	768.9	766.4
150°	777.1	772.7	782.8	786.5	783.4
152.5°	794.1	789.1	798.6	802.4	798.0
155°	810.5	804.9	812.4	816.2	811.2
157.5°	823.8	818.8	824.5	828.9	823.8
160°	835.2	831.4	835.2	839.0	834.5
162.5°	845.2	841.5	844.6	849.0	843.3
165°	854.0	850.3	852.2	856.6	852.2
167.5°	861.0	857.2	859.1	863.6	857.9
170°	866.7	862.9	864.2	868.6	862.9
172.5°	870.5	866.7	868.0	872.4	866.7
175°	873.6	869.2	870.5	874.9	868.6
177.5°	874.9	870.5	871.2	875.5	869.9
180°	871.8	871.8	871.8	871.8	871.8

TEST NUMBER: P918871

CATALOG NUMBER: DFN2DIP-HX2F0-060D030US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.95	14.99	14.75	15.81	16.82	13.53	14.56	14.33	15.39	16.40
	3H	15.60	16.53	16.41	17.36	18.40	15.14	16.07	15.95	16.90	17.94
	4H	16.18	17.06	17.01	17.90	18.95	15.72	16.60	16.55	17.44	18.49
	6H	16.57	17.38	17.41	18.22	19.29	16.11	16.92	16.95	17.76	18.83
	8H	16.67	17.44	17.52	18.30	19.37	16.21	16.98	17.06	17.85	18.91
	12H	16.71	17.45	17.57	18.31	19.40	16.25	16.99	17.11	17.84	18.94
4H	2H	14.42	15.30	15.26	16.14	17.19	14.09	14.96	14.92	15.80	16.85
	3H	16.28	17.01	17.12	17.88	18.95	15.89	16.63	16.74	17.50	18.56
	4H	16.98	17.64	17.84	18.52	19.61	16.58	17.25	17.44	18.12	19.21
	6H	17.48	18.06	18.35	18.95	20.05	17.08	17.66	17.96	18.55	19.65
	8H	17.62	18.16	18.50	19.05	20.16	17.22	17.76	18.10	18.65	19.76
	12H	17.69	18.18	18.59	19.08	20.20	17.29	17.77	18.18	18.68	19.80
8H	4H	17.18	17.72	18.05	18.61	19.72	16.83	17.37	17.70	18.25	19.36
	6H	17.79	18.23	18.69	19.16	20.27	17.43	17.88	18.34	18.81	19.92
	8H	17.99	18.39	18.91	19.31	20.44	17.64	18.03	18.55	18.96	20.08
	12H	18.12	18.46	19.03	19.38	20.56	17.75	18.10	18.66	19.01	20.19
12H	4H	17.17	17.65	18.07	18.56	19.68	16.82	17.31	17.72	18.22	19.33
	6H	17.81	18.21	18.73	19.13	20.26	17.47	17.87	18.39	18.79	19.92
	8H	18.04	18.39	18.96	19.31	20.49	17.70	18.05	18.62	18.96	20.14