

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918883

Luminaire Tested: DFN2DIP-HX2F0-060D060US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918883
REPORT IS A COMBINATION OF REPORTS P900719 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D060US935-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10228.6 lumens
Efficiency: N/A
Efficacy: 94.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 107.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

Luminous Intensity Polar Plot

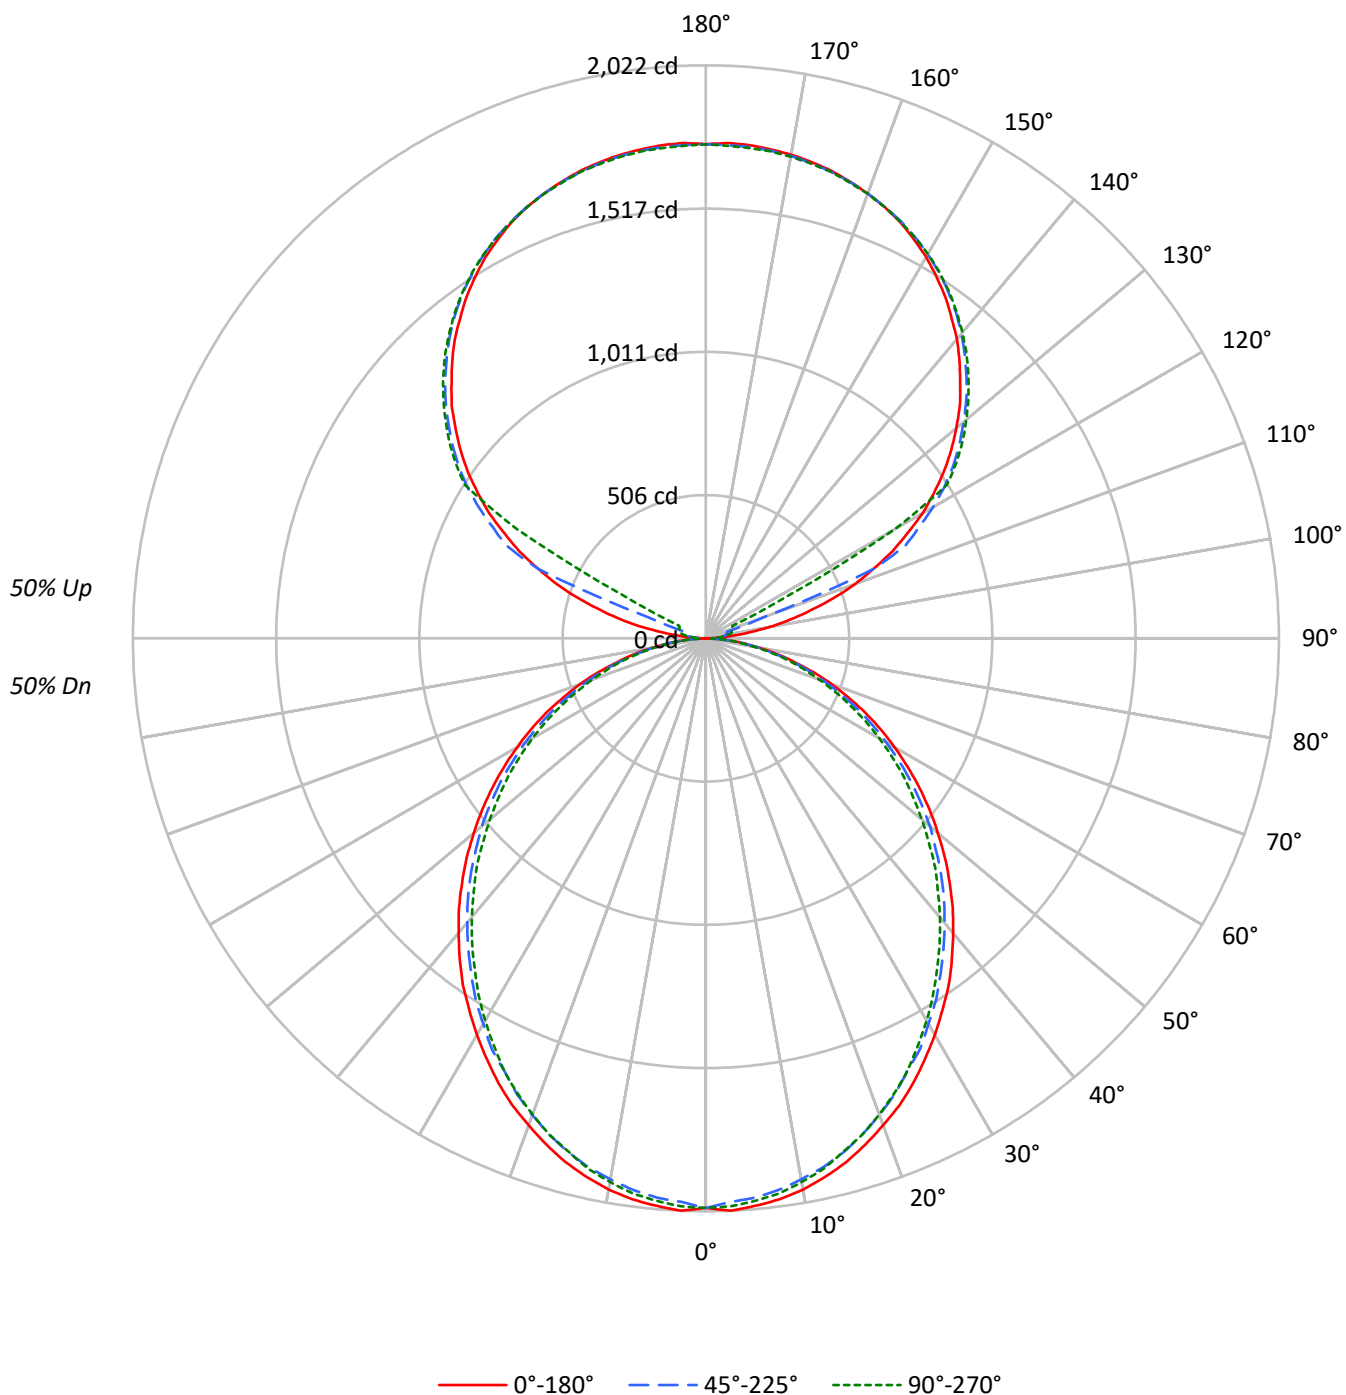

TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4736	4736	4736
5°	4736	4659	4693
10°	4690	4585	4621
15°	4614	4498	4513
20°	4513	4382	4403
25°	4413	4246	4277
30°	4289	4118	4119
35°	4171	3969	3952
40°	4026	3818	3794
45°	3882	3666	3630
50°	3724	3506	3442
55°	3558	3322	3267
60°	3370	3105	3067
65°	3164	2878	2831
70°	2902	2601	2574
75°	2542	2270	2326
80°	2104	1848	1877
85°	1428	1159	1162

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3882 cd/sqm

TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.8
10°-20°	532.3	5.2
20°-30°	782.3	7.6
30°-40°	908.6	8.9
40°-50°	907.5	8.9
50°-60°	791.3	7.7
60°-70°	584.9	5.7
70°-80°	330.9	3.2
80°-90°	90.4	0.9
90°-100°	57.5	0.6
100°-110°	214.3	2.1
110°-120°	568.4	5.6
120°-130°	942.7	9.2
130°-140°	1001.4	9.8
140°-150°	930.7	9.1
150°-160°	748.2	7.3
160°-170°	482.1	4.7
170°-180°	165.9	1.6
0°-30°	1503.8	14.7
0°-40°	2412.4	23.6
0°-60°	4111.1	40.2
0°-90°	5117.4	50.0
90°-120°	840.2	8.2
90°-150°	3714.9	36.3
90°-180°	5111.0	50.0
0°-180°	10228.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	15	25	32	34	9
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6



TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P918883

CATALOG NUMBER: DFN2DIP-HX2F0-060D060US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.54	13.40	13.50	14.38	15.65	12.12	12.98	13.08	13.95	15.22
	3H	14.18	14.95	15.14	15.93	17.22	13.72	14.49	14.68	15.47	16.76
	4H	14.75	15.48	15.73	16.46	17.77	14.29	15.02	15.27	16.01	17.31
	6H	15.13	15.80	16.12	16.79	18.11	14.67	15.34	15.66	16.33	17.65
	8H	15.22	15.86	16.22	16.87	18.18	14.77	15.41	15.76	16.41	17.73
	12H	15.26	15.87	16.27	16.87	18.21	14.80	15.41	15.80	16.41	17.75
4H	2H	12.99	13.72	13.98	14.71	16.01	12.65	13.39	13.64	14.37	15.67
	3H	14.83	15.44	15.83	16.46	17.77	14.45	15.06	15.44	16.07	17.39
	4H	15.52	16.08	16.53	17.09	18.43	15.13	15.69	16.14	16.70	18.04
	6H	16.02	16.50	17.03	17.53	18.86	15.62	16.10	16.64	17.13	18.47
	8H	16.15	16.60	17.17	17.63	18.98	15.76	16.21	16.77	17.23	18.58
	12H	16.22	16.62	17.25	17.66	19.02	15.81	16.22	16.85	17.26	18.61
8H	4H	15.71	16.16	16.73	17.18	18.53	15.36	15.81	16.38	16.83	18.18
	6H	16.31	16.68	17.35	17.75	19.10	15.96	16.33	17.00	17.40	18.75
	8H	16.52	16.84	17.57	17.89	19.26	16.16	16.49	17.21	17.54	18.91
	12H	16.63	16.92	17.69	17.97	19.38	16.26	16.55	17.32	17.60	19.01
12H	4H	15.69	16.10	16.73	17.14	18.49	15.35	15.76	16.39	16.79	18.15
	6H	16.34	16.66	17.39	17.72	19.08	16.00	16.32	17.05	17.37	18.74
	8H	16.56	16.85	17.61	17.89	19.30	16.22	16.50	17.27	17.55	18.96