

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921589

Luminaire Tested: DFN2DIP-HX2F0-050D050US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921589
REPORT IS A COMBINATION OF REPORTS P900708 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-050D050US940-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8203.8 lumens
Efficiency: N/A
Efficacy: 95.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLLONL

Luminous Intensity Polar Plot

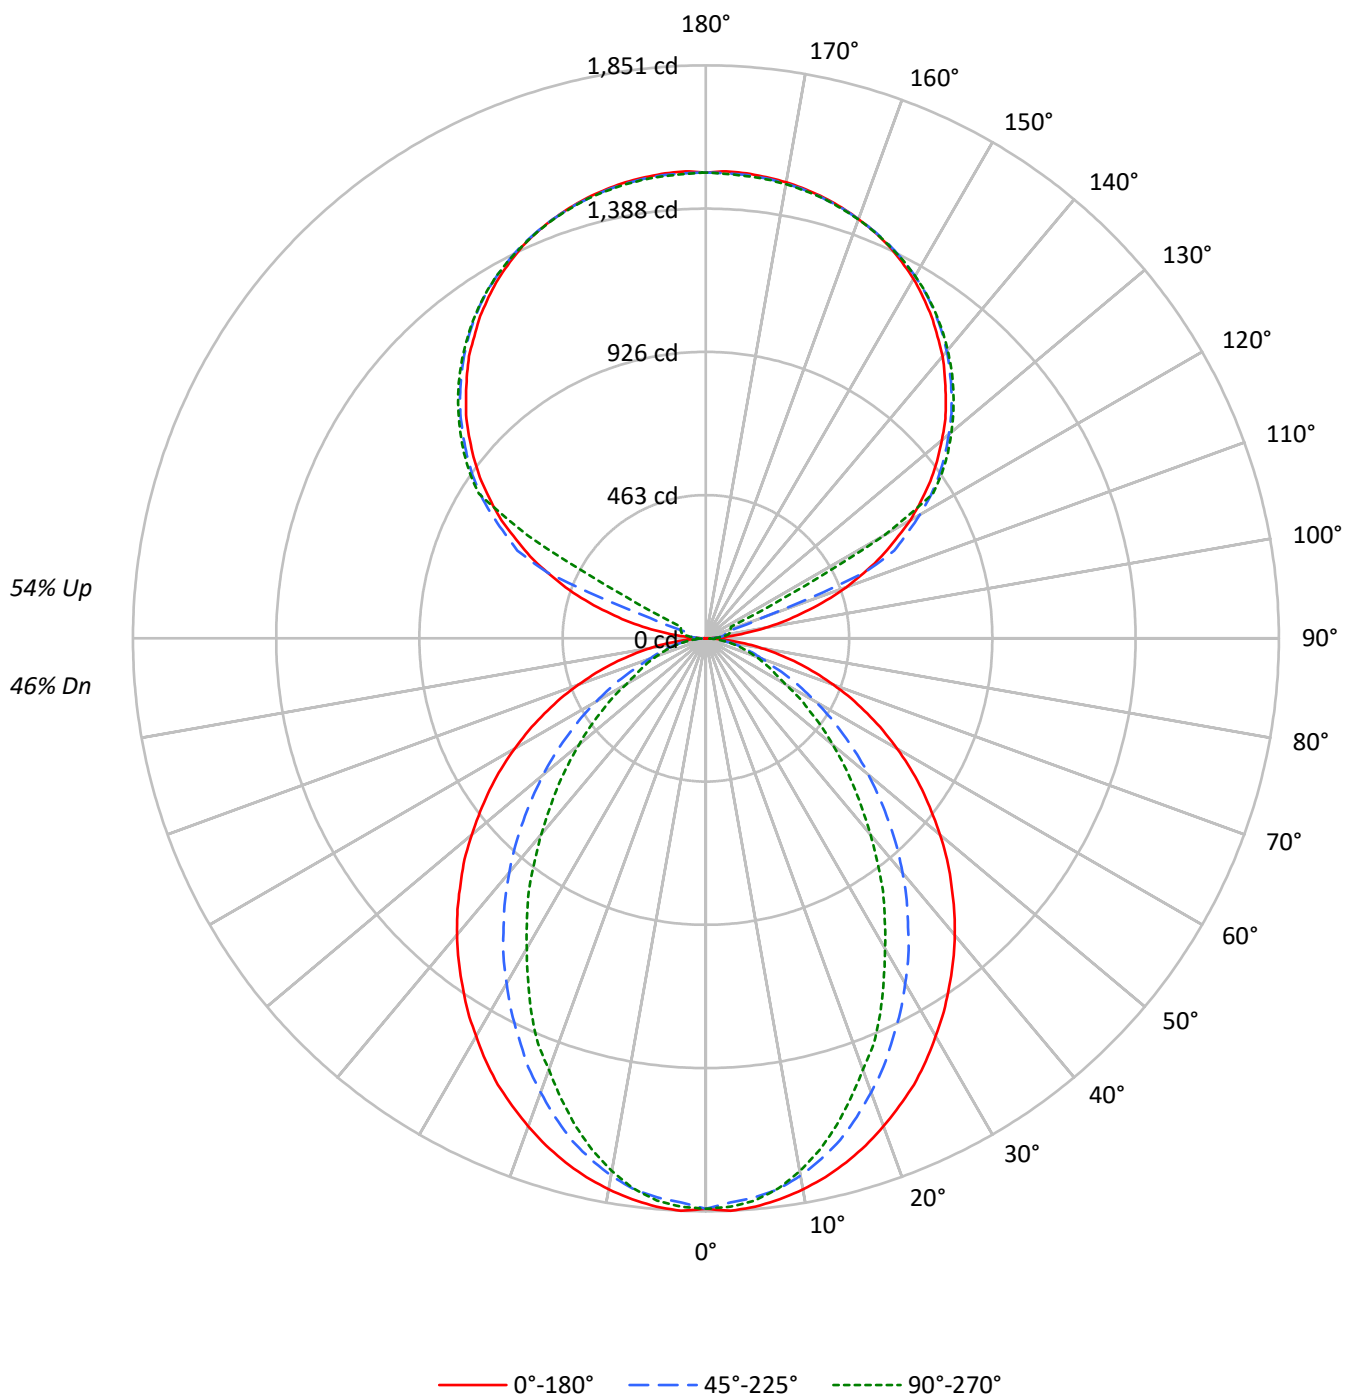

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4342	4342	4342
5°	4342	4263	4292
10°	4292	4168	4145
15°	4226	4021	3921
20°	4141	3821	3650
25°	4054	3599	3389
30°	3939	3373	3060
35°	3826	3131	2771
40°	3711	2881	2441
45°	3578	2605	2142
50°	3440	2329	1852
55°	3295	2033	1573
60°	3127	1727	1287
65°	2933	1416	1150
70°	2699	1127	1029
75°	2403	973	921
80°	1977	789	775
85°	1294	487	544

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3578 cd/sqm

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	2.1
10°-20°	474.1	5.8
20°-30°	665.6	8.1
30°-40°	725.6	8.8
40°-50°	666.9	8.1
50°-60°	523.7	6.4
60°-70°	340.9	4.2
70°-80°	175.5	2.1
80°-90°	47.5	0.6
90°-100°	49.6	0.6
100°-110°	185.0	2.3
110°-120°	490.6	6.0
120°-130°	813.6	9.9
130°-140°	864.3	10.5
140°-150°	803.2	9.8
150°-160°	645.8	7.9
160°-170°	416.1	5.1
170°-180°	143.2	1.7
0°-30°	1312.4	16.0
0°-40°	2038.0	24.8
0°-60°	3228.6	39.4
0°-90°	3792.4	46.2
90°-120°	725.2	8.8
90°-150°	3206.2	39.1
90°-180°	4411.0	53.8
0°-180°	8203.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	1	13	22	27	29	8
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P921589

CATALOG NUMBER: DFN2DIP-HX2F0-050D050US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.75	12.55	12.74	13.55	14.88	7.73	8.53	8.73	9.53	10.86
	3H	13.40	14.11	14.40	15.13	16.47	8.90	9.62	9.91	10.63	11.98
	4H	13.99	14.67	15.01	15.68	17.04	9.34	10.01	10.36	11.03	12.38
	6H	14.39	15.01	15.42	16.03	17.40	9.64	10.27	10.67	11.28	12.65
	8H	14.50	15.09	15.54	16.13	17.49	9.72	10.32	10.76	11.35	12.72
	12H	14.55	15.12	15.59	16.14	17.53	9.76	10.32	10.80	11.35	12.74
4H	2H	11.76	12.44	12.78	13.45	14.81	8.31	8.99	9.33	10.00	11.36
	3H	13.56	14.12	14.59	15.16	16.53	9.64	10.20	10.67	11.24	12.61
	4H	14.23	14.74	15.27	15.78	17.17	10.17	10.68	11.21	11.72	13.11
	6H	14.72	15.16	15.77	16.22	17.61	10.57	11.01	11.62	12.07	13.46
	8H	14.88	15.29	15.93	16.34	17.74	10.69	11.10	11.74	12.15	13.55
	12H	14.96	15.33	16.03	16.40	17.80	10.74	11.11	11.81	12.18	13.59
8H	4H	14.19	14.60	15.24	15.65	17.06	10.43	10.84	11.48	11.89	13.30
	6H	14.73	15.07	15.80	16.16	17.56	10.93	11.27	12.00	12.36	13.76
	8H	14.93	15.23	16.01	16.30	17.72	11.10	11.40	12.18	12.48	13.90
	12H	15.05	15.31	16.13	16.38	17.84	11.21	11.47	12.29	12.54	14.00
12H	4H	14.14	14.51	15.21	15.58	16.98	10.43	10.80	11.50	11.87	13.28
	6H	14.70	15.00	15.78	16.08	17.50	10.97	11.27	12.05	12.34	13.76
	8H	14.90	15.17	15.99	16.24	17.70	11.16	11.42	12.25	12.50	13.96

END OF REPORT