

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921609

Luminaire Tested: DFN2DIP-HX2F0-060D050US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921609
REPORT IS A COMBINATION OF REPORTS P900710 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D050US940-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8961.7 lumens
Efficiency: N/A
Efficacy: 91.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 97.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLLONL

Luminous Intensity Polar Plot

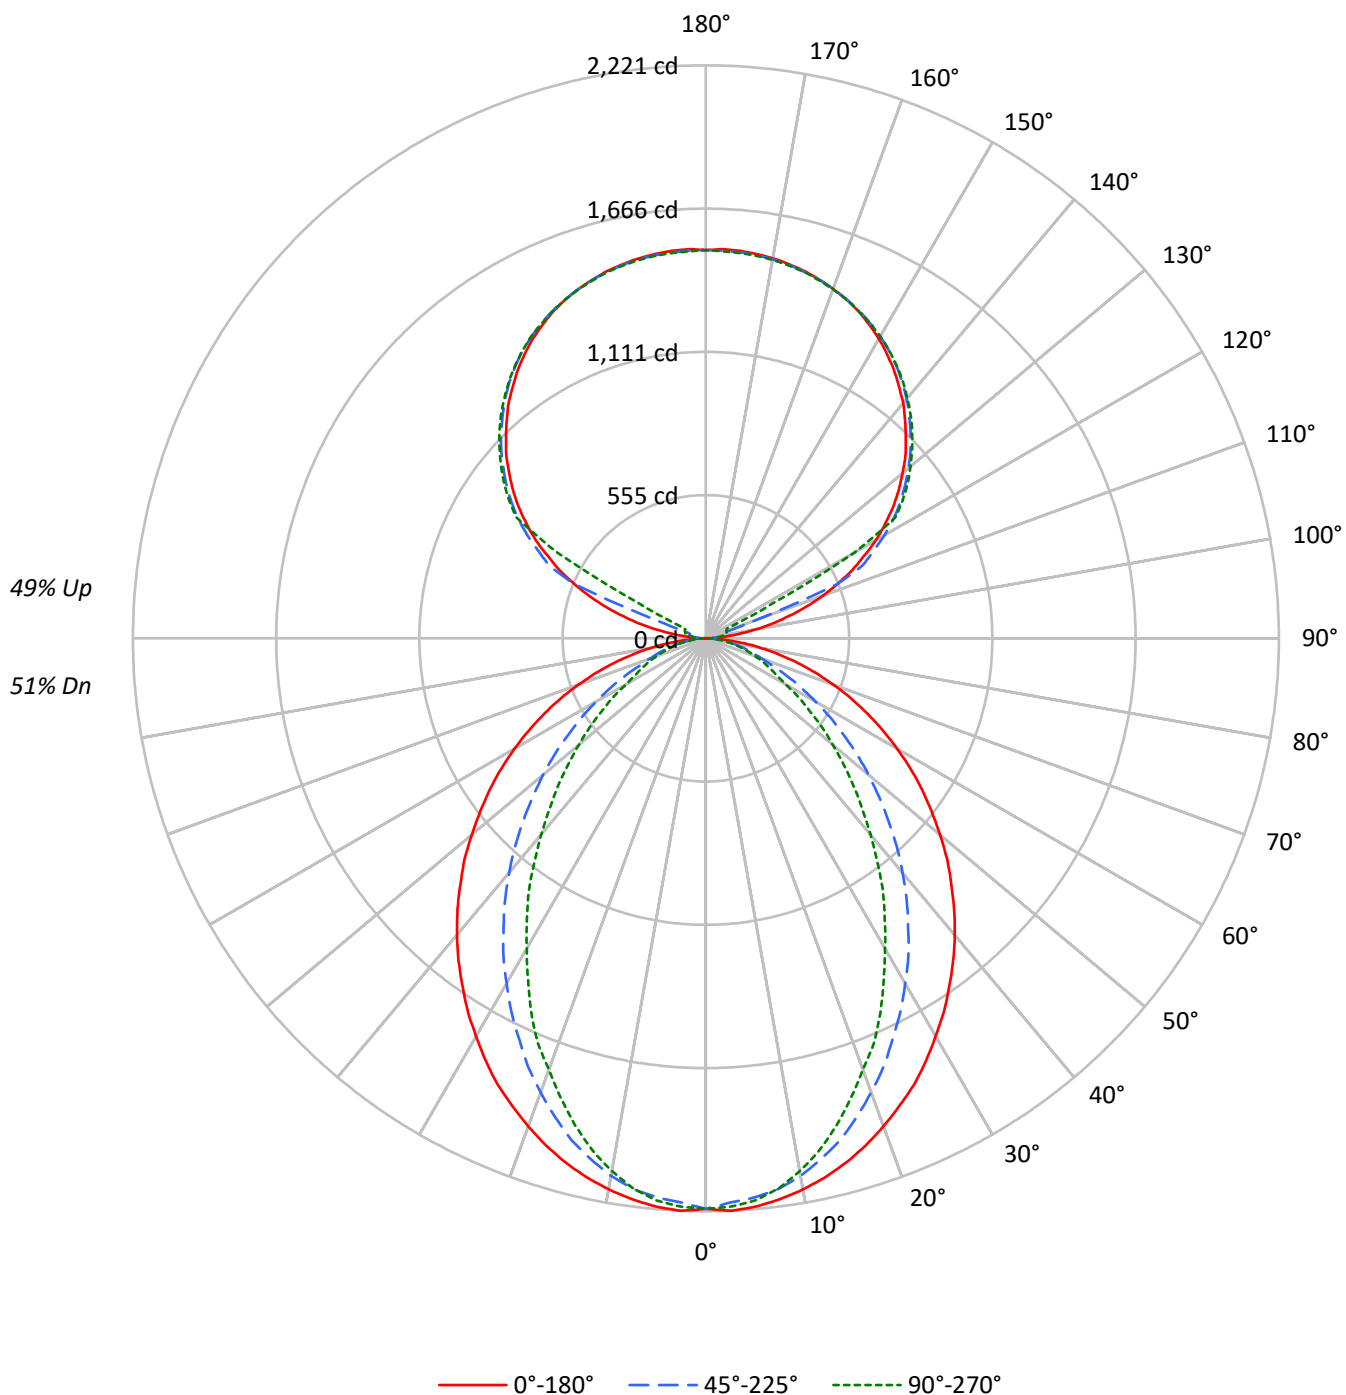

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	91	87	91	87	84	81	74	72	70	62	61	59	51	50	49
2	90	83	77	72	83	77	72	67	66	62	59	55	52	50	45	44	42
3	82	73	66	61	76	68	62	57	58	54	50	49	46	43	41	38	36
4	76	65	58	52	70	61	54	49	52	47	43	44	40	37	37	34	32
5	70	58	50	45	64	54	47	42	47	41	37	40	36	33	33	30	28
6	64	53	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	60	48	40	34	55	45	38	33	39	33	29	33	29	26	28	25	22
8	55	43	36	31	51	41	34	29	35	30	26	30	26	23	26	23	20
9	52	40	32	27	48	37	31	26	32	27	23	28	24	21	24	21	18
10	48	36	29	25	45	34	28	24	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5210	5210	5210
5°	5210	5115	5151
10°	5150	5002	4973
15°	5071	4825	4706
20°	4969	4586	4380
25°	4865	4320	4067
30°	4727	4048	3672
35°	4592	3757	3325
40°	4453	3457	2929
45°	4294	3127	2571
50°	4128	2794	2222
55°	3954	2440	1887
60°	3753	2072	1544
65°	3521	1699	1379
70°	3238	1352	1235
75°	2883	1168	1105
80°	2372	946	930
85°	1552	584	652

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4294 cd/sqm

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	2.3
10°-20°	568.9	6.3
20°-30°	798.7	8.9
30°-40°	870.7	9.7
40°-50°	800.3	8.9
50°-60°	628.5	7.0
60°-70°	409.1	4.6
70°-80°	210.6	2.3
80°-90°	56.4	0.6
90°-100°	49.6	0.6
100°-110°	185.0	2.1
110°-120°	490.6	5.5
120°-130°	813.6	9.1
130°-140°	864.3	9.6
140°-150°	803.2	9.0
150°-160°	645.8	7.2
160°-170°	416.1	4.6
170°-180°	143.2	1.6
0°-30°	1574.9	17.6
0°-40°	2445.6	27.3
0°-60°	3874.3	43.2
0°-90°	4550.4	50.8
90°-120°	725.2	8.1
90°-150°	3206.2	35.8
90°-180°	4411.0	49.2
0°-180°	8961.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	13	22	27	29	8
95°	71	35	42	48	47	84
105°	331	364	66	78	83	354
115°	626	644	672	168	89	616
125°	885	899	920	928	931	789
135°	1095	1113	1122	1134	1131	846
145°	1271	1270	1288	1296	1290	795
155°	1399	1389	1402	1409	1400	645
165°	1474	1468	1471	1478	1471	416
175°	1508	1500	1502	1510	1499	144
180°	1505	1505	1505	1505	1505	

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.1	13.0	21.8	27.3	29.3
92.5°	27.3	22.9	26.1	28.4	29.3
95°	70.7	34.8	42.4	48.0	46.8
97.5°	127.3	38.2	55.5	58.9	59.8
100°	192.8	43.6	62.1	70.7	72.9
102.5°	264.6	262.4	64.3	76.2	79.5
105°	331.0	363.7	66.4	78.4	82.8
107.5°	408.3	435.4	68.7	80.5	85.0
110°	482.4	505.2	190.6	81.7	86.0

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	552.1	571.6	553.1	83.8	87.1
115°	626.1	644.5	671.8	167.7	89.3
117.5°	690.3	712.0	730.7	574.8	289.6
120°	762.1	778.5	798.1	811.2	664.1
122.5°	823.0	840.5	862.4	868.9	870.0
125°	885.1	899.4	920.1	927.6	930.9
127.5°	941.7	957.0	973.5	984.3	985.3
130°	995.1	1012.6	1024.5	1036.5	1035.5
132.5°	1049.6	1063.8	1075.7	1085.6	1084.5
135°	1095.4	1112.9	1122.5	1133.5	1131.3
137.5°	1143.2	1156.3	1167.2	1178.1	1174.9
140°	1190.0	1198.8	1210.7	1220.5	1215.1
142.5°	1229.3	1237.0	1251.1	1259.7	1254.3
145°	1270.7	1269.5	1288.0	1295.7	1290.2
147.5°	1306.5	1303.2	1321.8	1327.2	1322.9
150°	1341.4	1333.8	1351.2	1357.7	1352.3
152.5°	1370.7	1362.1	1378.4	1385.0	1377.3
155°	1399.1	1389.4	1402.4	1408.9	1400.3
157.5°	1421.9	1413.3	1423.1	1430.7	1421.9
160°	1441.6	1435.0	1441.6	1448.0	1440.5
162.5°	1458.9	1452.5	1457.9	1465.5	1455.7
165°	1474.2	1467.8	1471.0	1478.5	1471.0
167.5°	1486.2	1479.6	1483.0	1490.6	1480.8
170°	1496.0	1489.4	1491.7	1499.2	1489.4
172.5°	1502.5	1496.0	1498.3	1505.8	1496.0
175°	1508.0	1500.3	1502.5	1510.1	1499.2
177.5°	1510.1	1502.5	1503.7	1511.3	1501.5
180°	1504.7	1504.7	1504.7	1504.7	1504.7

TEST NUMBER: P921609

CATALOG NUMBER: DFN2DIP-HX2F0-060D050US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.82	13.65	13.77	14.62	15.88	8.80	9.64	9.76	10.60	11.87
	3H	14.47	15.22	15.44	16.19	17.48	9.97	10.72	10.94	11.70	12.98
	4H	15.06	15.77	16.04	16.75	18.04	10.41	11.12	11.39	12.10	13.39
	6H	15.46	16.11	16.46	17.10	18.41	10.72	11.37	11.71	12.35	13.66
	8H	15.58	16.20	16.58	17.20	18.50	10.80	11.42	11.80	12.42	13.73
	12H	15.63	16.22	16.63	17.22	18.54	10.84	11.43	11.84	12.42	13.75
4H	2H	12.83	13.54	13.82	14.52	15.81	9.38	10.09	10.37	11.07	12.36
	3H	14.63	15.22	15.63	16.23	17.54	10.71	11.30	11.71	12.31	13.62
	4H	15.31	15.84	16.31	16.85	18.18	11.25	11.78	12.25	12.79	14.12
	6H	15.80	16.26	16.81	17.29	18.61	11.65	12.11	12.67	13.14	14.47
	8H	15.96	16.39	16.98	17.41	18.75	11.77	12.20	12.79	13.22	14.56
	12H	16.04	16.43	17.08	17.46	18.81	11.82	12.21	12.86	13.25	14.59
8H	4H	15.27	15.70	16.29	16.72	18.06	11.51	11.94	12.53	12.96	14.31
	6H	15.81	16.16	16.85	17.23	18.57	12.01	12.36	13.05	13.42	14.77
	8H	16.01	16.32	17.06	17.37	18.73	12.19	12.50	13.24	13.55	14.91
	12H	16.13	16.41	17.18	17.45	18.85	12.29	12.57	13.34	13.61	15.01
12H	4H	15.22	15.61	16.26	16.65	17.99	11.51	11.90	12.55	12.94	14.29
	6H	15.78	16.10	16.83	17.14	18.50	12.05	12.36	13.10	13.41	14.77
	8H	15.99	16.26	17.04	17.30	18.71	12.25	12.52	13.30	13.56	14.97