

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924293

Luminaire Tested: DFN2DIP-HX2F0-040D040US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924293
REPORT IS A COMBINATION OF REPORTS P900696 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-040D040US950-RLLONL
Description: 2 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7021.4 lumens
Efficiency: N/A
Efficacy: 107.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 65.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLLONL

Luminous Intensity Polar Plot

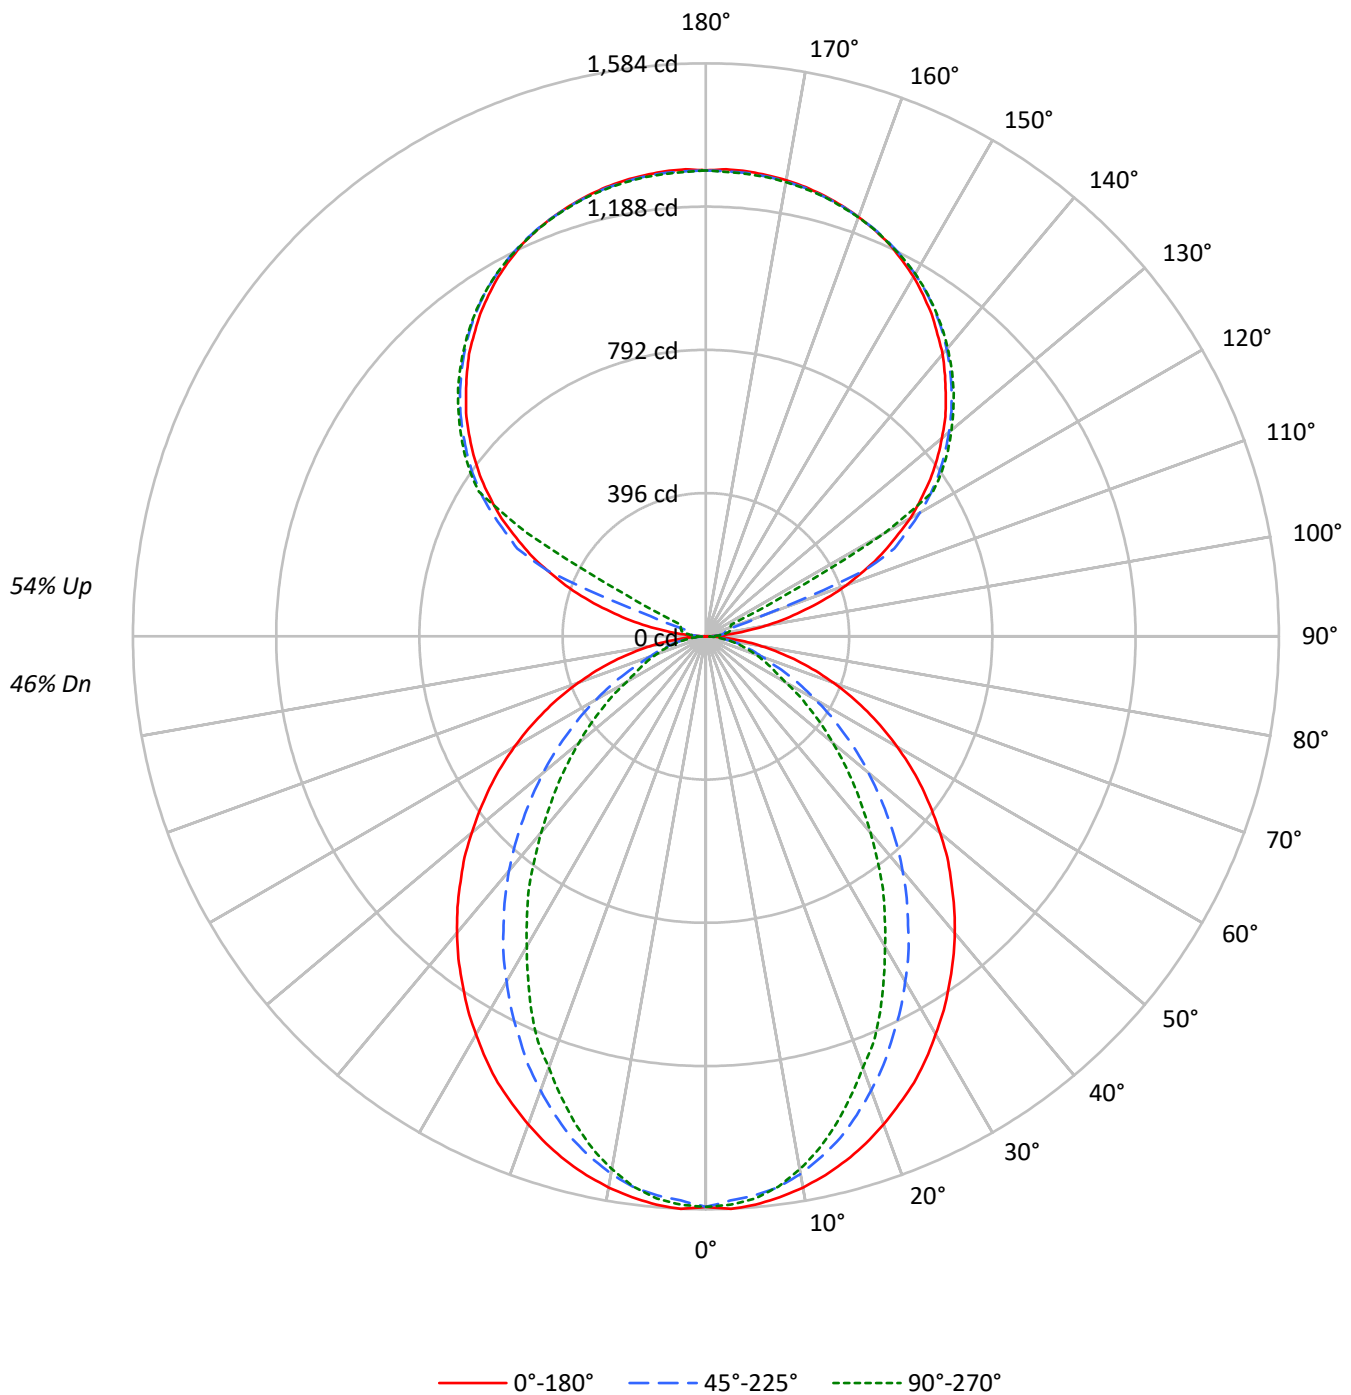

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3716	3716	3716
5°	3716	3648	3674
10°	3673	3568	3547
15°	3617	3441	3357
20°	3544	3271	3124
25°	3469	3081	2900
30°	3371	2887	2619
35°	3275	2680	2371
40°	3177	2466	2089
45°	3063	2230	1834
50°	2945	1993	1585
55°	2820	1740	1346
60°	2676	1478	1101
65°	2511	1212	984
70°	2310	964	881
75°	2056	833	788
80°	1692	674	664
85°	1106	417	465

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3063 cd/sqm

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.8	2.1
10°-20°	405.8	5.8
20°-30°	569.7	8.1
30°-40°	621.0	8.8
40°-50°	570.8	8.1
50°-60°	448.2	6.4
60°-70°	291.8	4.2
70°-80°	150.2	2.1
80°-90°	40.6	0.6
90°-100°	42.5	0.6
100°-110°	158.3	2.3
110°-120°	419.9	6.0
120°-130°	696.4	9.9
130°-140°	739.7	10.5
140°-150°	687.5	9.8
150°-160°	552.7	7.9
160°-170°	356.1	5.1
170°-180°	122.6	1.7
0°-30°	1123.3	16.0
0°-40°	1744.3	24.8
0°-60°	2763.3	39.4
0°-90°	3245.9	46.2
90°-120°	620.6	8.8
90°-150°	2744.1	39.1
90°-180°	3776.0	53.8
0°-180°	7021.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1577	1577	1577	1577	1577	
5°	1577	1570	1551	1564	1560	150
15°	1500	1484	1436	1409	1395	423
25°	1362	1316	1222	1163	1142	626
35°	1173	1100	975	885	853	734
45°	959	864	714	612	578	741
55°	729	618	464	378	351	652
65°	492	377	248	200	196	488
75°	262	163	114	104	103	278
85°	61	31	27	27	27	70
90°	1	11	19	23	25	7
95°	60	30	36	41	40	72
105°	283	311	57	67	71	303
115°	536	552	575	144	76	527
125°	758	770	787	794	797	676
135°	938	952	961	970	968	724
145°	1088	1087	1102	1109	1104	680
155°	1198	1189	1200	1206	1198	552
165°	1262	1256	1259	1266	1259	356
175°	1291	1284	1286	1292	1283	123
180°	1288	1288	1288	1288	1288	

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1577.2	1577.2	1577.2	1577.2	1577.2
2.5°	1584.3	1577.2	1561.4	1575.8	1572.9
5°	1577.2	1570.0	1551.4	1564.3	1560.1
7.5°	1564.3	1555.8	1535.8	1541.4	1534.3
10°	1547.2	1537.2	1508.7	1504.3	1495.9
12.5°	1525.8	1512.9	1474.3	1465.8	1450.1
15°	1500.1	1484.3	1435.9	1408.8	1394.6
17.5°	1470.1	1447.2	1387.2	1355.9	1333.0
20°	1435.9	1407.2	1335.9	1300.3	1268.8
22.5°	1398.8	1365.9	1283.0	1234.6	1213.3
25°	1361.6	1315.9	1221.7	1163.3	1141.7
27.5°	1317.5	1268.8	1164.6	1097.6	1064.7
30°	1270.3	1216.0	1101.8	1029.1	990.5
32.5°	1224.6	1158.9	1042.0	956.3	920.5
35°	1173.3	1100.4	974.9	884.9	853.4
37.5°	1123.3	1044.7	912.0	813.5	777.9
40°	1070.5	984.9	846.4	745.1	708.0
42.5°	1016.2	924.9	780.8	675.1	639.5
45°	959.2	863.5	713.7	612.3	578.0
47.5°	905.0	803.6	649.5	548.1	516.7
50°	845.0	743.6	586.6	488.1	458.2
52.5°	786.4	679.3	526.7	432.4	405.4
55°	729.3	618.0	463.8	378.3	351.2
57.5°	670.9	556.7	408.2	328.3	305.5
60°	610.8	496.7	349.6	276.9	254.1
62.5°	552.5	438.3	299.7	231.2	219.9
65°	492.5	376.7	248.3	199.9	195.5
67.5°	435.4	319.7	199.9	175.5	171.2
70°	375.4	264.1	165.5	151.3	145.5
72.5°	318.3	212.6	138.4	127.1	124.2
75°	262.5	162.7	114.2	104.2	102.8
77.5°	207.0	115.5	90.0	84.2	81.3
80°	155.5	82.8	68.4	62.9	62.9
82.5°	108.5	55.7	47.1	44.2	44.2
85°	61.3	31.4	27.1	27.1	27.1
87.5°	22.9	11.4	11.4	10.0	10.0
90°	0.9	11.2	18.6	23.4	25.1
92.5°	23.4	19.6	22.3	24.2	25.1
95°	60.5	29.8	36.3	41.0	40.1
97.5°	109.0	32.6	47.5	50.4	51.2
100°	164.9	37.3	53.1	60.5	62.4
102.5°	226.4	224.7	55.0	65.2	68.0
105°	283.2	311.3	56.9	67.1	70.8
107.5°	349.5	372.7	58.8	69.0	72.7
110°	412.9	432.4	163.1	69.9	73.6

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	472.5	489.2	473.4	71.7	74.6
115°	535.8	551.6	575.0	143.5	76.5
117.5°	590.8	609.4	625.3	492.0	247.8
120°	652.3	666.3	683.1	694.3	568.5
122.5°	704.4	719.4	738.1	743.6	744.6
125°	757.6	769.8	787.4	794.0	796.8
127.5°	806.0	819.1	833.1	842.5	843.3
130°	851.7	866.7	876.8	887.1	886.3
132.5°	898.3	910.5	920.7	929.1	928.2
135°	937.5	952.5	960.8	970.1	968.3
137.5°	978.4	989.6	999.0	1008.3	1005.5
140°	1018.5	1026.0	1036.2	1044.6	1040.0
142.5°	1052.2	1058.7	1070.8	1078.1	1073.5
145°	1087.6	1086.6	1102.3	1108.9	1104.3
147.5°	1118.2	1115.4	1131.3	1135.9	1132.3
150°	1148.0	1141.6	1156.5	1162.1	1157.4
152.5°	1173.2	1165.8	1179.7	1185.3	1178.9
155°	1197.5	1189.2	1200.3	1205.9	1198.4
157.5°	1217.0	1209.6	1218.1	1224.6	1217.0
160°	1233.8	1228.2	1233.8	1239.3	1232.9
162.5°	1248.7	1243.2	1247.8	1254.3	1245.9
165°	1261.8	1256.2	1259.0	1265.5	1259.0
167.5°	1272.1	1266.3	1269.3	1275.8	1267.4
170°	1280.5	1274.8	1276.6	1283.2	1274.8
172.5°	1286.0	1280.5	1282.4	1288.9	1280.5
175°	1290.6	1284.1	1286.0	1292.5	1283.2
177.5°	1292.5	1286.0	1286.9	1293.5	1285.1
180°	1287.9	1287.9	1287.9	1287.9	1287.9

TEST NUMBER: P924293

CATALOG NUMBER: DFN2DIP-HX2F0-040D040US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.21	12.01	12.20	13.01	14.34	7.19	7.99	8.19	8.99	10.32
	3H	12.86	13.57	13.86	14.59	15.93	8.36	9.07	9.37	10.09	11.43
	4H	13.45	14.12	14.47	15.14	16.50	8.80	9.47	9.82	10.49	11.84
	6H	13.85	14.47	14.88	15.49	16.86	9.10	9.72	10.13	10.74	12.11
	8H	13.96	14.55	15.00	15.59	16.95	9.18	9.78	10.22	10.81	12.17
	12H	14.01	14.58	15.05	15.60	16.99	9.22	9.78	10.26	10.81	12.20
4H	2H	11.22	11.90	12.24	12.91	14.27	7.77	8.44	8.79	9.46	10.81
	3H	13.02	13.58	14.05	14.62	15.99	9.10	9.66	10.13	10.70	12.07
	4H	13.69	14.20	14.73	15.24	16.63	9.63	10.14	10.67	11.18	12.57
	6H	14.18	14.62	15.23	15.68	17.06	10.03	10.47	11.08	11.53	12.92
	8H	14.34	14.75	15.39	15.80	17.20	10.15	10.56	11.20	11.61	13.01
	12H	14.42	14.79	15.49	15.86	17.26	10.20	10.57	11.27	11.64	13.04
8H	4H	13.65	14.06	14.70	15.11	16.51	9.89	10.30	10.94	11.35	12.76
	6H	14.19	14.53	15.26	15.62	17.02	10.39	10.73	11.46	11.82	13.22
	8H	14.39	14.69	15.47	15.76	17.18	10.56	10.86	11.64	11.94	13.36
	12H	14.51	14.77	15.59	15.84	17.30	10.67	10.93	11.75	12.00	13.46
12H	4H	13.60	13.97	14.67	15.04	16.44	9.89	10.26	10.96	11.33	12.74
	6H	14.16	14.46	15.24	15.54	16.96	10.43	10.73	11.51	11.80	13.22
	8H	14.36	14.63	15.45	15.70	17.16	10.62	10.88	11.71	11.96	13.42

END OF REPORT