

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P924323

Luminaire Tested: DFN2DIP-HX2F0-060D020US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P924323
REPORT IS A COMBINATION OF REPORTS P900679 AND P897595
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX2F0-060D020US950-FLLONL
Description: 2 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7555.7 lumens
Efficiency: N/A
Efficacy: 101.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 1.99' x L: 2.3' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 74.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

Luminous Intensity Polar Plot

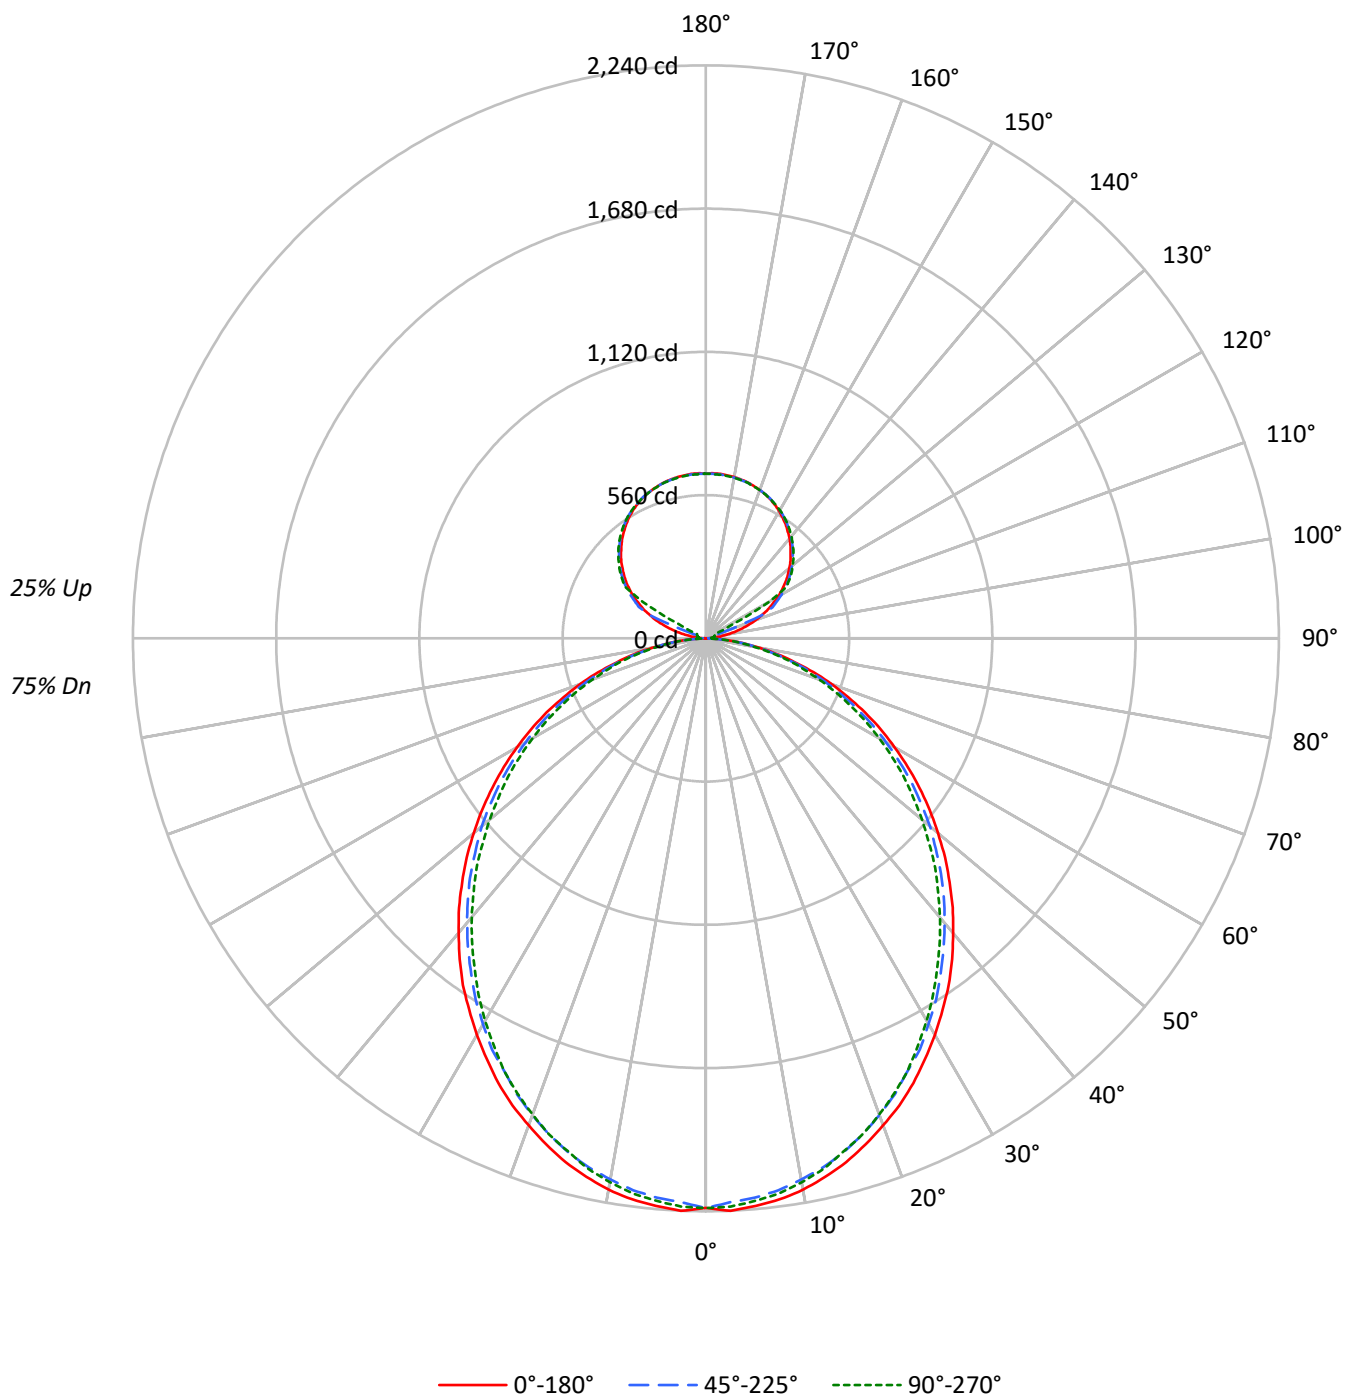

TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	46	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	37	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5248	5248	5248
5°	5248	5162	5200
10°	5197	5080	5120
15°	5112	4984	5000
20°	5000	4855	4878
25°	4889	4704	4739
30°	4752	4562	4564
35°	4621	4398	4379
40°	4461	4230	4203
45°	4302	4062	4023
50°	4127	3885	3814
55°	3943	3681	3620
60°	3735	3440	3398
65°	3506	3189	3136
70°	3215	2882	2853
75°	2817	2515	2578
80°	2332	2048	2080
85°	1583	1285	1288

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4302 cd/sqm

TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.6	2.8
10°-20°	589.8	7.8
20°-30°	866.8	11.5
30°-40°	1006.7	13.3
40°-50°	1005.5	13.3
50°-60°	876.7	11.6
60°-70°	648.1	8.6
70°-80°	366.7	4.9
80°-90°	97.9	1.3
90°-100°	21.2	0.3
100°-110°	79.1	1.0
110°-120°	209.9	2.8
120°-130°	348.2	4.6
130°-140°	369.8	4.9
140°-150°	343.7	4.5
150°-160°	276.4	3.7
160°-170°	178.1	2.4
170°-180°	61.3	0.8
0°-30°	1666.2	22.1
0°-40°	2673.0	35.4
0°-60°	4555.2	60.3
0°-90°	5667.9	75.0
90°-120°	310.3	4.1
90°-150°	1372.0	18.2
90°-180°	1888.0	25.0
0°-180°	7555.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2227	2227	2227	2227	2227	
5°	2227	2219	2195	2212	2208	211
15°	2120	2108	2080	2088	2078	597
25°	1919	1902	1866	1870	1866	883
35°	1656	1634	1600	1587	1576	1034
45°	1347	1332	1300	1276	1268	1040
55°	1020	1007	981	955	945	912
65°	688	675	653	634	623	680
75°	360	356	345	332	336	384
85°	88	86	84	77	75	98
90°	0	6	9	12	13	7
95°	30	15	18	20	20	36
105°	142	156	28	34	35	151
115°	268	276	288	72	38	264
125°	379	385	394	397	398	338
135°	469	476	480	485	484	362
145°	544	543	551	554	552	340
155°	599	594	600	603	599	276
165°	631	628	629	633	629	178
175°	645	642	643	646	642	61
180°	644	644	644	644	644	

TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2227.2	2227.2	2227.2	2227.2	2227.2
2.5°	2240.2	2229.5	2205.8	2227.2	2223.1
5°	2227.2	2218.8	2195.2	2212.2	2208.1
7.5°	2212.2	2199.5	2175.9	2193.2	2188.9
10°	2188.9	2173.9	2148.1	2165.2	2158.8
12.5°	2156.6	2143.8	2118.2	2128.9	2124.6
15°	2120.2	2107.5	2079.5	2088.2	2077.5
17.5°	2075.2	2062.5	2034.6	2045.2	2034.6
20°	2025.9	2013.2	1983.2	1989.6	1981.2
22.5°	1976.9	1957.5	1929.6	1929.6	1925.3
25°	1918.9	1901.9	1865.5	1869.6	1865.5
27.5°	1854.6	1839.6	1811.8	1805.5	1794.9
30°	1790.6	1773.2	1741.2	1734.8	1726.2
32.5°	1721.9	1709.2	1674.8	1661.9	1653.3
35°	1655.6	1634.2	1599.9	1586.9	1576.2
37.5°	1580.6	1561.2	1527.0	1511.9	1501.2
40°	1503.5	1486.2	1452.0	1432.9	1424.2
42.5°	1428.5	1411.3	1377.2	1355.6	1342.9
45°	1347.2	1332.2	1299.9	1276.5	1267.9
47.5°	1267.9	1252.9	1218.6	1195.0	1182.2
50°	1184.3	1173.6	1143.7	1113.6	1102.9
52.5°	1102.9	1087.9	1060.2	1036.6	1021.6
55°	1019.5	1006.6	980.9	955.2	944.6
57.5°	936.0	925.3	897.3	871.7	863.0
60°	852.3	843.9	814.0	790.3	783.9
62.5°	770.9	755.9	734.6	713.2	704.6
65°	687.5	674.7	653.3	633.9	623.2
67.5°	601.9	591.0	571.9	556.9	548.3
70°	522.6	514.0	494.6	479.7	471.3
72.5°	441.2	432.6	422.0	407.0	400.6
75°	359.7	355.7	344.7	332.0	336.3
77.5°	287.0	278.4	274.0	267.7	261.3
80°	214.3	212.0	207.7	201.3	197.0
82.5°	145.7	145.7	143.6	135.0	135.0
85°	87.7	85.7	83.6	77.0	75.0
87.5°	38.6	34.3	30.0	23.7	21.4
90°	0.5	5.6	9.3	11.6	12.6
92.5°	11.6	9.8	11.2	12.1	12.6
95°	30.2	14.9	18.1	20.5	20.0
97.5°	54.5	16.3	23.8	25.2	25.7
100°	82.5	18.6	26.5	30.2	31.2
102.5°	113.2	112.3	27.5	32.6	34.1
105°	141.7	155.6	28.4	33.5	35.4
107.5°	174.8	186.3	29.4	34.4	36.3
110°	206.4	216.2	81.6	35.0	36.8



TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	236.2	244.6	236.7	35.9	37.3
115°	267.9	275.8	287.5	71.7	38.3
117.5°	295.4	304.7	312.6	246.0	123.9
120°	326.2	333.1	341.5	347.2	284.2
122.5°	352.2	359.7	369.0	371.8	372.3
125°	378.8	384.8	393.7	397.0	398.4
127.5°	403.1	409.6	416.6	421.2	421.7
130°	425.9	433.3	438.5	443.6	443.1
132.5°	449.1	455.2	460.3	464.5	464.1
135°	468.8	476.2	480.3	485.1	484.2
137.5°	489.2	494.8	499.5	504.2	502.8
140°	509.2	513.1	518.1	522.3	520.0
142.5°	526.0	529.4	535.4	539.1	536.7
145°	543.8	543.3	551.2	554.5	552.2
147.5°	559.1	557.7	565.6	567.9	566.1
150°	574.0	570.8	578.2	581.0	578.7
152.5°	586.6	582.9	589.9	592.7	589.4
155°	598.7	594.5	600.2	602.9	599.2
157.5°	608.6	604.8	609.0	612.3	608.6
160°	617.0	614.1	617.0	619.7	616.5
162.5°	624.3	621.5	623.9	627.2	623.0
165°	630.9	628.1	629.4	632.8	629.4
167.5°	636.0	633.2	634.6	637.9	633.6
170°	640.2	637.4	638.3	641.6	637.4
172.5°	643.0	640.2	641.2	644.4	640.2
175°	645.3	642.0	643.0	646.2	641.6
177.5°	646.2	643.0	643.5	646.7	642.5
180°	643.9	643.9	643.9	643.9	643.9

TEST NUMBER: P924323

CATALOG NUMBER: DFN2DIP-HX2F0-060D020US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.94	16.08	15.65	16.81	17.68	14.52	15.66	15.23	16.39	17.25
	3H	16.60	17.62	17.32	18.36	19.26	16.14	17.16	16.86	17.90	18.80
	4H	17.18	18.15	17.92	18.90	19.81	16.72	17.69	17.46	18.44	19.35
	6H	17.58	18.47	18.33	19.23	20.15	17.12	18.01	17.87	18.77	19.69
	8H	17.68	18.53	18.44	19.31	20.23	17.22	18.07	17.98	18.85	19.77
	12H	17.73	18.54	18.50	19.31	20.26	17.27	18.08	18.03	18.85	19.80
4H	2H	15.43	16.40	16.17	17.14	18.05	15.09	16.06	15.83	16.81	17.71
	3H	17.29	18.10	18.04	18.88	19.81	16.91	17.71	17.66	18.50	19.42
	4H	17.99	18.73	18.77	19.51	20.47	17.60	18.34	18.37	19.12	20.07
	6H	18.50	19.14	19.29	19.95	20.91	18.11	18.74	18.90	19.55	20.51
	8H	18.65	19.24	19.44	20.05	21.02	18.25	18.85	19.04	19.65	20.62
	12H	18.72	19.26	19.53	20.08	21.06	18.32	18.85	19.13	19.68	20.66
8H	4H	18.20	18.80	19.00	19.60	20.58	17.85	18.45	18.64	19.25	20.22
	6H	18.82	19.31	19.64	20.16	21.13	18.46	18.96	19.29	19.81	20.78
	8H	19.02	19.46	19.86	20.31	21.30	18.67	19.11	19.50	19.95	20.94
	12H	19.15	19.54	19.99	20.37	21.42	18.78	19.17	19.62	20.01	21.05
12H	4H	18.20	18.74	19.01	19.56	20.54	17.86	18.39	18.67	19.22	20.20
	6H	18.84	19.28	19.68	20.13	21.12	18.50	18.94	19.34	19.79	20.78
	8H	19.08	19.47	19.92	20.30	21.35	18.73	19.12	19.57	19.96	21.00