

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902521

Luminaire Tested: DFN2DIP-HX3F0-030D030US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902521
REPORT IS A COMBINATION OF REPORTS P900722 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-030D030US830-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5202.9 lumens
Efficiency: N/A
Efficacy: 111.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 46.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLLONL

Luminous Intensity Polar Plot

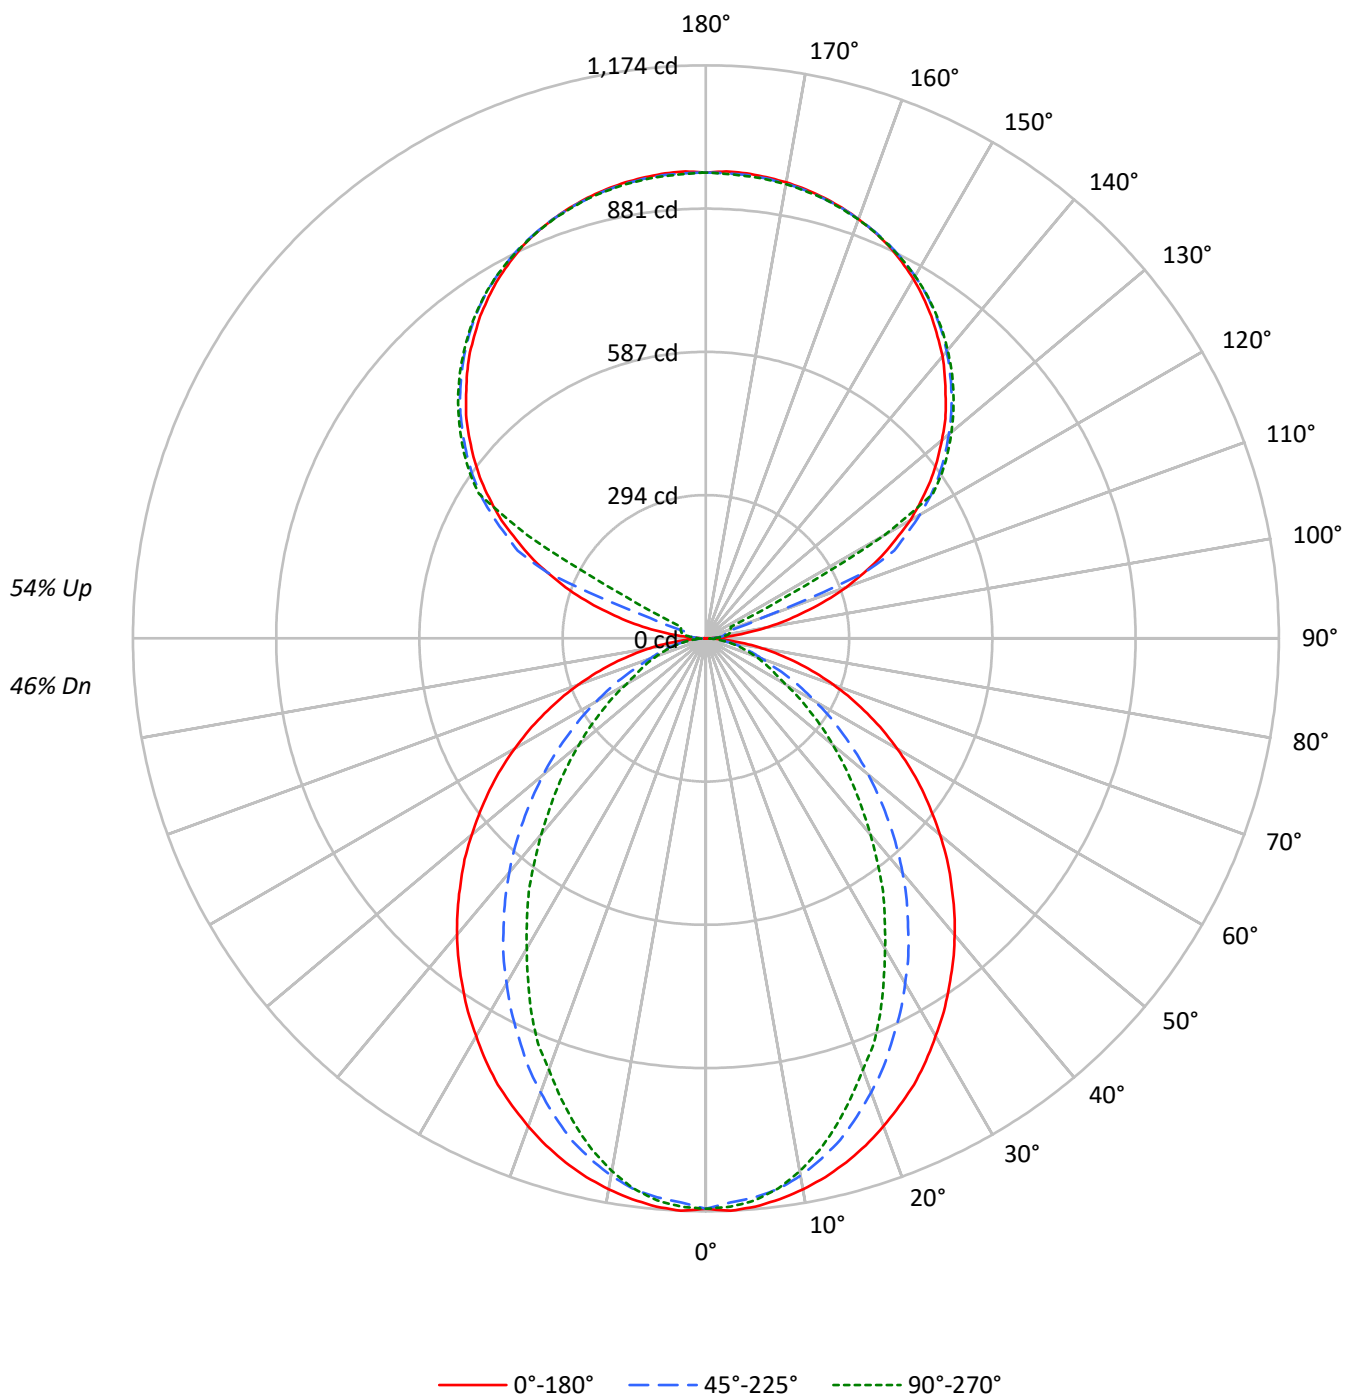

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1354	1354	1354
5°	1355	1331	1340
10°	1341	1304	1296
15°	1322	1260	1228
20°	1297	1200	1144
25°	1272	1132	1064
30°	1237	1063	962
35°	1204	989	873
40°	1169	913	770
45°	1130	828	678
50°	1089	742	587
55°	1046	651	500
60°	996	556	411
65°	939	459	369
70°	869	368	333
75°	781	323	301
80°	656	268	259
85°	447	174	190

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1130 cd/sqm

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	109.5	2.1
10°-20°	300.7	5.8
20°-30°	422.1	8.1
30°-40°	460.2	8.8
40°-50°	422.9	8.1
50°-60°	332.2	6.4
60°-70°	216.2	4.2
70°-80°	111.3	2.1
80°-90°	30.1	0.6
90°-100°	31.5	0.6
100°-110°	117.3	2.3
110°-120°	311.1	6.0
120°-130°	516.0	9.9
130°-140°	548.1	10.5
140°-150°	509.4	9.8
150°-160°	409.6	7.9
160°-170°	263.9	5.1
170°-180°	90.8	1.7
0°-30°	832.3	16.0
0°-40°	1292.5	24.8
0°-60°	2047.6	39.4
0°-90°	2405.2	46.2
90°-120°	459.9	8.8
90°-150°	2033.4	39.1
90°-180°	2798.0	53.8
0°-180°	5202.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1169	1169	1169	1169	1169	
5°	1169	1163	1150	1159	1156	111
15°	1112	1100	1064	1044	1033	313
25°	1009	975	905	862	846	464
35°	869	815	722	656	632	544
45°	711	640	529	454	428	549
55°	540	458	344	280	260	483
65°	365	279	184	148	145	362
75°	194	121	85	77	76	206
85°	45	23	20	20	20	52
90°	1	8	14	17	19	5
95°	45	22	27	30	30	53
105°	210	231	42	50	52	224
115°	397	409	426	106	57	391
125°	561	570	584	588	590	501
135°	695	706	712	719	718	537
145°	806	805	817	822	818	504
155°	887	881	889	894	888	409
165°	935	931	933	938	933	264
175°	956	952	953	958	951	91
180°	954	954	954	954	954	

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1168.7	1168.7	1168.7	1168.7	1168.7
2.5°	1173.9	1168.7	1157.0	1167.6	1165.5
5°	1168.7	1163.4	1149.6	1159.1	1155.9
7.5°	1159.1	1152.8	1138.0	1142.2	1136.9
10°	1146.4	1139.1	1117.9	1114.7	1108.4
12.5°	1130.6	1121.1	1092.5	1086.2	1074.5
15°	1111.5	1099.9	1063.9	1043.9	1033.3
17.5°	1089.3	1072.4	1027.9	1004.8	987.8
20°	1063.9	1042.7	989.9	963.6	940.2
22.5°	1036.5	1012.1	950.7	914.8	899.0
25°	1009.0	975.1	905.3	862.0	846.0
27.5°	976.2	940.2	863.0	813.3	788.9
30°	941.3	901.1	816.4	762.6	734.0
32.5°	907.4	858.8	772.1	708.6	682.1
35°	869.4	815.4	722.4	655.7	632.4
37.5°	832.4	774.1	675.8	602.8	576.5
40°	793.2	729.8	627.2	552.0	524.6
42.5°	753.0	685.4	578.5	500.2	473.8
45°	710.8	639.8	528.9	453.6	428.3
47.5°	670.5	595.5	481.3	406.0	382.9
50°	626.1	551.0	434.7	361.7	339.5
52.5°	582.7	503.4	390.3	320.5	300.4
55°	540.4	457.9	343.7	280.3	260.2
57.5°	497.1	412.5	302.6	243.3	226.3
60°	452.6	368.1	259.1	205.2	188.3
62.5°	409.3	324.7	222.1	171.4	163.0
65°	364.9	279.2	184.0	148.1	144.9
67.5°	322.6	236.9	148.1	130.1	126.9
70°	278.1	195.7	122.6	112.1	107.8
72.5°	235.8	157.5	102.5	94.2	92.0
75°	194.5	120.6	84.6	77.2	76.2
77.5°	153.4	85.6	66.6	62.4	60.2
80°	115.3	61.4	50.7	46.6	46.6
82.5°	80.3	41.3	34.9	32.8	32.8
85°	45.4	23.2	20.1	20.1	20.1
87.5°	17.0	8.4	8.4	7.4	7.4
90°	0.7	8.3	13.8	17.3	18.6
92.5°	17.3	14.5	16.6	18.0	18.6
95°	44.9	22.1	26.9	30.4	29.7
97.5°	80.8	24.2	35.2	37.3	38.0
100°	122.2	27.6	39.4	44.9	46.3
102.5°	167.8	166.5	40.7	48.3	50.4
105°	209.9	230.6	42.1	49.7	52.5
107.5°	258.9	276.2	43.5	51.1	53.9
110°	305.9	320.4	120.8	51.8	54.6

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	350.2	362.5	350.8	53.2	55.2
115°	397.0	408.8	426.0	106.3	56.6
117.5°	437.8	451.6	463.4	364.6	183.7
120°	483.3	493.7	506.1	514.4	421.2
122.5°	522.0	533.1	547.0	551.0	551.8
125°	561.4	570.3	583.5	588.3	590.4
127.5°	597.3	606.9	617.4	624.2	624.9
130°	631.1	642.2	649.8	657.3	656.8
132.5°	665.6	674.7	682.2	688.4	687.8
135°	694.7	705.8	711.9	718.9	717.5
137.5°	725.0	733.3	740.3	747.2	745.1
140°	754.7	760.3	767.8	774.0	770.6
142.5°	779.7	784.5	793.4	798.9	795.5
145°	805.9	805.1	816.9	821.7	818.2
147.5°	828.6	826.5	838.3	841.7	839.0
150°	850.7	845.9	857.0	861.0	857.6
152.5°	869.3	863.8	874.2	878.4	873.5
155°	887.3	881.2	889.4	893.5	888.1
157.5°	901.8	896.4	902.6	907.4	901.8
160°	914.3	910.1	914.3	918.4	913.5
162.5°	925.3	921.1	924.6	929.4	923.2
165°	934.9	930.9	932.9	937.7	932.9
167.5°	942.5	938.4	940.5	945.4	939.1
170°	948.8	944.6	946.0	950.8	944.6
172.5°	952.9	948.8	950.2	955.0	948.8
175°	956.3	951.5	952.9	957.7	950.8
177.5°	957.7	952.9	953.7	958.5	952.3
180°	954.3	954.3	954.3	954.3	954.3

TEST NUMBER: P902521

CATALOG NUMBER: DFN2DIP-HX3F0-030D030US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.79	8.59	8.79	9.60	10.92	3.77	4.57	4.76	5.57	6.90
	3H	9.46	10.18	10.47	11.19	12.54	4.95	5.67	5.96	6.68	8.03
	4H	10.06	10.74	11.08	11.75	13.11	5.40	6.07	6.42	7.09	8.44
	6H	10.48	11.10	11.50	12.12	13.49	5.71	6.34	6.74	7.35	8.72
	8H	10.60	11.19	11.63	12.23	13.59	5.80	6.39	6.84	7.43	8.79
	12H	10.66	11.22	11.69	12.25	13.63	5.84	6.40	6.88	7.43	8.82
4H	2H	7.81	8.48	8.83	9.50	10.85	4.36	5.03	5.38	6.05	7.40
	3H	9.62	10.19	10.66	11.23	12.60	5.70	6.26	6.73	7.30	8.67
	4H	10.31	10.82	11.35	11.86	13.25	6.24	6.76	7.28	7.79	9.18
	6H	10.82	11.26	11.87	12.32	13.70	6.65	7.10	7.70	8.15	9.54
	8H	10.99	11.40	12.04	12.45	13.85	6.78	7.19	7.83	8.24	9.65
	12H	11.07	11.45	12.14	12.51	13.92	6.84	7.21	7.91	8.28	9.69
8H	4H	10.27	10.69	11.32	11.74	13.14	6.51	6.93	7.57	7.98	9.38
	6H	10.83	11.17	11.90	12.26	13.66	7.03	7.37	8.10	8.46	9.86
	8H	11.04	11.34	12.12	12.42	13.84	7.21	7.51	8.30	8.59	10.01
	12H	11.17	11.44	12.26	12.51	13.97	7.33	7.59	8.41	8.66	10.12
12H	4H	10.22	10.60	11.29	11.66	13.07	6.52	6.89	7.59	7.95	9.36
	6H	10.81	11.10	11.89	12.18	13.60	7.07	7.37	8.15	8.45	9.87
	8H	11.02	11.28	12.10	12.35	13.81	7.28	7.54	8.36	8.61	10.07

END OF REPORT