

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902580

Luminaire Tested: DFN2DIP-HX3F0-050D060US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902580
REPORT IS A COMBINATION OF REPORTS P899248 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-050D060US830-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9010.7 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLLFLL

Luminous Intensity Polar Plot

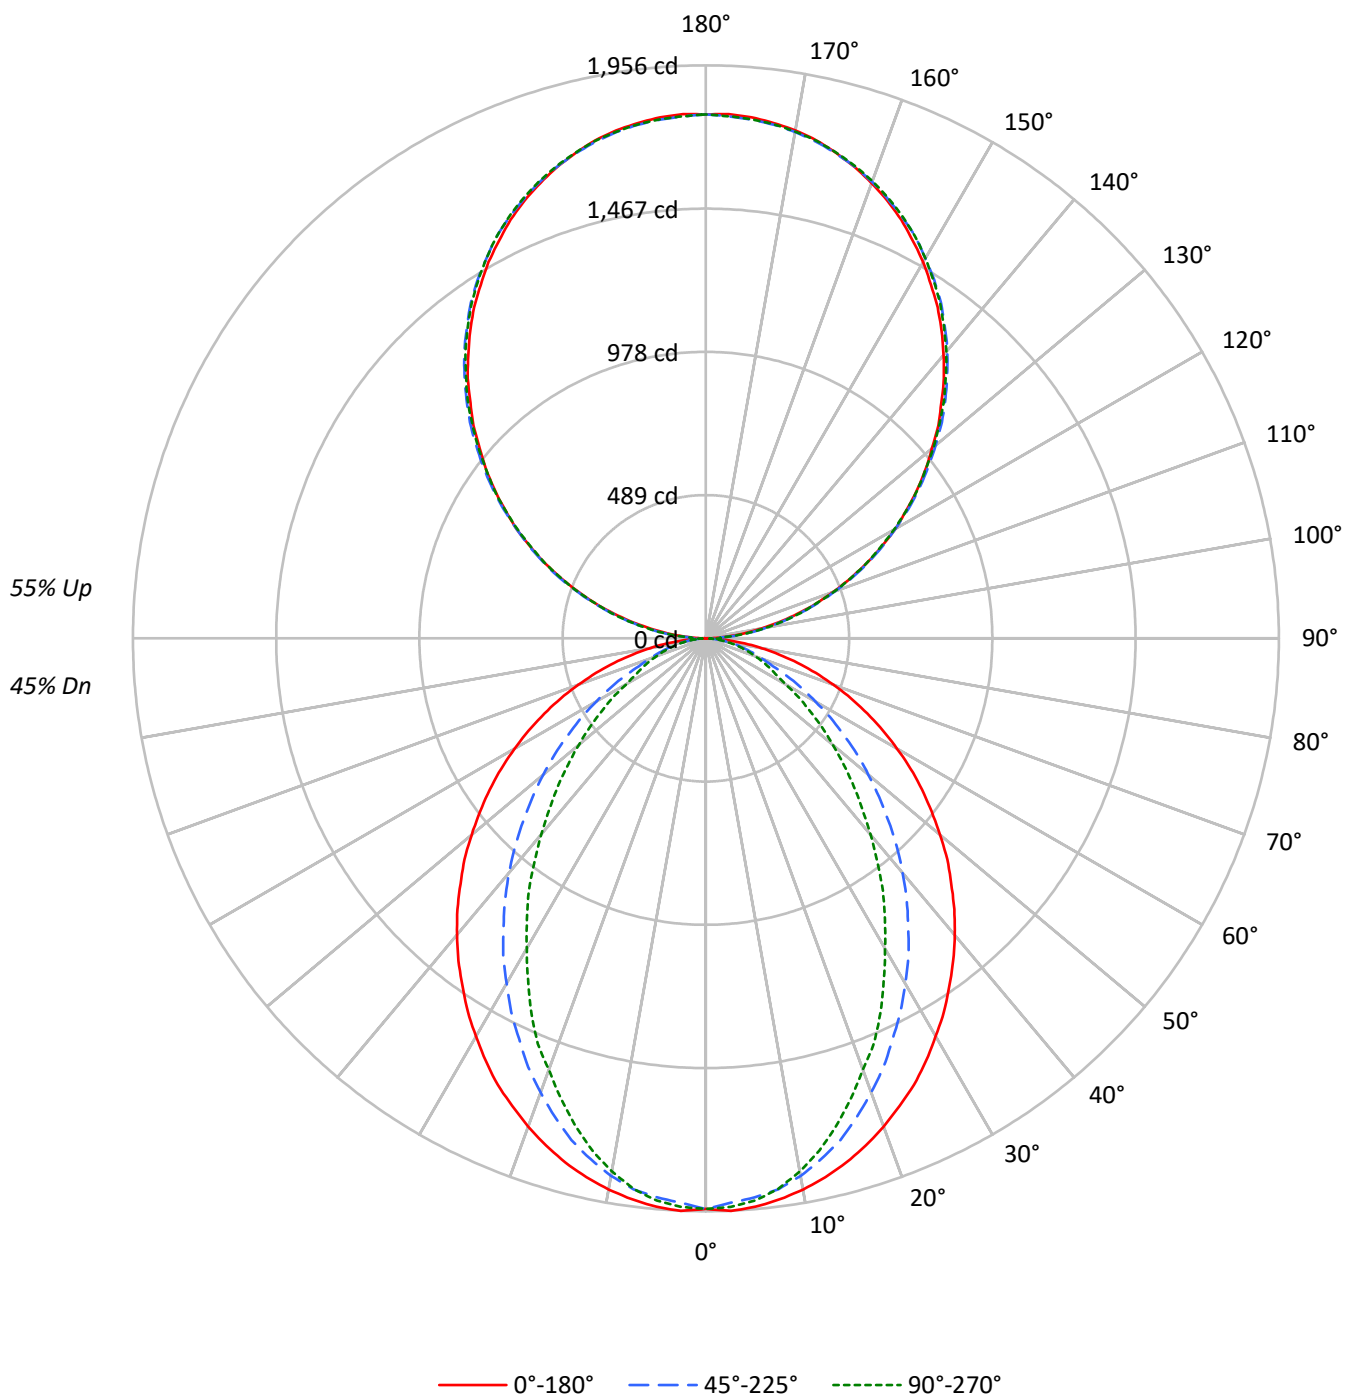

TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	51	51	51
1	97	93	89	86	89	85	82	79	71	69	67	58	56	55	46	45	44
2	89	82	76	71	81	75	70	66	63	59	56	51	49	47	41	39	38
3	81	72	65	59	74	66	60	55	56	51	47	46	43	40	37	34	33
4	74	64	56	51	68	59	52	47	50	45	41	41	37	35	33	30	28
5	68	57	49	44	63	53	46	41	45	39	35	37	33	30	30	27	25
6	63	51	44	38	58	48	41	36	40	35	31	34	30	27	27	24	22
7	58	47	39	33	54	43	36	31	37	31	28	31	27	24	25	22	20
8	54	42	35	30	50	39	33	28	34	28	25	28	24	21	23	20	18
9	51	39	31	27	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	36	29	24	43	33	27	23	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2256	2256	2256
5°	2259	2219	2233
10°	2235	2174	2159
15°	2204	2100	2046
20°	2162	2000	1907
25°	2119	1887	1773
30°	2062	1772	1603
35°	2006	1649	1455
40°	1949	1521	1284
45°	1883	1380	1129
50°	1815	1237	979
55°	1743	1085	834
60°	1660	926	685
65°	1564	764	615
70°	1449	614	555
75°	1303	538	502
80°	1092	446	431
85°	747	291	317

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1883 cd/sqm

TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	2.0
10°-20°	501.1	5.6
20°-30°	703.6	7.8
30°-40°	766.9	8.5
40°-50°	704.9	7.8
50°-60°	553.6	6.1
60°-70°	360.3	4.0
70°-80°	185.5	2.1
80°-90°	52.4	0.6
90°-100°	110.7	1.2
100°-110°	351.6	3.9
110°-120°	601.8	6.7
120°-130°	791.4	8.8
130°-140°	888.4	9.9
140°-150°	871.1	9.7
150°-160°	730.8	8.1
160°-170°	484.6	5.4
170°-180°	169.4	1.9
0°-30°	1387.2	15.4
0°-40°	2154.2	23.9
0°-60°	3412.7	37.9
0°-90°	4010.9	44.5
90°-120°	1064.1	11.8
90°-150°	3615.0	40.1
90°-180°	5000.0	55.5
0°-180°	9010.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	2	19	53	50	51	9
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8



TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P902580

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.39	10.18	10.40	11.20	12.55	5.37	6.16	6.38	7.17	8.52
	3H	11.06	11.76	12.08	12.79	14.16	6.55	7.26	7.57	8.28	9.65
	4H	11.66	12.33	12.69	13.35	14.73	7.00	7.66	8.03	8.69	10.07
	6H	12.07	12.69	13.12	13.72	15.11	7.31	7.92	8.35	8.96	10.35
	8H	12.20	12.78	13.24	13.83	15.21	7.40	7.98	8.45	9.03	10.41
	12H	12.25	12.81	13.30	13.85	15.26	7.44	7.99	8.49	9.03	10.44
4H	2H	9.41	10.07	10.44	11.10	12.48	5.96	6.62	6.99	7.65	9.03
	3H	11.22	11.78	12.27	12.83	14.22	7.30	7.85	8.34	8.91	10.30
	4H	11.91	12.41	12.96	13.46	14.87	7.84	8.35	8.89	9.39	10.81
	6H	12.41	12.85	13.47	13.92	15.33	8.25	8.69	9.31	9.76	11.17
	8H	12.58	12.99	13.64	14.05	15.47	8.38	8.78	9.44	9.84	11.27
	12H	12.67	13.04	13.75	14.11	15.54	8.44	8.80	9.52	9.88	11.31
8H	4H	11.87	12.28	12.93	13.34	14.76	8.11	8.52	9.17	9.58	11.00
	6H	12.43	12.76	13.51	13.87	15.29	8.62	8.96	9.71	10.06	11.48
	8H	12.64	12.93	13.73	14.02	15.46	8.81	9.10	9.90	10.19	11.63
	12H	12.77	13.03	13.86	14.11	15.59	8.92	9.18	10.02	10.26	11.74
12H	4H	11.82	12.19	12.90	13.26	14.69	8.11	8.48	9.19	9.56	10.99
	6H	12.40	12.70	13.49	13.78	15.22	8.67	8.96	9.76	10.05	11.49
	8H	12.61	12.87	13.71	13.96	15.44	8.87	9.13	9.97	10.21	11.70

END OF REPORT