

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902595

Luminaire Tested: DFN2DIP-HX3F0-060D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902595
REPORT IS A COMBINATION OF REPORTS P900741 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D040US830-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 108.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 86.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLLONL

Luminous Intensity Polar Plot

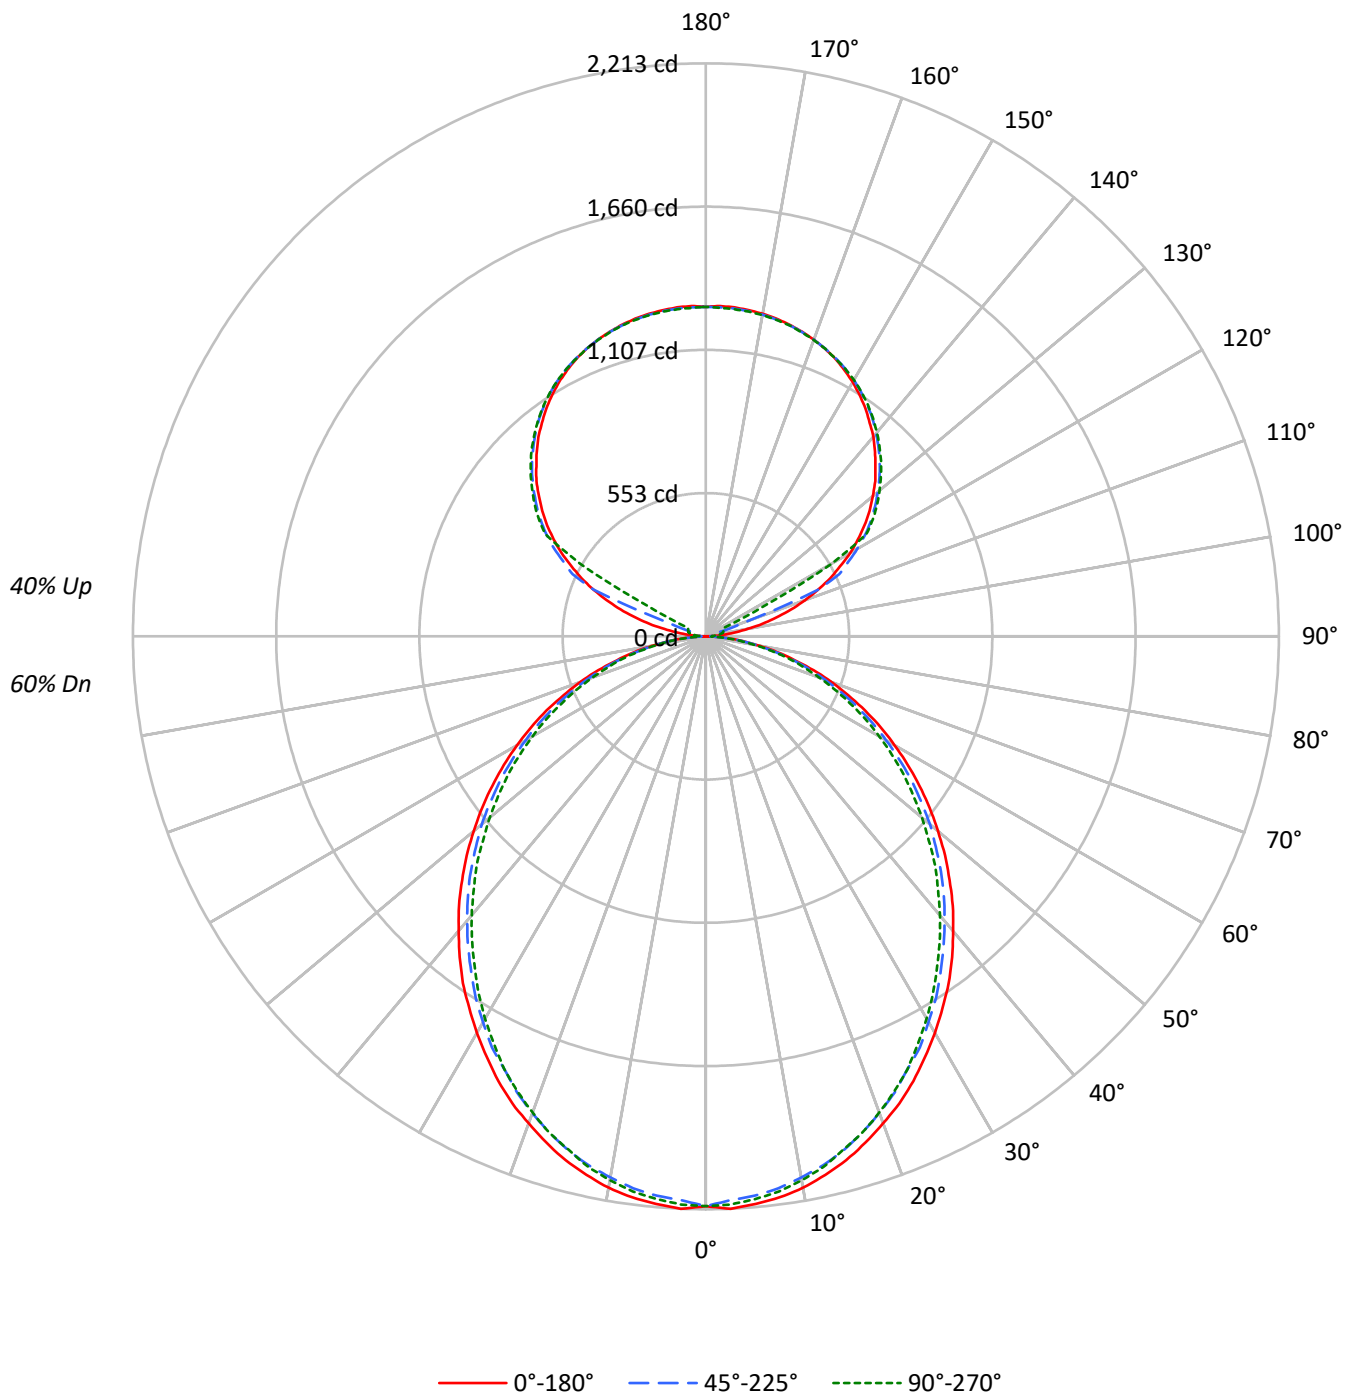

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2549	2549	2549
5°	2552	2512	2529
10°	2530	2476	2493
15°	2492	2434	2438
20°	2440	2375	2382
25°	2389	2306	2317
30°	2325	2241	2236
35°	2265	2165	2149
40°	2190	2088	2067
45°	2116	2010	1982
50°	2035	1929	1885
55°	1949	1835	1794
60°	1853	1724	1691
65°	1747	1609	1569
70°	1613	1468	1438
75°	1428	1299	1314
80°	1204	1083	1082
85°	853	717	702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2116 cd/sqm

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.2
10°-20°	582.7	6.2
20°-30°	856.4	9.2
30°-40°	994.6	10.7
40°-50°	993.4	10.6
50°-60°	866.2	9.3
60°-70°	640.3	6.9
70°-80°	362.3	3.9
80°-90°	97.9	1.0
90°-100°	41.9	0.4
100°-110°	156.4	1.7
110°-120°	414.8	4.4
120°-130°	688.0	7.4
130°-140°	730.8	7.8
140°-150°	679.2	7.3
150°-160°	546.1	5.9
160°-170°	351.9	3.8
170°-180°	121.1	1.3
0°-30°	1646.2	17.6
0°-40°	2640.9	28.3
0°-60°	4500.5	48.2
0°-90°	5600.9	60.0
90°-120°	613.2	6.6
90°-150°	2711.2	29.1
90°-180°	3730.0	40.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	11	18	23	25	9
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P902595

CATALOG NUMBER: DFN2DIP-HX3F0-060D040US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.36	12.32	12.22	13.20	14.32	10.93	11.89	11.79	12.77	13.89
	3H	13.02	13.88	13.89	14.77	15.92	12.55	13.41	13.43	14.31	15.45
	4H	13.60	14.42	14.50	15.32	16.48	13.13	13.95	14.03	14.85	16.01
	6H	14.00	14.75	14.91	15.66	16.83	13.53	14.28	14.44	15.19	16.36
	8H	14.11	14.82	15.02	15.75	16.92	13.64	14.35	14.55	15.28	16.45
	12H	14.15	14.84	15.07	15.76	16.95	13.68	14.36	14.60	15.28	16.48
4H	2H	11.83	12.64	12.73	13.54	14.70	11.48	12.30	12.38	13.20	14.36
	3H	13.69	14.37	14.60	15.31	16.48	13.30	13.98	14.21	14.92	16.09
	4H	14.40	15.02	15.33	15.95	17.15	14.00	14.62	14.92	15.55	16.75
	6H	14.92	15.45	15.85	16.41	17.60	14.51	15.05	15.45	16.00	17.20
	8H	15.07	15.57	16.00	16.51	17.73	14.66	15.16	15.60	16.11	17.32
	12H	15.14	15.59	16.10	16.56	17.77	14.72	15.18	15.68	16.14	17.36
8H	4H	14.61	15.11	15.54	16.05	17.27	14.25	14.75	15.19	15.70	16.91
	6H	15.23	15.65	16.20	16.64	17.85	14.87	15.29	15.84	16.28	17.49
	8H	15.45	15.81	16.42	16.79	18.02	15.08	15.45	16.06	16.43	17.66
	12H	15.58	15.90	16.56	16.87	18.15	15.20	15.52	16.18	16.50	17.77
12H	4H	14.60	15.05	15.55	16.01	17.23	14.25	14.70	15.20	15.66	16.88
	6H	15.26	15.63	16.23	16.61	17.84	14.91	15.28	15.89	16.26	17.49
	8H	15.50	15.82	16.48	16.80	18.07	15.15	15.47	16.13	16.44	17.72

END OF REPORT