

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902598

Luminaire Tested: DFN2DIP-HX3F0-060D050US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902598
REPORT IS A COMBINATION OF REPORTS P899235 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D050US830-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9769.4 lumens
Efficiency: N/A
Efficacy: 104.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 93.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFLL

Luminous Intensity Polar Plot

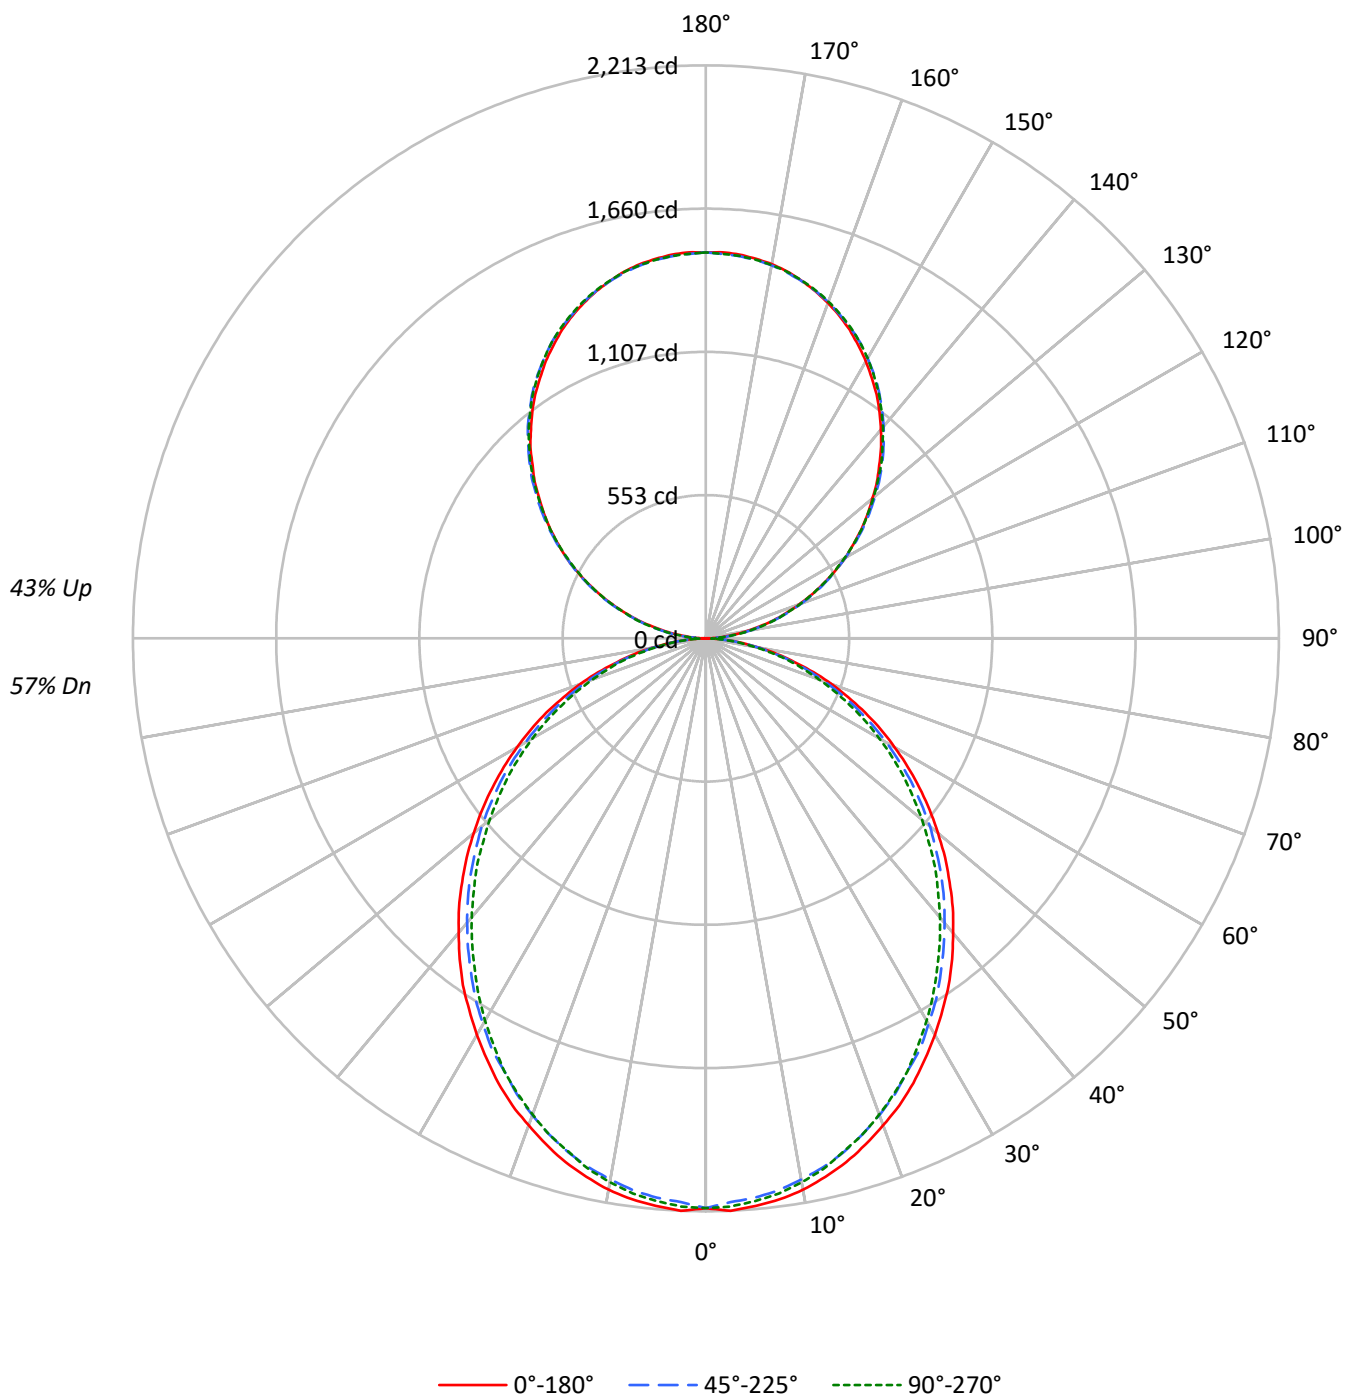

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2549	2549	2549
5°	2552	2512	2529
10°	2530	2476	2493
15°	2492	2434	2438
20°	2440	2375	2382
25°	2389	2306	2317
30°	2325	2241	2236
35°	2265	2165	2149
40°	2190	2088	2067
45°	2116	2010	1982
50°	2035	1929	1885
55°	1949	1835	1794
60°	1853	1724	1691
65°	1747	1609	1569
70°	1613	1468	1438
75°	1428	1299	1314
80°	1204	1083	1082
85°	853	717	702

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2116 cd/sqm

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.1
10°-20°	582.7	6.0
20°-30°	856.4	8.8
30°-40°	994.6	10.2
40°-50°	993.4	10.2
50°-60°	866.2	8.9
60°-70°	640.3	6.6
70°-80°	362.3	3.7
80°-90°	99.9	1.0
90°-100°	92.2	0.9
100°-110°	293.0	3.0
110°-120°	501.5	5.1
120°-130°	659.5	6.8
130°-140°	740.3	7.6
140°-150°	725.9	7.4
150°-160°	609.0	6.2
160°-170°	403.9	4.1
170°-180°	141.2	1.4
0°-30°	1646.2	16.9
0°-40°	2640.9	27.0
0°-60°	4500.5	46.1
0°-90°	5602.9	57.4
90°-120°	886.7	9.1
90°-150°	3012.5	30.8
90°-180°	4167.0	42.7
0°-180°	9769.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	16	44	41	43	9
95°	66	78	80	80	78	73
105°	270	274	277	279	279	285
115°	503	510	508	507	503	498
125°	732	743	740	736	734	654
135°	947	961	963	962	958	732
145°	1149	1158	1166	1167	1162	718
155°	1314	1318	1322	1328	1324	605
165°	1430	1428	1428	1438	1431	403
175°	1488	1484	1482	1490	1483	141
180°	1490	1490	1490	1490	1490	

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	1.3	16.2	44.0	41.4	42.7
92.5°	27.9	37.7	39.1	40.4	40.4
95°	65.6	78.2	80.4	80.4	78.2
97.5°	109.1	120.8	125.8	125.8	125.8
100°	159.5	169.8	173.4	173.4	172.1
102.5°	212.5	220.2	225.1	226.5	225.1
105°	270.5	274.1	276.8	279.0	279.0
107.5°	328.0	333.4	333.4	334.3	328.0
110°	383.7	391.0	391.0	391.0	387.3

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.9	451.6	450.3	446.7	443.9
115°	503.2	510.5	508.2	506.9	503.2
117.5°	562.1	572.0	565.7	562.1	558.6
120°	621.4	631.3	621.4	621.4	617.4
122.5°	675.3	688.0	681.6	678.1	675.3
125°	732.0	743.2	739.6	735.6	734.2
127.5°	787.2	801.2	796.3	790.8	787.2
130°	839.0	855.1	852.8	850.2	845.2
132.5°	896.9	909.5	910.4	904.1	900.5
135°	946.8	960.6	963.4	962.1	958.5
137.5°	1002.5	1013.7	1016.0	1015.0	1009.7
140°	1051.4	1062.7	1068.9	1068.9	1064.0
142.5°	1101.7	1113.0	1116.6	1117.9	1113.0
145°	1149.4	1158.4	1165.5	1167.0	1162.0
147.5°	1192.1	1203.3	1208.7	1211.0	1206.0
150°	1236.1	1243.8	1248.7	1252.7	1248.7
152.5°	1275.3	1282.9	1289.1	1294.1	1289.1
155°	1314.3	1317.9	1321.9	1328.2	1324.2
157.5°	1348.0	1350.7	1352.9	1362.0	1355.7
160°	1378.1	1380.8	1382.1	1389.8	1384.4
162.5°	1406.0	1406.0	1407.3	1415.9	1409.6
165°	1429.8	1428.4	1428.4	1437.5	1431.2
167.5°	1451.3	1447.3	1447.3	1456.3	1450.0
170°	1467.5	1464.0	1462.6	1471.6	1464.0
172.5°	1478.8	1475.2	1473.9	1482.8	1475.2
175°	1487.8	1484.1	1481.5	1490.4	1482.8
177.5°	1492.7	1489.1	1486.4	1494.0	1486.4
180°	1490.4	1490.4	1490.4	1490.4	1490.4

TEST NUMBER: P902598

CATALOG NUMBER: DFN2DIP-HX3F0-060D050US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.13	12.06	12.02	12.97	14.14	10.70	11.63	11.59	12.55	13.71
	3H	12.79	13.62	13.69	14.55	15.73	12.32	13.16	13.22	14.08	15.26
	4H	13.37	14.16	14.29	15.09	16.29	12.91	13.70	13.82	14.62	15.82
	6H	13.77	14.50	14.70	15.43	16.64	13.30	14.03	14.23	14.96	16.17
	8H	13.88	14.57	14.81	15.52	16.73	13.41	14.10	14.34	15.05	16.26
	12H	13.92	14.58	14.87	15.53	16.76	13.45	14.11	14.39	15.05	16.29
4H	2H	11.60	12.39	12.52	13.32	14.51	11.26	12.05	12.18	12.97	14.17
	3H	13.46	14.12	14.40	15.08	16.29	13.07	13.73	14.01	14.69	15.90
	4H	14.17	14.77	15.12	15.73	16.96	13.77	14.37	14.72	15.32	16.56
	6H	14.68	15.20	15.64	16.18	17.42	14.28	14.80	15.24	15.77	17.01
	8H	14.83	15.32	15.79	16.29	17.54	14.42	14.91	15.38	15.88	17.13
	12H	14.90	15.34	15.88	16.33	17.58	14.49	14.93	15.47	15.91	17.17
8H	4H	14.37	14.86	15.33	15.83	17.08	14.01	14.50	14.97	15.47	16.72
	6H	15.00	15.40	15.98	16.41	17.66	14.64	15.04	15.62	16.05	17.30
	8H	15.21	15.57	16.21	16.57	17.83	14.85	15.20	15.84	16.20	17.47
	12H	15.34	15.65	16.34	16.65	17.96	14.96	15.28	15.96	16.27	17.58
12H	4H	14.36	14.80	15.34	15.78	17.04	14.01	14.45	14.99	15.43	16.69
	6H	15.03	15.38	16.02	16.38	17.65	14.68	15.03	15.67	16.03	17.30
	8H	15.26	15.58	16.26	16.57	17.88	14.91	15.22	15.91	16.22	17.53

END OF REPORT