

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902609

Luminaire Tested: DFN2DIP-HX3F0-060D070US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902609
REPORT IS A COMBINATION OF REPORTS P900784 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D070US830-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11338.7 lumens
Efficiency: N/A
Efficacy: 103.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLLONL

Luminous Intensity Polar Plot

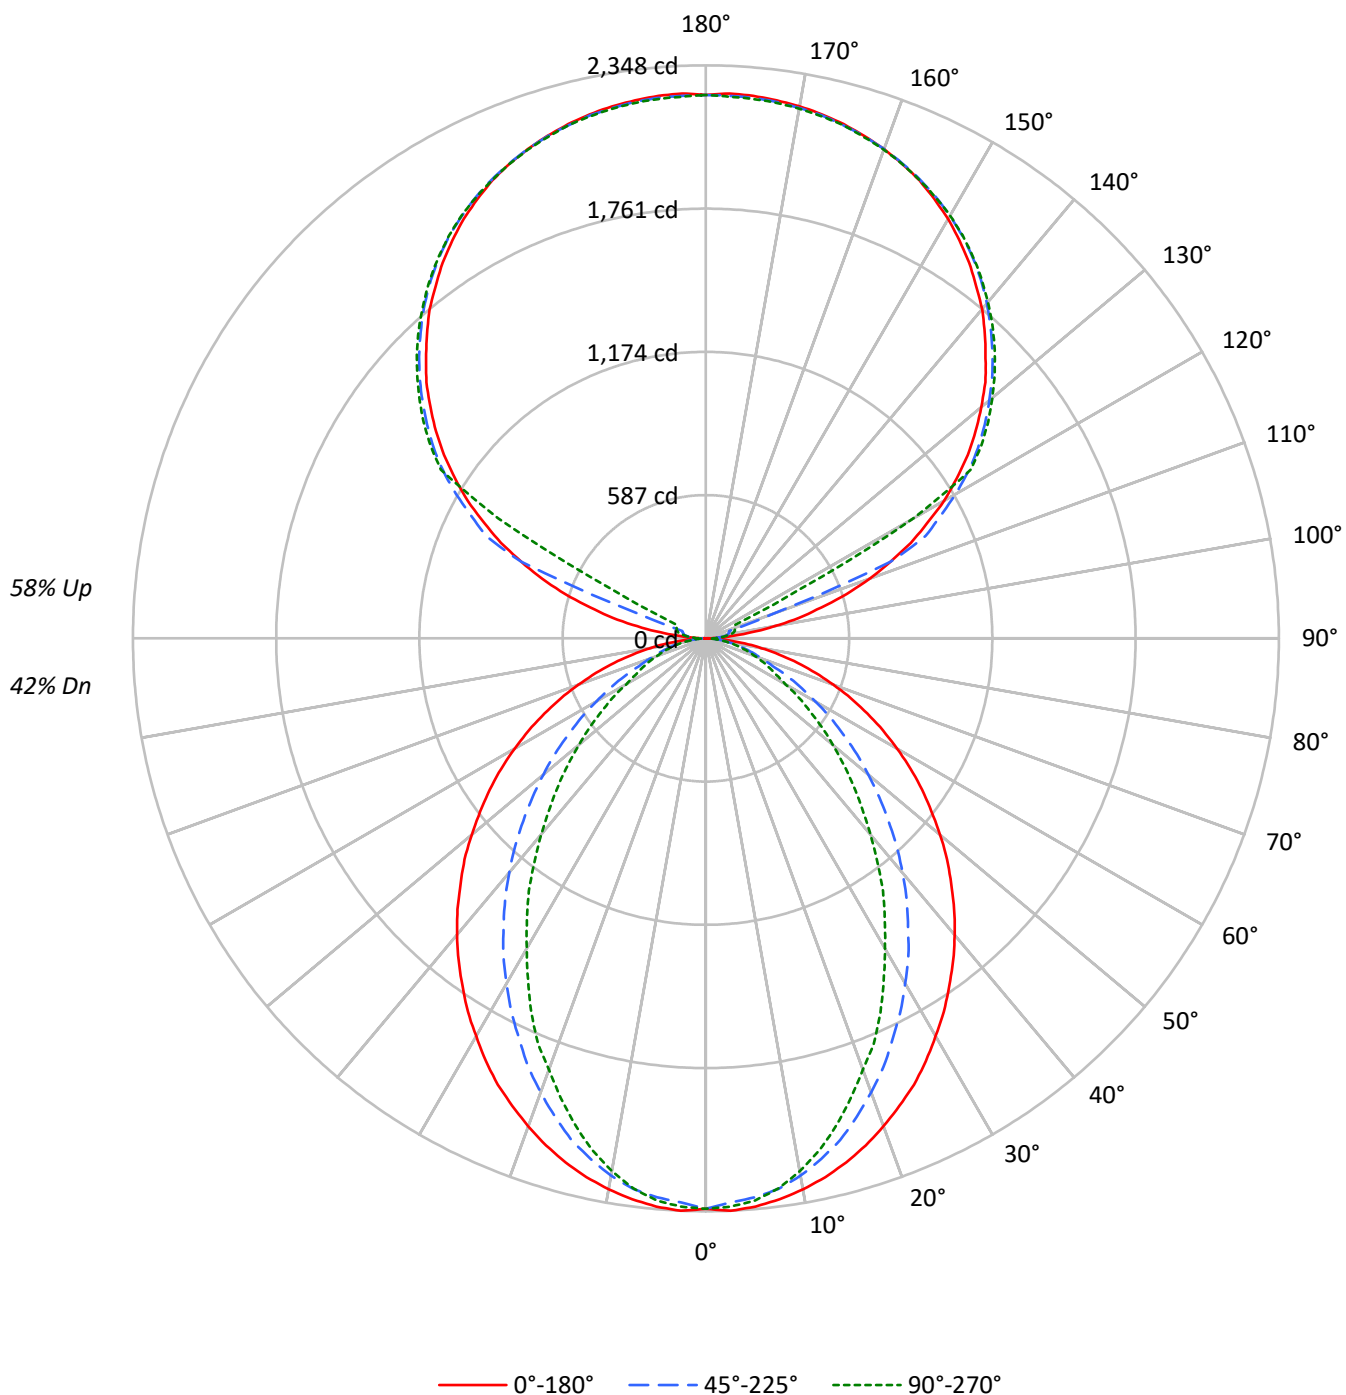

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	89	85	88	85	81	79	70	68	66	56	55	54	44	43	42
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	81	72	65	59	74	66	60	55	55	50	47	45	42	39	35	33	31
4	74	64	56	50	67	59	52	47	49	44	40	40	36	34	32	29	27
5	68	57	49	43	62	52	46	40	44	39	35	36	32	29	29	26	24
6	63	51	43	38	57	47	40	35	40	34	31	33	29	26	26	23	21
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	27	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	21	18	16
10	47	35	28	24	43	33	26	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2707	2707	2707
5°	2711	2663	2680
10°	2682	2609	2591
15°	2644	2520	2455
20°	2594	2400	2289
25°	2543	2265	2128
30°	2474	2127	1924
35°	2407	1979	1745
40°	2339	1825	1541
45°	2259	1656	1355
50°	2178	1484	1174
55°	2092	1302	1001
60°	1992	1111	822
65°	1877	917	738
70°	1738	736	666
75°	1564	645	603
80°	1311	535	518
85°	896	349	381

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2259 cd/sqm

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	1.9
10°-20°	601.3	5.3
20°-30°	844.3	7.4
30°-40°	920.3	8.1
40°-50°	845.9	7.5
50°-60°	664.3	5.9
60°-70°	432.4	3.8
70°-80°	222.6	2.0
80°-90°	60.7	0.5
90°-100°	73.4	0.6
100°-110°	273.7	2.4
110°-120°	725.9	6.4
120°-130°	1204.0	10.6
130°-140°	1278.9	11.3
140°-150°	1188.6	10.5
150°-160°	955.6	8.4
160°-170°	615.8	5.4
170°-180°	211.9	1.9
0°-30°	1664.7	14.7
0°-40°	2585.0	22.8
0°-60°	4095.1	36.1
0°-90°	4810.9	42.4
90°-120°	1073.0	9.5
90°-150°	4744.6	41.8
90°-180°	6528.0	57.6
0°-180°	11338.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	2	19	32	40	44	11
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P902609

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.81	10.59	10.84	11.61	12.99	5.79	6.56	6.82	7.59	8.97
	3H	11.48	12.17	12.51	13.21	14.61	6.97	7.66	8.01	8.70	10.10
	4H	12.08	12.73	13.13	13.77	15.18	7.41	8.07	8.46	9.11	10.51
	6H	12.49	13.09	13.55	14.14	15.55	7.73	8.33	8.79	9.37	10.79
	8H	12.61	13.18	13.68	14.25	15.66	7.82	8.39	8.88	9.45	10.86
	12H	12.67	13.21	13.74	14.27	15.70	7.85	8.40	8.92	9.45	10.89
4H	2H	9.82	10.48	10.88	11.52	12.92	6.37	7.03	7.43	8.07	9.47
	3H	11.64	12.18	12.70	13.25	14.67	7.71	8.26	8.78	9.33	10.74
	4H	12.32	12.82	13.39	13.88	15.32	8.26	8.75	9.32	9.81	11.25
	6H	12.83	13.25	13.90	14.34	15.77	8.67	9.09	9.74	10.18	11.61
	8H	13.00	13.40	14.07	14.47	15.92	8.79	9.19	9.87	10.27	11.71
	12H	13.08	13.44	14.18	14.53	15.99	8.85	9.21	9.95	10.30	11.76
8H	4H	12.28	12.68	13.36	13.76	15.21	8.53	8.92	9.60	10.00	11.45
	6H	12.84	13.17	13.94	14.29	15.73	9.04	9.36	10.14	10.48	11.93
	8H	13.05	13.34	14.16	14.44	15.91	9.22	9.51	10.33	10.61	12.08
	12H	13.18	13.44	14.29	14.53	16.04	9.34	9.59	10.45	10.68	12.19
12H	4H	12.23	12.59	13.33	13.68	15.14	8.53	8.89	9.62	9.98	11.43
	6H	12.82	13.10	13.92	14.20	15.67	9.08	9.37	10.19	10.47	11.94
	8H	13.03	13.28	14.14	14.38	15.88	9.29	9.54	10.40	10.64	12.14

END OF REPORT