

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902665

Luminaire Tested: DFN2DIP-HX3F0-090D030US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902665
REPORT IS A COMBINATION OF REPORTS P900734 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D030US830-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10009.8 lumens
Efficiency: N/A
Efficacy: 86.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 115.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLLONL

Luminous Intensity Polar Plot

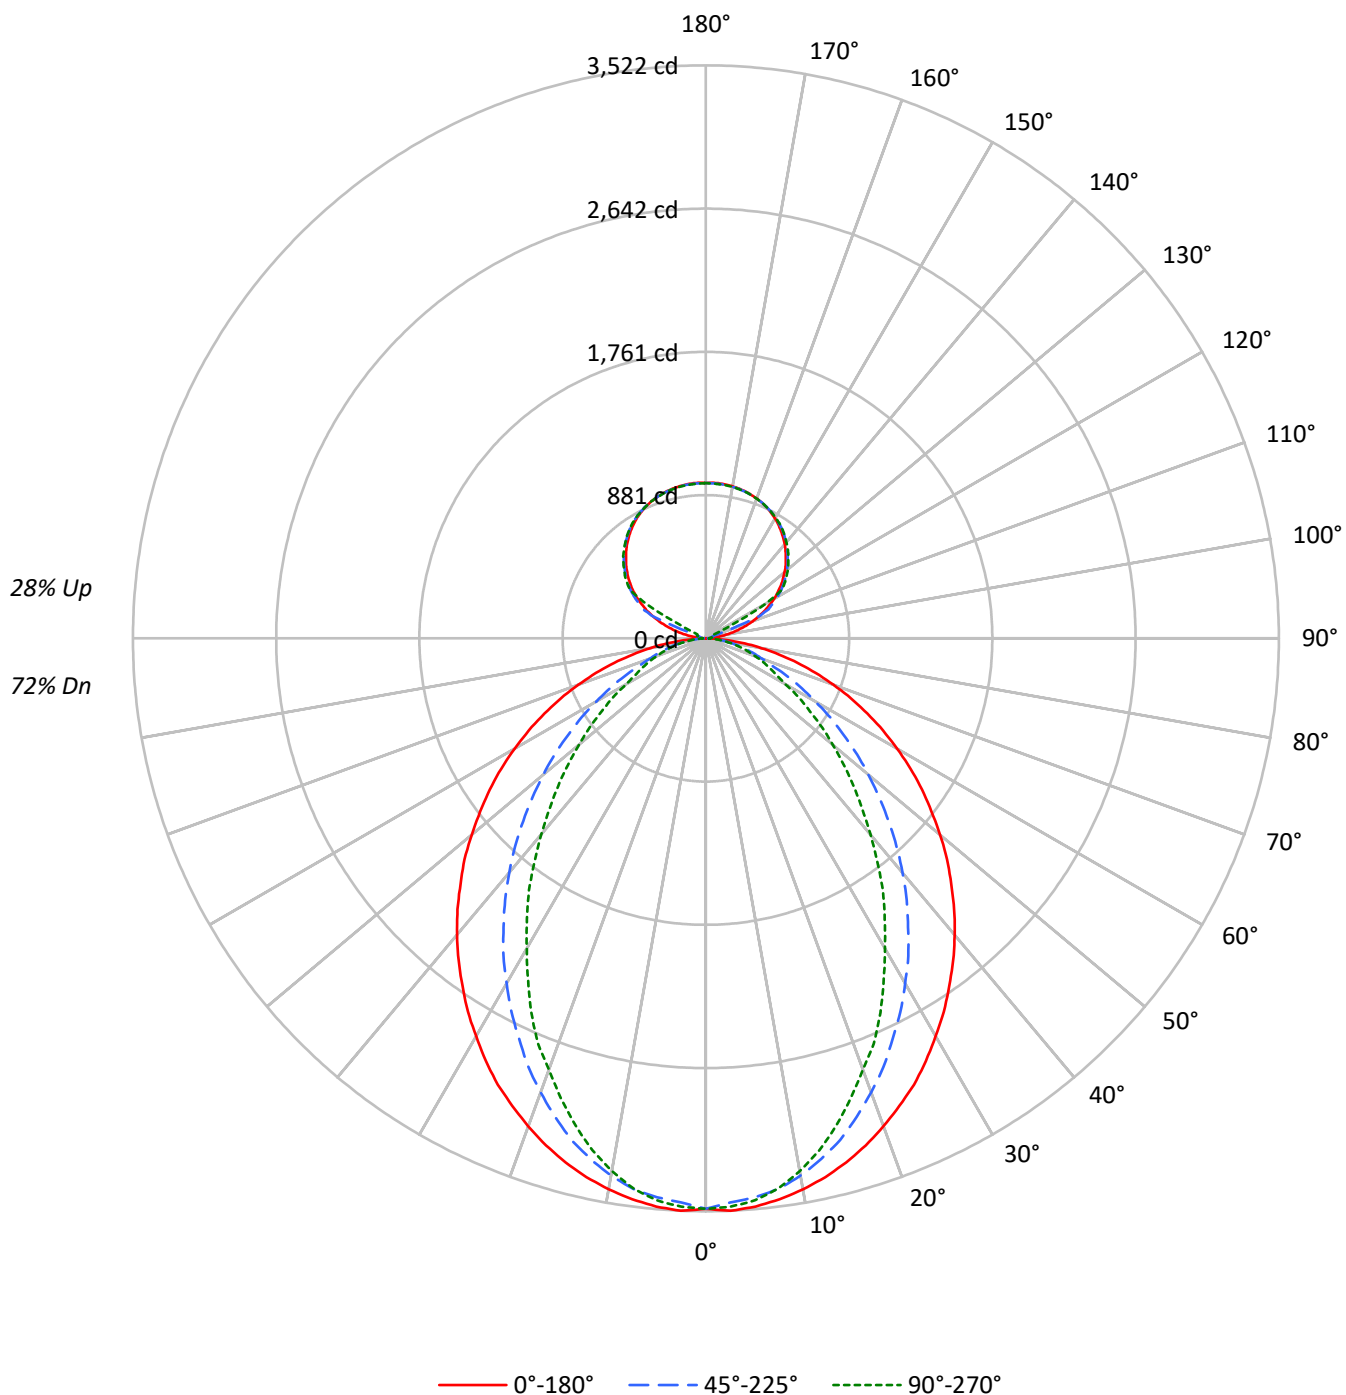

TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	107	107	107	107	96	96	96	86	86	86	76	76	76
1	103	99	95	92	98	94	91	88	85	82	80	76	75	73	69	67	66
2	95	87	81	76	90	83	78	73	75	71	68	68	65	62	61	59	57
3	87	78	70	65	82	74	67	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	54	60	54	50	55	50	46	50	46	43
5	74	62	54	48	70	59	52	47	54	48	44	50	45	41	45	41	38
6	68	56	48	42	65	54	46	41	49	43	39	45	40	36	41	37	34
7	63	51	43	38	60	49	42	36	45	39	34	41	36	32	38	34	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	27
9	55	43	35	30	52	41	34	30	38	32	28	35	30	26	32	28	25
10	52	40	32	28	49	38	31	27	35	29	25	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4061	4061	4061
5°	4066	3994	4020
10°	4024	3913	3887
15°	3966	3781	3683
20°	3891	3600	3433
25°	3815	3397	3192
30°	3712	3190	2886
35°	3611	2968	2618
40°	3508	2738	2311
45°	3389	2483	2033
50°	3266	2227	1762
55°	3137	1952	1501
60°	2988	1667	1233
65°	2816	1376	1107
70°	2608	1105	999
75°	2345	968	904
80°	1966	803	777
85°	1343	522	570

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3389 cd/sqm

TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.6	3.3
10°-20°	902.0	9.0
20°-30°	1266.4	12.7
30°-40°	1380.5	13.8
40°-50°	1268.8	12.7
50°-60°	996.5	10.0
60°-70°	648.6	6.5
70°-80°	333.9	3.3
80°-90°	86.9	0.9
90°-100°	31.5	0.3
100°-110°	117.3	1.2
110°-120°	311.1	3.1
120°-130°	516.0	5.2
130°-140°	548.1	5.5
140°-150°	509.4	5.1
150°-160°	409.6	4.1
160°-170°	263.9	2.6
170°-180°	90.8	0.9
0°-30°	2497.0	24.9
0°-40°	3877.5	38.7
0°-60°	6142.8	61.4
0°-90°	7212.1	72.1
90°-120°	459.9	4.6
90°-150°	2033.4	20.3
90°-180°	2798.0	28.0
0°-180°	10009.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3506	3506	3506	3506	3506	
5°	3506	3490	3449	3477	3468	332
15°	3335	3300	3192	3132	3100	940
25°	3027	2925	2716	2586	2538	1392
35°	2608	2446	2167	1967	1897	1632
45°	2132	1920	1586	1361	1285	1647
55°	1621	1374	1031	841	781	1449
65°	1095	838	552	444	435	1085
75°	584	362	254	232	229	617
85°	136	70	60	60	60	156
90°	1	8	14	17	19	10
95°	45	22	27	30	30	53
105°	210	231	42	50	52	224
115°	397	409	426	106	57	391
125°	561	570	584	588	590	501
135°	695	706	712	719	718	537
145°	806	805	817	822	818	504
155°	887	881	889	894	888	409
165°	935	931	933	938	933	264
175°	956	952	953	958	951	91
180°	954	954	954	954	954	

TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3506.0	3506.0	3506.0	3506.0	3506.0
2.5°	3521.8	3506.0	3470.9	3503.0	3496.5
5°	3506.0	3490.1	3448.8	3477.3	3467.9
7.5°	3477.3	3458.5	3414.1	3426.5	3410.7
10°	3439.3	3417.1	3353.8	3344.0	3325.2
12.5°	3391.8	3363.3	3277.4	3258.6	3223.5
15°	3334.6	3299.7	3191.9	3131.6	3100.0
17.5°	3268.0	3217.2	3083.8	3014.2	2963.4
20°	3191.9	3128.3	2969.7	2890.6	2820.6
22.5°	3109.4	3036.4	2852.2	2744.5	2697.1
25°	3027.0	2925.3	2715.9	2586.0	2538.2
27.5°	2928.7	2820.6	2589.0	2439.9	2366.8
30°	2824.0	2703.1	2449.3	2287.7	2201.9
32.5°	2722.3	2576.2	2316.3	2125.8	2046.4
35°	2608.2	2446.3	2167.2	1967.3	1897.2
37.5°	2497.1	2322.4	2027.5	1808.4	1729.3
40°	2379.6	2189.4	1881.4	1656.2	1573.8
42.5°	2259.1	2056.2	1735.6	1500.7	1421.5
45°	2132.2	1919.5	1586.5	1360.9	1284.9
47.5°	2011.7	1786.5	1443.8	1218.2	1148.6
50°	1878.4	1653.1	1304.1	1085.0	1018.6
52.5°	1748.1	1510.1	1170.8	961.4	901.2
55°	1621.2	1373.8	1031.0	840.9	780.6
57.5°	1491.3	1237.5	907.6	729.8	679.0
60°	1357.9	1104.1	777.3	615.7	564.9
62.5°	1228.0	974.2	666.2	514.1	488.8
65°	1094.7	837.5	552.0	444.3	434.6
67.5°	967.8	710.6	444.3	390.1	380.7
70°	834.5	587.1	368.0	336.3	323.5
72.5°	707.6	472.6	307.6	282.4	276.1
75°	583.7	361.6	253.8	231.6	228.6
77.5°	460.1	256.8	199.9	187.2	180.8
80°	345.7	184.2	152.1	139.7	139.7
82.5°	241.0	123.9	104.7	98.3	98.3
85°	136.3	69.7	60.2	60.2	60.2
87.5°	50.8	25.3	25.3	22.2	22.2
90°	0.7	8.3	13.8	17.3	18.6
92.5°	17.3	14.5	16.6	18.0	18.6
95°	44.9	22.1	26.9	30.4	29.7
97.5°	80.8	24.2	35.2	37.3	38.0
100°	122.2	27.6	39.4	44.9	46.3
102.5°	167.8	166.5	40.7	48.3	50.4
105°	209.9	230.6	42.1	49.7	52.5
107.5°	258.9	276.2	43.5	51.1	53.9
110°	305.9	320.4	120.8	51.8	54.6

TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	350.2	362.5	350.8	53.2	55.2
115°	397.0	408.8	426.0	106.3	56.6
117.5°	437.8	451.6	463.4	364.6	183.7
120°	483.3	493.7	506.1	514.4	421.2
122.5°	522.0	533.1	547.0	551.0	551.8
125°	561.4	570.3	583.5	588.3	590.4
127.5°	597.3	606.9	617.4	624.2	624.9
130°	631.1	642.2	649.8	657.3	656.8
132.5°	665.6	674.7	682.2	688.4	687.8
135°	694.7	705.8	711.9	718.9	717.5
137.5°	725.0	733.3	740.3	747.2	745.1
140°	754.7	760.3	767.8	774.0	770.6
142.5°	779.7	784.5	793.4	798.9	795.5
145°	805.9	805.1	816.9	821.7	818.2
147.5°	828.6	826.5	838.3	841.7	839.0
150°	850.7	845.9	857.0	861.0	857.6
152.5°	869.3	863.8	874.2	878.4	873.5
155°	887.3	881.2	889.4	893.5	888.1
157.5°	901.8	896.4	902.6	907.4	901.8
160°	914.3	910.1	914.3	918.4	913.5
162.5°	925.3	921.1	924.6	929.4	923.2
165°	934.9	930.9	932.9	937.7	932.9
167.5°	942.5	938.4	940.5	945.4	939.1
170°	948.8	944.6	946.0	950.8	944.6
172.5°	952.9	948.8	950.2	955.0	948.8
175°	956.3	951.5	952.9	957.7	950.8
177.5°	957.7	952.9	953.7	958.5	952.3
180°	954.3	954.3	954.3	954.3	954.3



TEST NUMBER: P902665

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.82	14.87	14.57	15.64	16.56	9.80	10.85	10.55	11.61	12.53
	3H	15.51	16.45	16.27	17.23	18.18	11.00	11.94	11.76	12.72	13.67
	4H	16.12	17.01	16.90	17.79	18.76	11.46	12.34	12.24	13.13	14.09
	6H	16.55	17.37	17.34	18.16	19.13	11.79	12.60	12.58	13.39	14.37
	8H	16.68	17.45	17.48	18.27	19.24	11.88	12.66	12.68	13.47	14.45
	12H	16.74	17.48	17.55	18.29	19.29	11.93	12.67	12.74	13.47	14.48
4H	2H	13.87	14.75	14.65	15.54	16.50	10.42	11.30	11.20	12.09	13.05
	3H	15.71	16.44	16.50	17.26	18.24	11.78	12.52	12.58	13.34	14.32
	4H	16.40	17.07	17.21	17.89	18.90	12.34	13.00	13.15	13.82	14.83
	6H	16.92	17.50	17.75	18.34	19.35	12.76	13.34	13.59	14.18	15.19
	8H	17.10	17.63	17.93	18.47	19.50	12.89	13.43	13.72	14.27	15.29
	12H	17.20	17.68	18.05	18.54	19.57	12.96	13.45	13.81	14.31	15.34
8H	4H	16.39	16.92	17.22	17.76	18.79	12.63	13.16	13.46	14.00	15.03
	6H	16.95	17.39	17.81	18.28	19.30	13.15	13.59	14.01	14.47	15.50
	8H	17.16	17.56	18.03	18.43	19.48	13.33	13.73	14.21	14.61	15.65
	12H	17.31	17.65	18.18	18.52	19.62	13.46	13.81	14.33	14.67	15.77
12H	4H	16.35	16.83	17.20	17.69	18.72	12.64	13.12	13.49	13.98	15.01
	6H	16.93	17.32	17.80	18.20	19.24	13.19	13.59	14.06	14.47	15.51
	8H	17.15	17.50	18.02	18.37	19.46	13.41	13.76	14.28	14.62	15.72

END OF REPORT