

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P902679

Luminaire Tested: DFN2DIP-HX3F0-090D070US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P902679
REPORT IS A COMBINATION OF REPORTS P900789 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D070US830-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14929.9 lumens
Efficiency: N/A
Efficacy: 102.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLLONL

Luminous Intensity Polar Plot

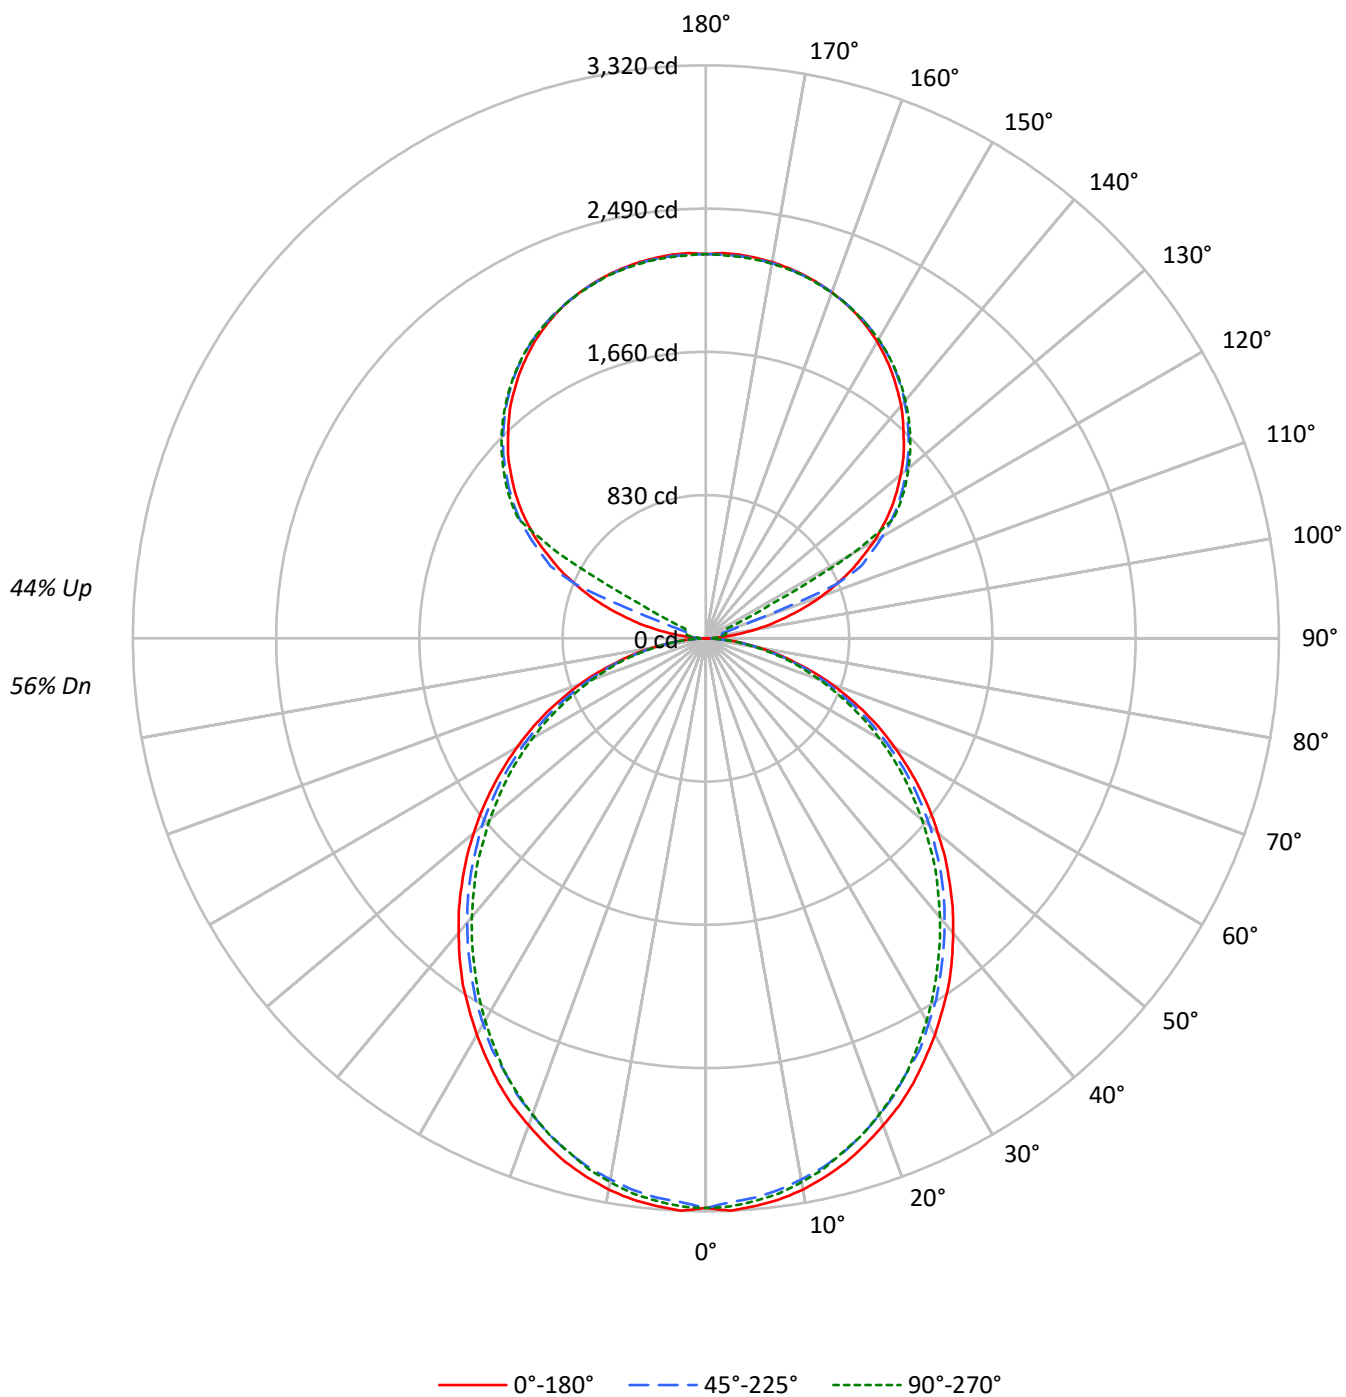

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		74	74	74		62	62	62
1	99	95	91	87		92	88	85	82		76	74	71		65	63	62		55	53	52
2	90	83	77	71		84	77	72	67		67	63	59		57	54	51		48	46	44
3	82	73	65	59		76	68	61	56		59	54	50		51	47	44		43	40	38
4	75	64	56	50		70	60	53	48		52	47	42		45	41	37		38	35	32
5	69	58	49	43		64	54	46	41		47	41	37		40	36	32		34	31	28
6	64	52	43	38		59	48	41	36		42	36	32		37	32	28		31	28	25
7	59	47	39	33		55	44	37	31		38	33	28		33	29	25		29	25	22
8	55	42	35	29		51	40	33	28		35	29	25		30	26	22		26	23	20
9	51	39	31	26		48	36	30	25		32	26	23		28	23	20		24	21	18
10	48	36	28	23		44	34	27	22		30	24	20		26	21	18		22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3823	3823	3823
5°	3828	3768	3793
10°	3795	3714	3740
15°	3738	3650	3658
20°	3660	3563	3573
25°	3584	3459	3476
30°	3488	3361	3353
35°	3397	3247	3224
40°	3285	3131	3100
45°	3174	3016	2973
50°	3052	2894	2827
55°	2924	2753	2692
60°	2779	2586	2537
65°	2621	2413	2354
70°	2420	2202	2156
75°	2142	1948	1971
80°	1805	1624	1623
85°	1281	1075	1052

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3174 cd/sqm

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	2.1
10°-20°	874.1	5.9
20°-30°	1284.6	8.6
30°-40°	1492.0	10.0
40°-50°	1490.1	10.0
50°-60°	1299.3	8.7
60°-70°	960.5	6.4
70°-80°	543.4	3.6
80°-90°	147.3	1.0
90°-100°	73.4	0.5
100°-110°	273.7	1.8
110°-120°	725.9	4.9
120°-130°	1204.0	8.1
130°-140°	1278.9	8.6
140°-150°	1188.6	8.0
150°-160°	955.6	6.4
160°-170°	615.8	4.1
170°-180°	211.9	1.4
0°-30°	2469.3	16.5
0°-40°	3961.3	26.5
0°-60°	6750.7	45.2
0°-90°	8402.0	56.3
90°-120°	1073.0	7.2
90°-150°	4744.6	31.8
90°-180°	6528.0	43.7
0°-180°	14929.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	2	19	32	40	44	14
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P902679

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.45	13.37	13.35	14.29	15.47	12.02	12.94	12.92	13.86	15.04
	3H	14.11	14.93	15.02	15.86	17.07	13.64	14.46	14.55	15.39	16.60
	4H	14.69	15.47	15.62	16.41	17.62	14.22	15.00	15.15	15.94	17.15
	6H	15.09	15.81	16.03	16.75	17.97	14.62	15.34	15.56	16.28	17.51
	8H	15.19	15.88	16.14	16.84	18.06	14.72	15.41	15.67	16.37	17.59
	12H	15.24	15.89	16.19	16.84	18.09	14.76	15.42	15.72	16.37	17.62
4H	2H	12.91	13.70	13.85	14.63	15.84	12.57	13.35	13.51	14.29	15.50
	3H	14.78	15.43	15.72	16.39	17.62	14.39	15.04	15.33	16.01	17.23
	4H	15.49	16.08	16.44	17.04	18.30	15.09	15.68	16.04	16.64	17.89
	6H	16.00	16.51	16.97	17.50	18.75	15.59	16.11	16.56	17.09	18.34
	8H	16.15	16.63	17.11	17.60	18.87	15.74	16.22	16.71	17.20	18.46
	12H	16.22	16.65	17.21	17.65	18.92	15.80	16.24	16.79	17.23	18.50
8H	4H	15.69	16.17	16.65	17.14	18.41	15.33	15.81	16.30	16.79	18.05
	6H	16.31	16.71	17.30	17.73	18.99	15.95	16.35	16.95	17.37	18.63
	8H	16.53	16.88	17.53	17.88	19.17	16.16	16.51	17.17	17.52	18.80
	12H	16.66	16.96	17.66	17.97	19.29	16.28	16.58	17.28	17.59	18.91
12H	4H	15.67	16.11	16.66	17.10	18.37	15.32	15.76	16.31	16.75	18.02
	6H	16.34	16.69	17.34	17.70	18.98	15.99	16.34	16.99	17.35	18.63
	8H	16.58	16.89	17.58	17.89	19.22	16.22	16.53	17.23	17.53	18.86

END OF REPORT