

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905347

Luminaire Tested: DFN2DIP-HX3F0-070D040US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905347
REPORT IS A COMBINATION OF REPORTS P900743 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D040US835-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10890.0 lumens
Efficiency: N/A
Efficacy: 110.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 98.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

Luminous Intensity Polar Plot

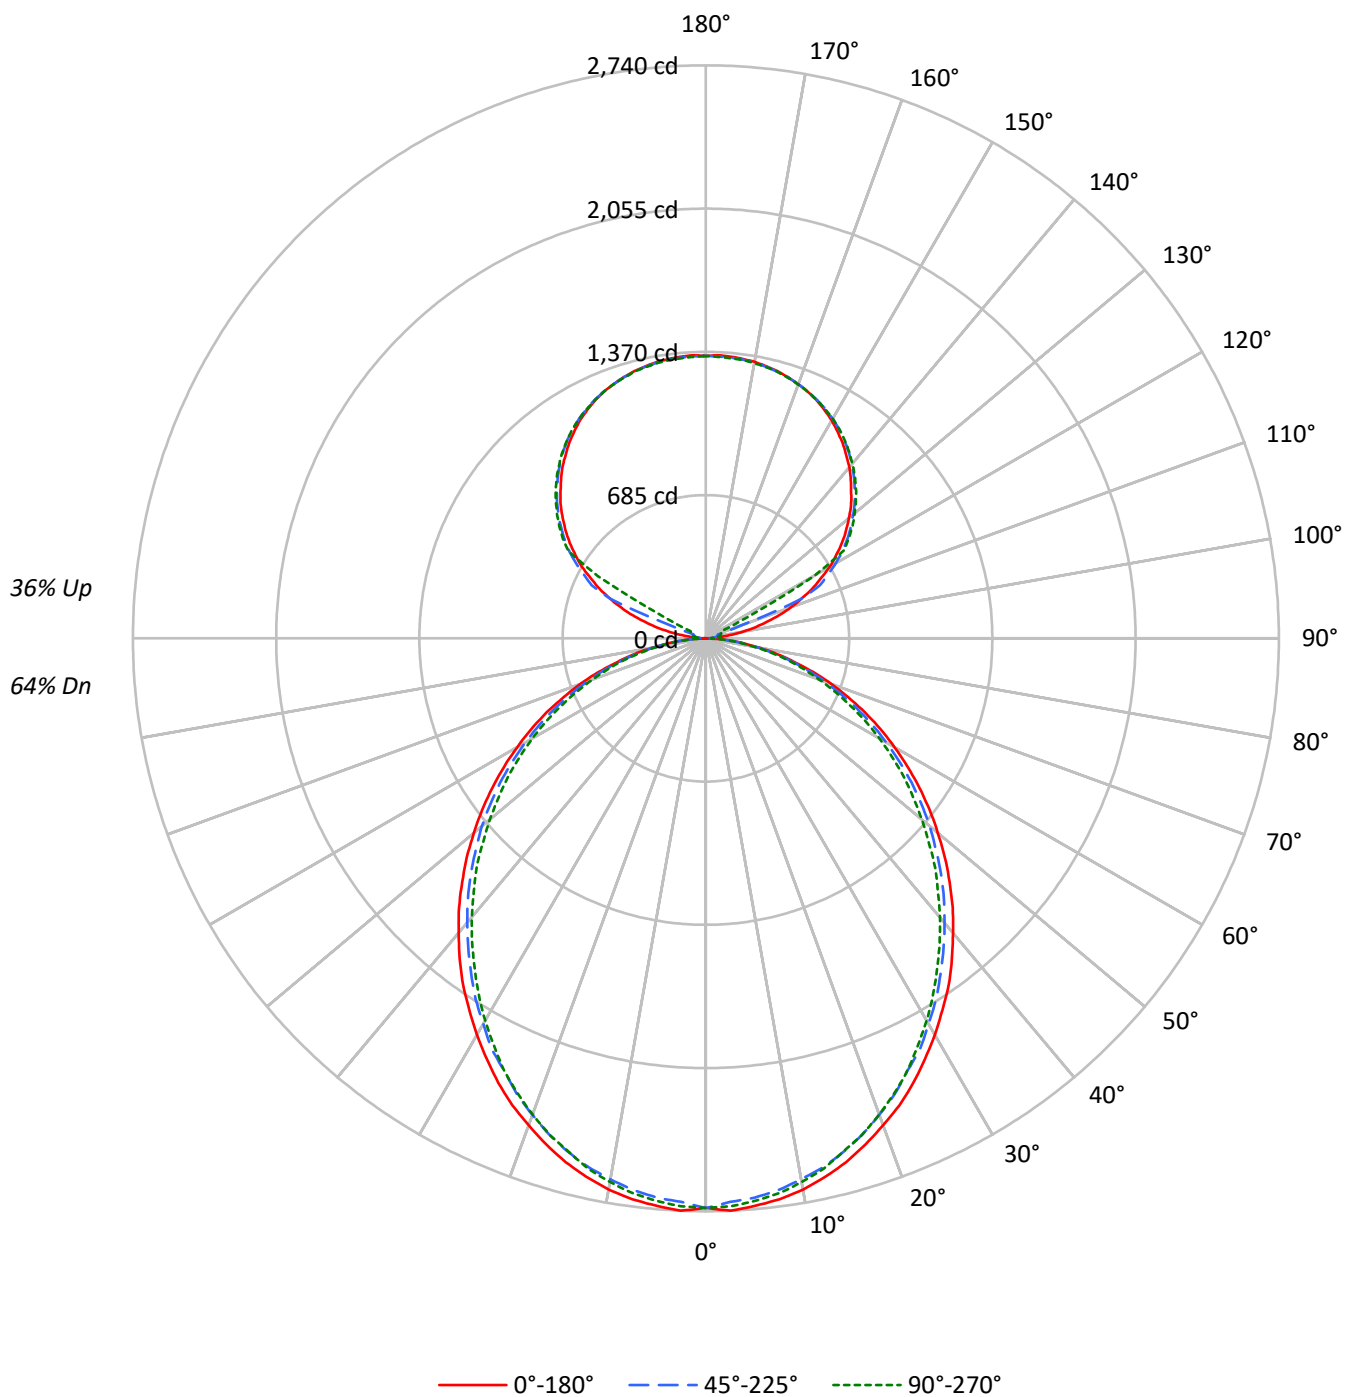

TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91		79	79	79		69
1	101	96	92	89	94	91	87	84	80	77	75		70	68	66		61
2	92	84	78	73	86	79	74	69	70	66	62		61	58	55		53
3	84	74	67	61	78	70	63	58	62	57	52		54	50	47		47
4	77	66	58	51	72	62	55	49	55	49	45		48	44	40		42
5	71	59	50	44	66	55	48	42	49	43	39		44	39	35		38
6	65	53	44	38	61	50	42	37	44	38	34		39	34	31		35
7	60	48	39	34	56	45	38	32	40	34	30		36	31	27		32
8	56	43	35	30	52	41	34	29	37	31	27		33	28	24		29
9	52	40	32	27	49	38	31	26	34	28	24		30	25	22		27
10	49	36	29	24	46	35	28	23	31	26	22		28	23	20		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3155	3155	3155
5°	3159	3109	3130
10°	3132	3065	3086
15°	3084	3012	3018
20°	3020	2940	2949
25°	2957	2854	2869
30°	2878	2774	2767
35°	2803	2679	2660
40°	2711	2584	2558
45°	2619	2488	2453
50°	2518	2388	2333
55°	2413	2272	2221
60°	2293	2134	2093
65°	2163	1991	1942
70°	1997	1817	1779
75°	1767	1607	1627
80°	1490	1341	1339
85°	1057	888	869

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2619 cd/sqm

TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	2.4
10°-20°	721.3	6.6
20°-30°	1060.0	9.7
30°-40°	1231.1	11.3
40°-50°	1229.6	11.3
50°-60°	1072.2	9.8
60°-70°	792.6	7.3
70°-80°	448.4	4.1
80°-90°	120.7	1.1
90°-100°	44.5	0.4
100°-110°	165.9	1.5
110°-120°	440.1	4.0
120°-130°	729.9	6.7
130°-140°	775.4	7.1
140°-150°	720.6	6.6
150°-160°	579.4	5.3
160°-170°	373.3	3.4
170°-180°	128.5	1.2
0°-30°	2037.7	18.7
0°-40°	3268.8	30.0
0°-60°	5570.6	51.2
0°-90°	6932.4	63.7
90°-120°	650.5	6.0
90°-150°	2876.4	26.4
90°-180°	3958.0	36.3
0°-180°	10890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	1	12	20	24	26	10
95°	63	31	38	43	42	75
105°	297	326	60	70	74	317
115°	562	578	603	150	80	553
125°	794	807	825	832	835	708
135°	983	998	1007	1017	1015	759
145°	1140	1139	1156	1162	1158	713
155°	1255	1246	1258	1264	1256	578
165°	1323	1317	1320	1326	1320	374
175°	1353	1346	1348	1355	1345	129
180°	1350	1350	1350	1350	1350	

TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	0.9	11.7	19.5	24.5	26.3
92.5°	24.5	20.5	23.4	25.4	26.3
95°	63.4	31.2	38.0	43.0	42.0
97.5°	114.3	34.2	49.8	52.8	53.7
100°	172.9	39.1	55.7	63.4	65.4
102.5°	237.3	235.5	57.6	68.3	71.3
105°	296.9	326.3	59.6	70.3	74.2
107.5°	366.3	390.7	61.6	72.3	76.2
110°	432.8	453.2	171.0	73.3	77.1



TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	495.3	512.8	496.2	75.2	78.2
115°	561.6	578.2	602.7	150.4	80.2
117.5°	619.3	638.8	655.5	515.7	259.8
120°	683.8	698.4	716.0	727.8	595.9
122.5°	738.4	754.1	773.7	779.5	780.5
125°	794.1	806.9	825.4	832.3	835.2
127.5°	844.9	858.6	873.3	883.1	884.0
130°	892.8	908.5	919.1	929.9	929.0
132.5°	941.6	954.4	965.1	973.9	973.0
135°	982.7	998.4	1007.1	1016.9	1015.0
137.5°	1025.6	1037.3	1047.2	1056.9	1054.0
140°	1067.6	1075.5	1086.2	1095.0	1090.1
142.5°	1102.9	1109.7	1122.4	1130.1	1125.3
145°	1140.0	1139.0	1155.5	1162.4	1157.5
147.5°	1172.1	1169.2	1185.8	1190.7	1186.9
150°	1203.4	1196.6	1212.3	1218.1	1213.2
152.5°	1229.8	1222.0	1236.6	1242.5	1235.7
155°	1255.2	1246.5	1258.2	1264.0	1256.2
157.5°	1275.7	1267.9	1276.8	1283.6	1275.7
160°	1293.3	1287.4	1293.3	1299.1	1292.3
162.5°	1308.9	1303.1	1308.0	1314.8	1306.0
165°	1322.6	1316.8	1319.7	1326.5	1319.7
167.5°	1333.4	1327.4	1330.5	1337.3	1328.5
170°	1342.2	1336.3	1338.2	1345.1	1336.3
172.5°	1348.0	1342.2	1344.2	1351.0	1342.2
175°	1352.8	1346.0	1348.0	1354.8	1345.1
177.5°	1354.8	1348.0	1349.0	1355.9	1347.1
180°	1350.0	1350.0	1350.0	1350.0	1350.0

TEST NUMBER: P905347

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.39	13.39	13.22	14.25	15.31	11.96	12.96	12.79	13.82	14.88
	3H	14.06	14.95	14.90	15.82	16.91	13.59	14.48	14.43	15.35	16.44
	4H	14.65	15.49	15.50	16.36	17.46	14.18	15.02	15.04	15.89	16.99
	6H	15.05	15.83	15.92	16.70	17.82	14.58	15.36	15.45	16.23	17.35
	8H	15.15	15.90	16.03	16.79	17.90	14.68	15.43	15.56	16.32	17.43
	12H	15.20	15.91	16.09	16.80	17.94	14.73	15.44	15.61	16.32	17.46
4H	2H	12.87	13.72	13.73	14.59	15.69	12.53	13.37	13.39	14.24	15.34
	3H	14.74	15.45	15.61	16.35	17.46	14.35	15.06	15.22	15.96	17.07
	4H	15.45	16.10	16.34	17.00	18.14	15.05	15.70	15.94	16.59	17.73
	6H	15.97	16.53	16.87	17.45	18.59	15.56	16.12	16.47	17.04	18.19
	8H	16.12	16.64	17.02	17.55	18.71	15.71	16.23	16.61	17.15	18.30
	12H	16.19	16.66	17.12	17.60	18.76	15.78	16.25	16.70	17.18	18.34
8H	4H	15.66	16.18	16.56	17.09	18.25	15.30	15.82	16.20	16.74	17.89
	6H	16.28	16.72	17.22	17.67	18.83	15.93	16.36	16.86	17.31	18.47
	8H	16.50	16.88	17.44	17.83	19.01	16.14	16.52	17.08	17.47	18.64
	12H	16.63	16.97	17.58	17.91	19.14	16.25	16.59	17.20	17.53	18.76
12H	4H	15.65	16.12	16.57	17.05	18.22	15.30	15.77	16.22	16.70	17.87
	6H	16.31	16.70	17.26	17.65	18.82	15.97	16.35	16.91	17.30	18.47
	8H	16.56	16.89	17.50	17.84	19.06	16.20	16.54	17.15	17.48	18.71