

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P905357

Luminaire Tested: DFN2DIP-HX3F0-070D060US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P905357
REPORT IS A COMBINATION OF REPORTS P900772 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D060US835-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11890.0 lumens
Efficiency: N/A
Efficacy: 103.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 114.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLLONL

Luminous Intensity Polar Plot

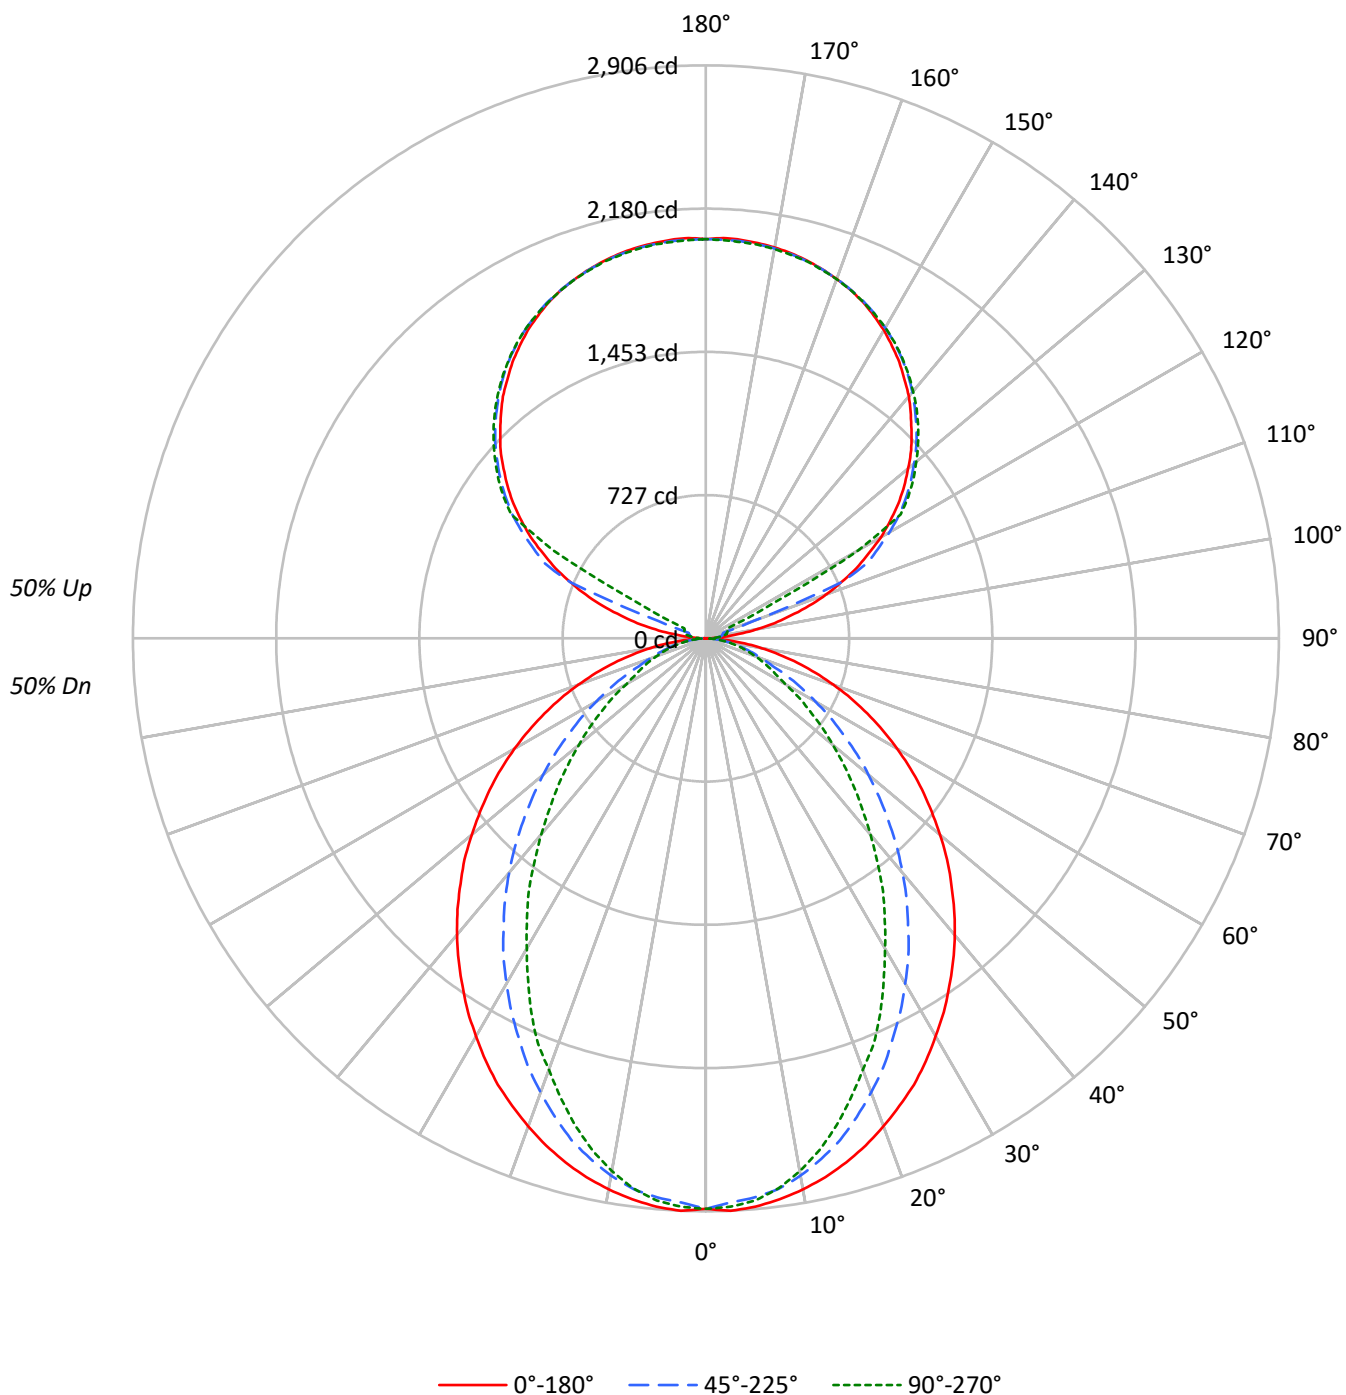

TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3351	3351	3351
5°	3355	3296	3317
10°	3320	3229	3207
15°	3273	3120	3039
20°	3211	2971	2833
25°	3148	2804	2634
30°	3063	2633	2382
35°	2980	2449	2161
40°	2895	2259	1907
45°	2797	2049	1678
50°	2695	1837	1454
55°	2589	1611	1239
60°	2466	1375	1018
65°	2324	1135	914
70°	2152	912	824
75°	1935	799	746
80°	1622	663	641
85°	1108	431	471

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2797 cd/sqm

TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	271.1	2.3
10°-20°	744.3	6.3
20°-30°	1045.0	8.8
30°-40°	1139.2	9.6
40°-50°	1047.0	8.8
50°-60°	822.3	6.9
60°-70°	535.2	4.5
70°-80°	275.5	2.3
80°-90°	73.9	0.6
90°-100°	66.8	0.6
100°-110°	248.9	2.1
110°-120°	660.2	5.6
120°-130°	1094.9	9.2
130°-140°	1163.0	9.8
140°-150°	1080.9	9.1
150°-160°	869.0	7.3
160°-170°	560.0	4.7
170°-180°	192.7	1.6
0°-30°	2060.5	17.3
0°-40°	3199.7	26.9
0°-60°	5068.9	42.6
0°-90°	5953.5	50.1
90°-120°	975.8	8.2
90°-150°	4314.7	36.3
90°-180°	5936.0	49.9
0°-180°	11890.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2893	2893	2893	2893	2893	
5°	2893	2880	2846	2870	2862	274
15°	2752	2723	2634	2584	2558	775
25°	2498	2414	2241	2134	2094	1149
35°	2152	2019	1788	1623	1566	1347
45°	1760	1584	1309	1123	1060	1359
55°	1338	1134	851	694	644	1195
65°	903	691	456	367	359	896
75°	482	298	209	191	189	509
85°	112	58	50	50	50	129
90°	1	18	29	37	40	11
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	

TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2893.1	2893.1	2893.1	2893.1	2893.1
2.5°	2906.1	2893.1	2864.2	2890.6	2885.3
5°	2893.1	2880.0	2845.9	2869.5	2861.7
7.5°	2869.5	2853.9	2817.3	2827.5	2814.5
10°	2838.1	2819.8	2767.5	2759.5	2743.9
12.5°	2798.9	2775.3	2704.5	2688.9	2660.0
15°	2751.7	2722.8	2633.9	2584.2	2558.1
17.5°	2696.7	2654.8	2544.8	2487.2	2445.3
20°	2633.9	2581.4	2450.6	2385.3	2327.5
22.5°	2565.9	2505.6	2353.6	2264.7	2225.6
25°	2497.8	2413.9	2241.1	2133.9	2094.5
27.5°	2416.7	2327.5	2136.4	2013.4	1953.1
30°	2330.3	2230.6	2021.1	1887.8	1817.0
32.5°	2246.4	2125.9	1911.4	1754.2	1688.6
35°	2152.2	2018.6	1788.4	1623.4	1565.6
37.5°	2060.6	1916.4	1673.1	1492.2	1427.0
40°	1963.6	1806.7	1552.5	1366.7	1298.6
42.5°	1864.2	1696.7	1432.2	1238.3	1173.1
45°	1759.5	1583.9	1309.2	1123.1	1060.3
47.5°	1660.0	1474.2	1191.4	1005.3	947.8
50°	1550.0	1364.2	1076.1	895.3	840.6
52.5°	1442.5	1246.1	966.1	793.3	743.6
55°	1337.8	1133.6	850.8	693.9	644.2
57.5°	1230.6	1021.1	748.9	602.2	560.3
60°	1120.6	911.1	641.4	508.1	466.1
62.5°	1013.3	803.9	549.7	424.2	403.3
65°	903.3	691.1	455.6	366.7	358.6
67.5°	798.6	586.4	366.7	321.9	314.2
70°	688.6	484.4	303.6	277.5	266.9
72.5°	583.9	390.0	253.9	233.1	227.8
75°	481.7	298.3	209.4	191.1	188.6
77.5°	379.7	211.9	165.0	154.4	149.2
80°	285.3	151.9	125.6	115.3	115.3
82.5°	198.9	102.2	86.4	81.1	81.1
85°	112.5	57.5	49.7	49.7	49.7
87.5°	41.9	20.8	20.8	18.3	18.3
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7



TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9

TEST NUMBER: P905357

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.31	12.14	12.28	13.12	14.39	7.29	8.12	8.25	9.09	10.36
	3H	12.98	13.72	13.96	14.71	16.00	8.47	9.22	9.45	10.20	11.49
	4H	13.59	14.29	14.57	15.27	16.58	8.92	9.62	9.91	10.61	11.91
	6H	14.00	14.65	15.00	15.64	16.95	9.24	9.88	10.24	10.87	12.19
	8H	14.12	14.74	15.13	15.75	17.06	9.33	9.94	10.33	10.95	12.26
	12H	14.18	14.77	15.19	15.77	17.10	9.37	9.95	10.38	10.95	12.29
4H	2H	11.33	12.03	12.32	13.02	14.32	7.88	8.58	8.87	9.57	10.87
	3H	13.15	13.73	14.15	14.75	16.07	9.22	9.81	10.23	10.82	12.14
	4H	13.84	14.37	14.85	15.38	16.72	9.77	10.30	10.78	11.31	12.65
	6H	14.34	14.80	15.37	15.83	17.17	10.18	10.64	11.20	11.67	13.01
	8H	14.51	14.94	15.54	15.97	17.32	10.31	10.74	11.33	11.76	13.11
	12H	14.60	14.99	15.65	16.03	17.39	10.37	10.76	11.41	11.80	13.15
8H	4H	13.80	14.23	14.83	15.25	16.61	10.04	10.47	11.07	11.50	12.85
	6H	14.36	14.71	15.41	15.78	17.13	10.56	10.91	11.60	11.98	13.33
	8H	14.57	14.88	15.63	15.93	17.30	10.74	11.05	11.80	12.11	13.48
	12H	14.70	14.98	15.76	16.02	17.44	10.86	11.13	11.92	12.18	13.59
12H	4H	13.75	14.14	14.80	15.18	16.54	10.05	10.43	11.09	11.47	12.83
	6H	14.34	14.65	15.39	15.70	17.07	10.60	10.91	11.66	11.97	13.34
	8H	14.55	14.82	15.61	15.87	17.28	10.81	11.08	11.87	12.13	13.54

END OF REPORT