

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907982

Luminaire Tested: DFN2DIP-HX3F0-030D050US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907982
REPORT IS A COMBINATION OF REPORTS P899229 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-030D050US840-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7468.0 lumens
Efficiency: N/A
Efficacy: 123.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 60.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFLL

Luminous Intensity Polar Plot

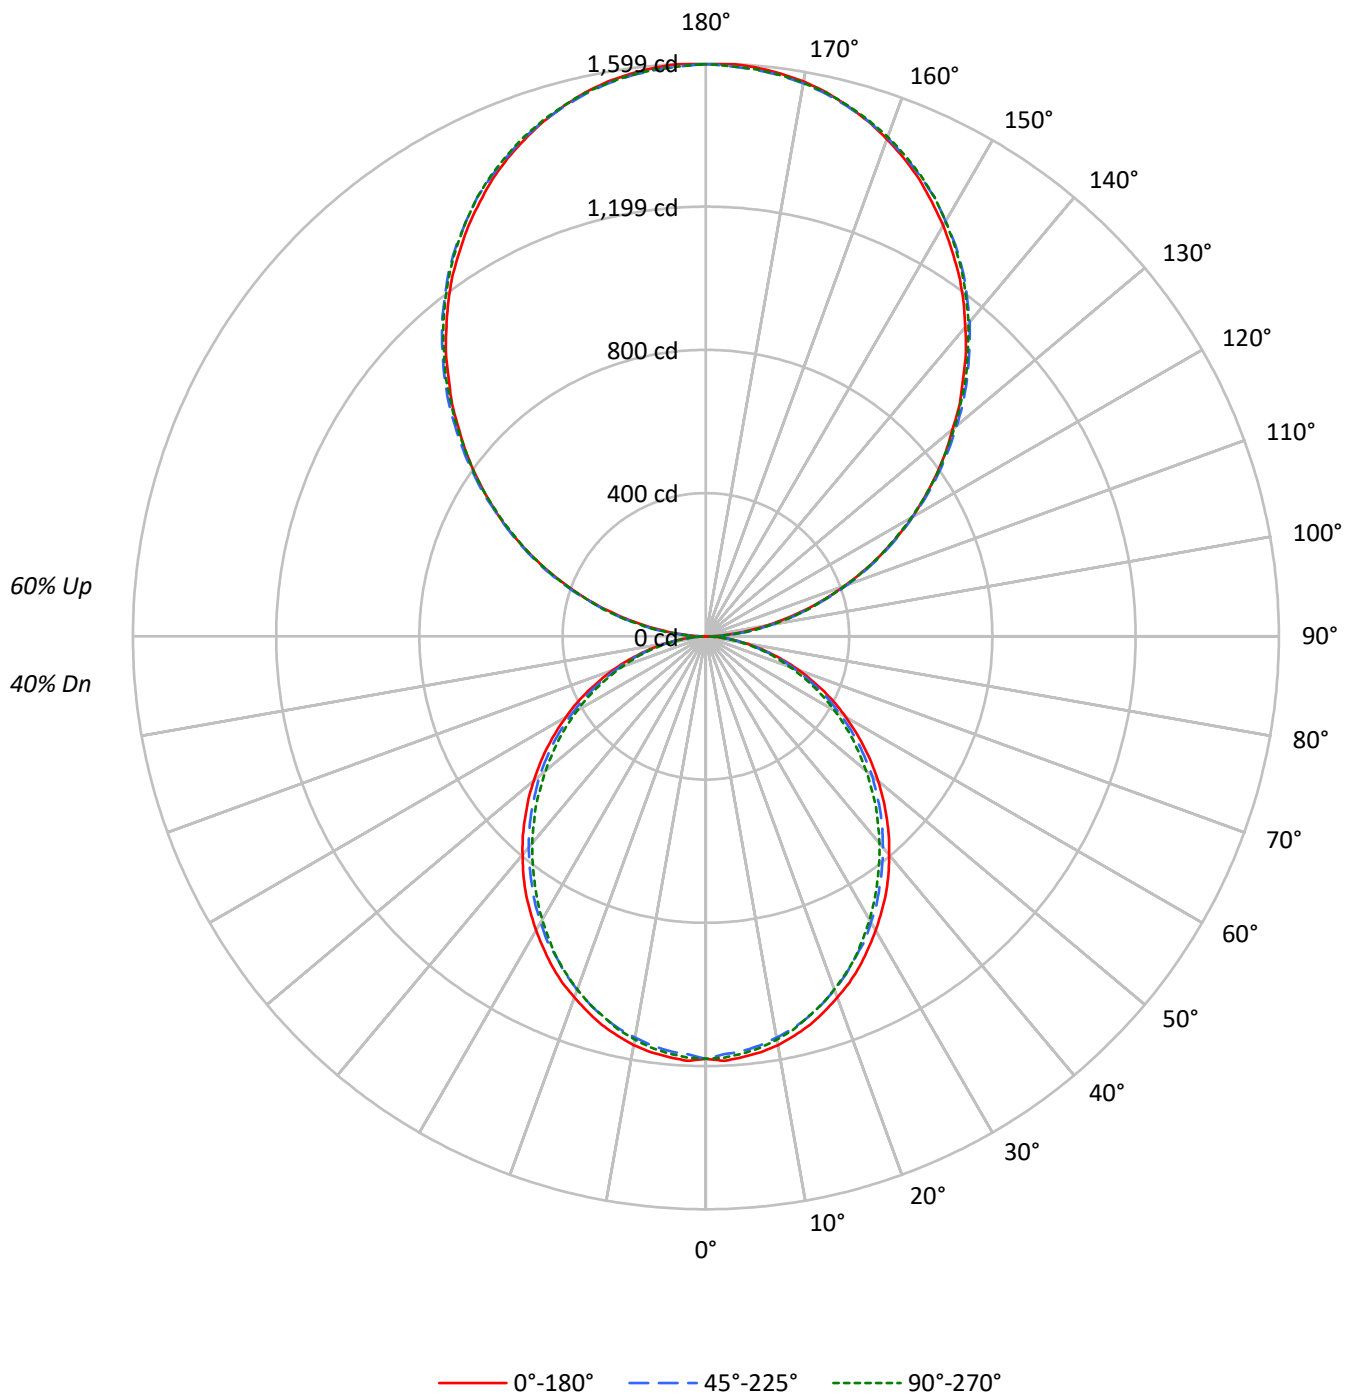

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	42	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	29	27	25
5	67	55	47	41	60	51	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	27	24	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	28	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	16	14
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1365	1365	1365
5°	1367	1346	1355
10°	1355	1326	1336
15°	1335	1304	1306
20°	1307	1272	1276
25°	1280	1235	1241
30°	1246	1200	1198
35°	1213	1160	1151
40°	1173	1118	1107
45°	1134	1077	1062
50°	1090	1034	1010
55°	1044	983	961
60°	993	924	906
65°	936	862	841
70°	864	786	770
75°	765	696	704
80°	645	580	580
85°	458	384	376

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1502 cd/sqm

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	111.0	1.5
10°-20°	312.2	4.2
20°-30°	458.8	6.1
30°-40°	532.8	7.1
40°-50°	532.2	7.1
50°-60°	464.1	6.2
60°-70°	343.1	4.6
70°-80°	194.1	2.6
80°-90°	55.8	0.7
90°-100°	98.8	1.3
100°-110°	314.0	4.2
110°-120°	537.3	7.2
120°-130°	706.6	9.5
130°-140°	793.2	10.6
140°-150°	777.8	10.4
150°-160°	652.5	8.7
160°-170°	432.7	5.8
170°-180°	151.2	2.0
0°-30°	881.9	11.8
0°-40°	1414.7	18.9
0°-60°	2411.0	32.3
0°-90°	3003.9	40.2
90°-120°	950.1	12.7
90°-150°	3227.7	43.2
90°-180°	4464.0	59.8
0°-180°	7468.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1179	1179	1179	1179	1179	
5°	1179	1174	1162	1171	1169	112
15°	1122	1116	1101	1105	1100	316
25°	1016	1007	987	990	987	467
35°	876	865	847	840	834	547
45°	713	705	688	676	671	550
55°	540	533	519	506	500	482
65°	364	357	346	336	330	360
75°	190	188	182	176	178	203
85°	46	45	44	41	40	52
90°	1	17	47	44	46	7
95°	70	84	86	86	84	78
105°	290	294	297	299	299	306
115°	539	547	544	543	539	533
125°	784	796	792	788	787	701
135°	1014	1029	1032	1031	1027	784
145°	1232	1241	1249	1250	1245	769
155°	1408	1412	1416	1423	1419	648
165°	1532	1530	1530	1540	1533	432
175°	1594	1590	1587	1597	1589	151
180°	1597	1597	1597	1597	1597	

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1178.8	1178.8	1178.8	1178.8	1178.8
2.5°	1185.7	1180.0	1167.5	1178.8	1176.7
5°	1178.8	1174.4	1161.9	1170.9	1168.7
7.5°	1170.9	1164.2	1151.7	1160.8	1158.5
10°	1158.5	1150.5	1137.0	1146.0	1142.7
12.5°	1141.5	1134.7	1121.2	1126.7	1124.5
15°	1122.2	1115.5	1100.7	1105.2	1099.5
17.5°	1098.3	1091.7	1076.8	1082.5	1076.8
20°	1072.3	1065.5	1049.7	1053.0	1048.5
22.5°	1046.3	1036.1	1021.3	1021.3	1019.0
25°	1015.6	1006.6	987.3	989.6	987.3
27.5°	981.6	973.6	959.0	955.6	950.0
30°	947.7	938.6	921.6	918.2	913.6
32.5°	911.4	904.6	886.5	879.6	875.0
35°	876.3	864.9	846.8	839.9	834.2
37.5°	836.6	826.4	808.2	800.2	794.6
40°	795.8	786.7	768.5	758.4	753.9
42.5°	756.1	747.0	728.9	717.5	710.7
45°	713.1	705.1	688.0	675.6	671.1
47.5°	671.1	663.2	645.0	632.5	625.7
50°	626.8	621.2	605.3	589.5	583.8
52.5°	583.8	575.8	561.2	548.7	540.7
55°	539.7	532.8	519.2	505.6	500.0
57.5°	495.3	489.7	474.9	461.3	456.8
60°	451.1	446.7	430.8	418.3	415.0
62.5°	408.1	400.1	388.8	377.5	372.9
65°	364.0	357.1	345.8	335.6	329.9
67.5°	318.6	312.9	302.7	294.8	290.2
70°	276.6	272.1	261.9	253.9	249.4
72.5°	233.6	228.9	223.3	215.4	212.1
75°	190.4	188.2	182.5	175.7	178.0
77.5°	151.9	147.3	145.0	141.7	138.4
80°	113.4	112.2	109.9	106.5	104.3
82.5°	77.1	77.1	76.0	71.4	71.4
85°	46.5	45.3	44.2	40.8	39.7
87.5°	20.4	18.2	15.9	12.5	11.3
90°	1.4	17.4	47.2	44.3	45.7
92.5°	29.9	40.4	41.9	43.3	43.3
95°	70.3	83.8	86.1	86.1	83.8
97.5°	116.9	129.5	134.8	134.8	134.8
100°	170.9	182.0	185.8	185.8	184.4
102.5°	227.7	235.9	241.2	242.7	241.2
105°	289.8	293.7	296.6	298.9	298.9
107.5°	351.4	357.2	357.2	358.2	351.4
110°	411.1	418.9	418.9	418.9	415.0

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	475.6	483.8	482.4	478.6	475.6
115°	539.2	546.9	544.5	543.1	539.2
117.5°	602.3	612.9	606.1	602.3	598.4
120°	665.8	676.4	665.8	665.8	661.5
122.5°	723.6	737.1	730.3	726.5	723.6
125°	784.3	796.3	792.4	788.1	786.7
127.5°	843.4	858.4	853.1	847.3	843.4
130°	898.9	916.2	913.7	910.9	905.5
132.5°	961.0	974.4	975.4	968.7	964.8
135°	1014.4	1029.3	1032.2	1030.8	1026.9
137.5°	1074.1	1086.1	1088.5	1087.5	1081.8
140°	1126.5	1138.6	1145.3	1145.3	1140.0
142.5°	1180.4	1192.6	1196.4	1197.8	1192.6
145°	1231.5	1241.1	1248.8	1250.3	1245.0
147.5°	1277.3	1289.3	1295.1	1297.5	1292.1
150°	1324.4	1332.6	1337.9	1342.2	1337.9
152.5°	1366.3	1374.5	1381.2	1386.5	1381.2
155°	1408.2	1412.0	1416.3	1423.1	1418.8
157.5°	1444.3	1447.1	1449.6	1459.3	1452.5
160°	1476.5	1479.5	1480.9	1489.0	1483.3
162.5°	1506.4	1506.4	1507.8	1517.0	1510.3
165°	1532.0	1530.5	1530.5	1540.1	1533.4
167.5°	1555.0	1550.6	1550.6	1560.3	1553.6
170°	1572.4	1568.5	1567.1	1576.7	1568.5
172.5°	1584.4	1580.5	1579.1	1588.7	1580.5
175°	1594.1	1590.1	1587.3	1596.9	1588.7
177.5°	1599.3	1595.5	1592.6	1600.7	1592.6
180°	1596.9	1596.9	1596.9	1596.9	1596.9

TEST NUMBER: P907982

CATALOG NUMBER: DFN2DIP-HX3F0-030D050US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.33	8.11	8.37	9.15	10.56	6.90	7.68	7.94	8.73	10.13
	3H	8.98	9.68	10.02	10.73	12.15	8.51	9.21	9.56	10.26	11.68
	4H	9.56	10.22	10.62	11.27	12.70	9.09	9.75	10.15	10.80	12.24
	6H	9.95	10.56	11.01	11.61	13.06	9.48	10.09	10.54	11.14	12.59
	8H	10.05	10.63	11.12	11.70	13.14	9.58	10.16	10.65	11.23	12.67
	12H	10.09	10.64	11.17	11.71	13.17	9.61	10.17	10.69	11.23	12.69
4H	2H	7.78	8.44	8.85	9.50	10.93	7.44	8.10	8.50	9.15	10.58
	3H	9.63	10.18	10.70	11.26	12.71	9.24	9.79	10.31	10.87	12.32
	4H	10.33	10.84	11.41	11.91	13.38	9.93	10.44	11.01	11.51	12.98
	6H	10.84	11.27	11.92	12.37	13.83	10.43	10.87	11.52	11.96	13.42
	8H	10.98	11.39	12.07	12.48	13.95	10.57	10.98	11.66	12.07	13.54
	12H	11.05	11.42	12.15	12.52	14.00	10.63	11.00	11.74	12.10	13.58
8H	4H	10.52	10.93	11.61	12.02	13.49	10.16	10.57	11.25	11.66	13.13
	6H	11.14	11.48	12.25	12.61	14.08	10.78	11.12	11.89	12.25	13.72
	8H	11.35	11.65	12.47	12.76	14.25	10.99	11.28	12.11	12.40	13.89
	12H	11.48	11.74	12.60	12.84	14.37	11.10	11.36	12.22	12.47	13.99
12H	4H	10.50	10.87	11.61	11.97	13.45	10.15	10.52	11.26	11.62	13.10
	6H	11.17	11.46	12.28	12.57	14.07	10.82	11.11	11.94	12.23	13.72
	8H	11.40	11.66	12.52	12.77	14.30	11.05	11.31	12.17	12.41	13.94

END OF REPORT