

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908093

Luminaire Tested: DFN2DIP-HX3F0-070D090US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908093
REPORT IS A COMBINATION OF REPORTS P899294 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D090US840-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14052.2 lumens
Efficiency: N/A
Efficacy: 100.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLLFLL

Luminous Intensity Polar Plot

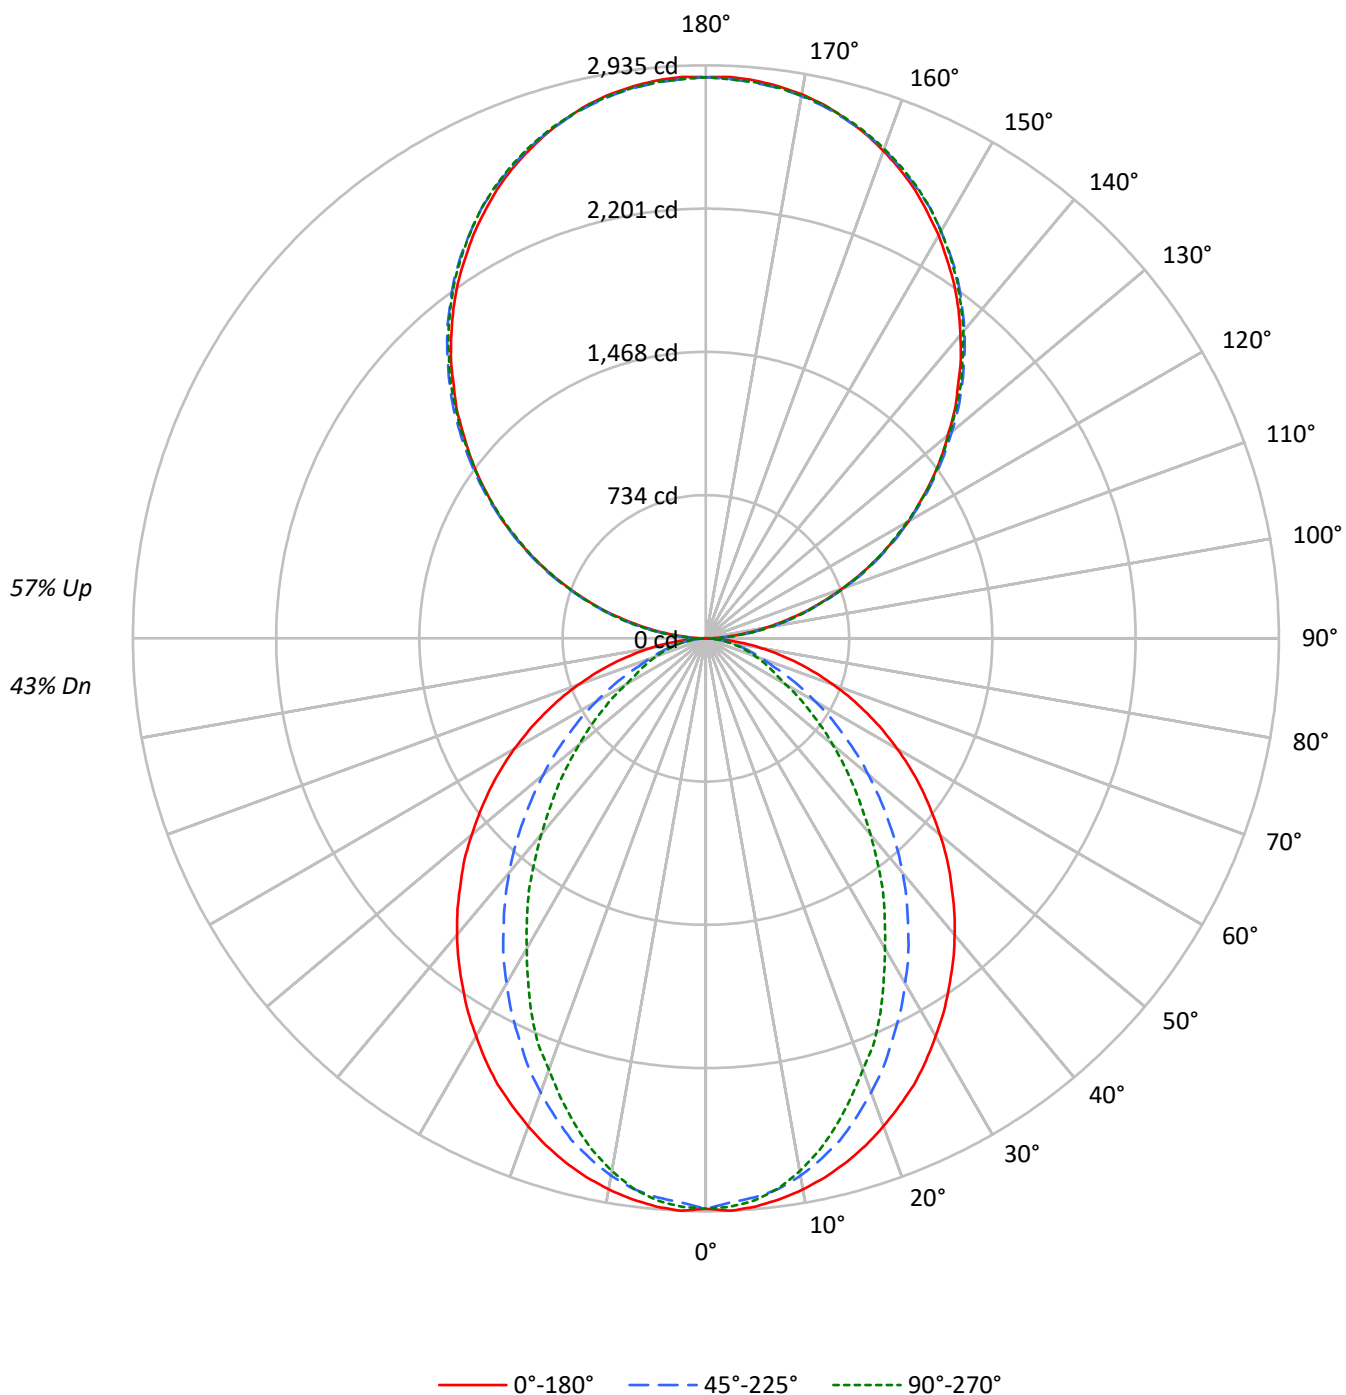

TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	50	50	50
1	97	92	89	85	88	85	82	79	70	68	66	57	55	54	44	43	43
2	88	81	75	70	80	74	69	65	62	58	55	50	48	46	40	38	36
3	81	72	65	59	74	66	60	55	55	51	47	45	42	39	35	33	32
4	74	64	56	50	68	59	52	47	49	44	40	40	37	34	32	30	28
5	68	57	49	43	62	52	46	41	44	39	35	36	32	30	29	26	24
6	63	51	43	38	57	47	40	35	40	35	31	33	29	26	26	24	22
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	28	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3384	3384	3384
5°	3388	3328	3350
10°	3353	3261	3239
15°	3305	3151	3069
20°	3243	3000	2861
25°	3179	2831	2660
30°	3093	2659	2405
35°	3009	2473	2182
40°	2924	2282	1926
45°	2825	2070	1694
50°	2722	1855	1468
55°	2614	1627	1251
60°	2490	1389	1028
65°	2347	1147	923
70°	2173	921	832
75°	1955	807	753
80°	1638	669	647
85°	1119	436	476

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2825 cd/sqm

TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.8	1.9
10°-20°	751.7	5.3
20°-30°	1055.3	7.5
30°-40°	1150.4	8.2
40°-50°	1057.3	7.5
50°-60°	830.4	5.9
60°-70°	540.5	3.8
70°-80°	278.2	2.0
80°-90°	79.2	0.6
90°-100°	177.9	1.3
100°-110°	565.2	4.0
110°-120°	967.2	6.9
120°-130°	1272.0	9.1
130°-140°	1427.7	10.2
140°-150°	1400.0	10.0
150°-160°	1174.4	8.4
160°-170°	778.9	5.5
170°-180°	272.2	1.9
0°-30°	2080.9	14.8
0°-40°	3231.2	23.0
0°-60°	5118.9	36.4
0°-90°	6016.8	42.8
90°-120°	1710.2	12.2
90°-150°	5809.9	41.3
90°-180°	8035.0	57.2
0°-180°	14052.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2922	2922	2922	2922	2922	
5°	2922	2908	2874	2898	2890	277
15°	2779	2750	2660	2610	2583	783
25°	2522	2438	2263	2155	2115	1160
35°	2173	2038	1806	1639	1581	1360
45°	1777	1600	1322	1134	1071	1372
55°	1351	1145	859	701	651	1207
65°	912	698	460	370	362	904
75°	486	301	212	193	190	515
85°	114	58	50	50	50	130
90°	3	31	85	80	82	14
95°	126	151	155	155	151	141
105°	522	529	534	538	538	551
115°	971	984	980	978	971	960
125°	1412	1433	1426	1419	1416	1261
135°	1826	1853	1858	1855	1848	1411
145°	2217	2234	2248	2250	2241	1385
155°	2535	2542	2550	2562	2554	1167
165°	2757	2755	2755	2772	2760	778
175°	2869	2862	2857	2874	2860	273
180°	2874	2874	2874	2874	2874	

TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2921.6	2921.6	2921.6	2921.6	2921.6
2.5°	2934.8	2921.6	2892.5	2919.1	2913.8
5°	2921.6	2908.4	2874.0	2897.8	2889.9
7.5°	2897.8	2882.1	2845.1	2855.4	2842.3
10°	2866.1	2847.6	2794.8	2786.7	2771.0
12.5°	2826.5	2802.7	2731.2	2715.4	2686.2
15°	2778.8	2749.7	2659.9	2609.7	2583.3
17.5°	2723.3	2681.0	2569.9	2511.7	2469.4
20°	2659.9	2606.9	2474.8	2408.8	2350.5
22.5°	2591.2	2530.3	2376.8	2287.0	2247.6
25°	2522.4	2437.7	2263.2	2155.0	2115.2
27.5°	2440.5	2350.5	2157.5	2033.3	1972.4
30°	2353.3	2252.6	2041.0	1906.4	1834.9
32.5°	2268.6	2146.9	1930.3	1771.5	1705.3
35°	2173.4	2038.5	1806.0	1639.4	1581.0
37.5°	2080.9	1935.3	1689.6	1506.9	1441.1
40°	1983.0	1824.5	1567.8	1380.2	1311.4
42.5°	1882.6	1713.4	1446.3	1250.5	1184.7
45°	1776.9	1599.5	1322.1	1134.2	1070.8
47.5°	1676.4	1488.7	1203.2	1015.2	957.2
50°	1565.3	1377.7	1086.7	904.1	848.9
52.5°	1456.7	1258.4	975.6	801.1	750.9
55°	1351.0	1144.8	859.2	700.7	650.6
57.5°	1242.7	1031.2	756.3	608.1	565.8
60°	1131.7	920.1	647.7	513.1	470.7
62.5°	1023.3	811.8	555.1	428.4	407.3
65°	912.2	697.9	460.1	370.3	362.1
67.5°	806.5	592.2	370.3	325.1	317.3
70°	695.4	489.2	306.6	280.2	269.5
72.5°	589.7	393.8	256.4	235.4	230.0
75°	486.5	301.2	211.5	193.0	190.5
77.5°	383.4	214.0	166.6	155.9	150.7
80°	288.1	153.4	126.8	116.4	116.4
82.5°	200.9	103.2	87.3	81.9	81.9
85°	113.6	58.1	50.2	50.2	50.2
87.5°	42.3	21.0	21.0	18.5	18.5
90°	2.6	31.2	84.9	79.7	82.3
92.5°	53.7	72.8	75.4	78.0	78.0
95°	126.5	150.8	155.1	155.1	150.8
97.5°	210.6	233.1	242.7	242.7	242.7
100°	307.6	327.6	334.5	334.5	331.9
102.5°	409.9	424.6	434.1	436.8	434.1
105°	521.7	528.6	533.8	538.2	538.2
107.5°	632.6	643.0	643.0	644.7	632.6
110°	740.0	754.0	754.0	754.0	747.0

TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	856.2	870.9	868.3	861.4	856.2
115°	970.6	984.4	980.1	977.5	970.6
117.5°	1084.1	1103.2	1091.1	1084.1	1077.1
120°	1198.5	1217.5	1198.5	1198.5	1190.6
122.5°	1302.4	1326.8	1314.6	1307.7	1302.4
125°	1411.7	1433.3	1426.4	1418.6	1416.0
127.5°	1518.2	1545.1	1535.6	1525.2	1518.2
130°	1617.9	1649.1	1644.8	1639.5	1630.0
132.5°	1729.7	1753.9	1755.7	1743.5	1736.7
135°	1825.8	1852.7	1858.0	1855.3	1848.5
137.5°	1933.3	1955.0	1959.3	1957.6	1947.2
140°	2027.8	2049.4	2061.5	2061.5	2052.0
142.5°	2124.9	2146.5	2153.4	2156.1	2146.5
145°	2216.8	2234.0	2247.9	2250.5	2241.0
147.5°	2299.1	2320.7	2331.1	2335.4	2325.9
150°	2384.0	2398.7	2408.2	2416.0	2408.2
152.5°	2459.3	2474.1	2486.2	2495.8	2486.2
155°	2534.8	2541.6	2549.5	2561.6	2553.8
157.5°	2599.7	2604.9	2609.3	2626.6	2614.4
160°	2657.8	2663.0	2665.6	2680.3	2669.9
162.5°	2711.5	2711.5	2714.1	2730.6	2718.5
165°	2757.4	2754.8	2754.8	2772.2	2760.1
167.5°	2799.0	2791.3	2791.3	2808.5	2796.4
170°	2830.2	2823.3	2820.8	2838.0	2823.3
172.5°	2851.9	2845.0	2842.4	2859.7	2845.0
175°	2869.2	2862.3	2857.1	2874.5	2859.7
177.5°	2878.7	2871.9	2866.6	2881.3	2866.6
180°	2874.5	2874.5	2874.5	2874.5	2874.5



TEST NUMBER: P908093

CATALOG NUMBER: DFN2DIP-HX3F0-070D090US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.63	11.40	11.65	12.43	13.80	6.60	7.38	7.63	8.40	9.78
	3H	12.29	12.99	13.33	14.02	15.41	7.78	8.48	8.82	9.51	10.90
	4H	12.89	13.55	13.94	14.59	15.99	8.23	8.88	9.27	9.92	11.32
	6H	13.31	13.91	14.36	14.95	16.36	8.54	9.15	9.60	10.19	11.60
	8H	13.43	14.00	14.49	15.06	16.47	8.63	9.20	9.69	10.26	11.67
	12H	13.48	14.03	14.55	15.08	16.51	8.67	9.21	9.73	10.27	11.70
4H	2H	10.64	11.29	11.69	12.33	13.73	7.19	7.84	8.24	8.88	10.28
	3H	12.45	13.00	13.51	14.07	15.48	8.53	9.07	9.59	10.14	11.55
	4H	13.14	13.64	14.20	14.69	16.13	9.07	9.57	10.13	10.63	12.06
	6H	13.64	14.07	14.72	15.15	16.58	9.48	9.91	10.56	10.99	12.42
	8H	13.81	14.21	14.89	15.28	16.73	9.61	10.01	10.68	11.08	12.52
	12H	13.90	14.26	14.99	15.35	16.80	9.67	10.03	10.76	11.11	12.56
8H	4H	13.10	13.50	14.17	14.57	16.02	9.34	9.74	10.42	10.81	12.26
	6H	13.66	13.99	14.75	15.10	16.54	9.85	10.18	10.95	11.30	12.74
	8H	13.87	14.16	14.97	15.25	16.72	10.04	10.33	11.14	11.43	12.89
	12H	14.00	14.25	15.10	15.34	16.85	10.15	10.41	11.26	11.50	13.00
12H	4H	13.05	13.41	14.14	14.50	15.95	9.34	9.70	10.43	10.79	12.24
	6H	13.63	13.92	14.73	15.02	16.48	9.90	10.19	11.00	11.29	12.75
	8H	13.84	14.10	14.95	15.19	16.69	10.10	10.36	11.21	11.45	12.95

END OF REPORT