

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908107

Luminaire Tested: DFN2DIP-HX3F0-080D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908107
REPORT IS A COMBINATION OF REPORTS P900773 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D060US840-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13996.7 lumens
Efficiency: N/A
Efficacy: 111.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

Luminous Intensity Polar Plot

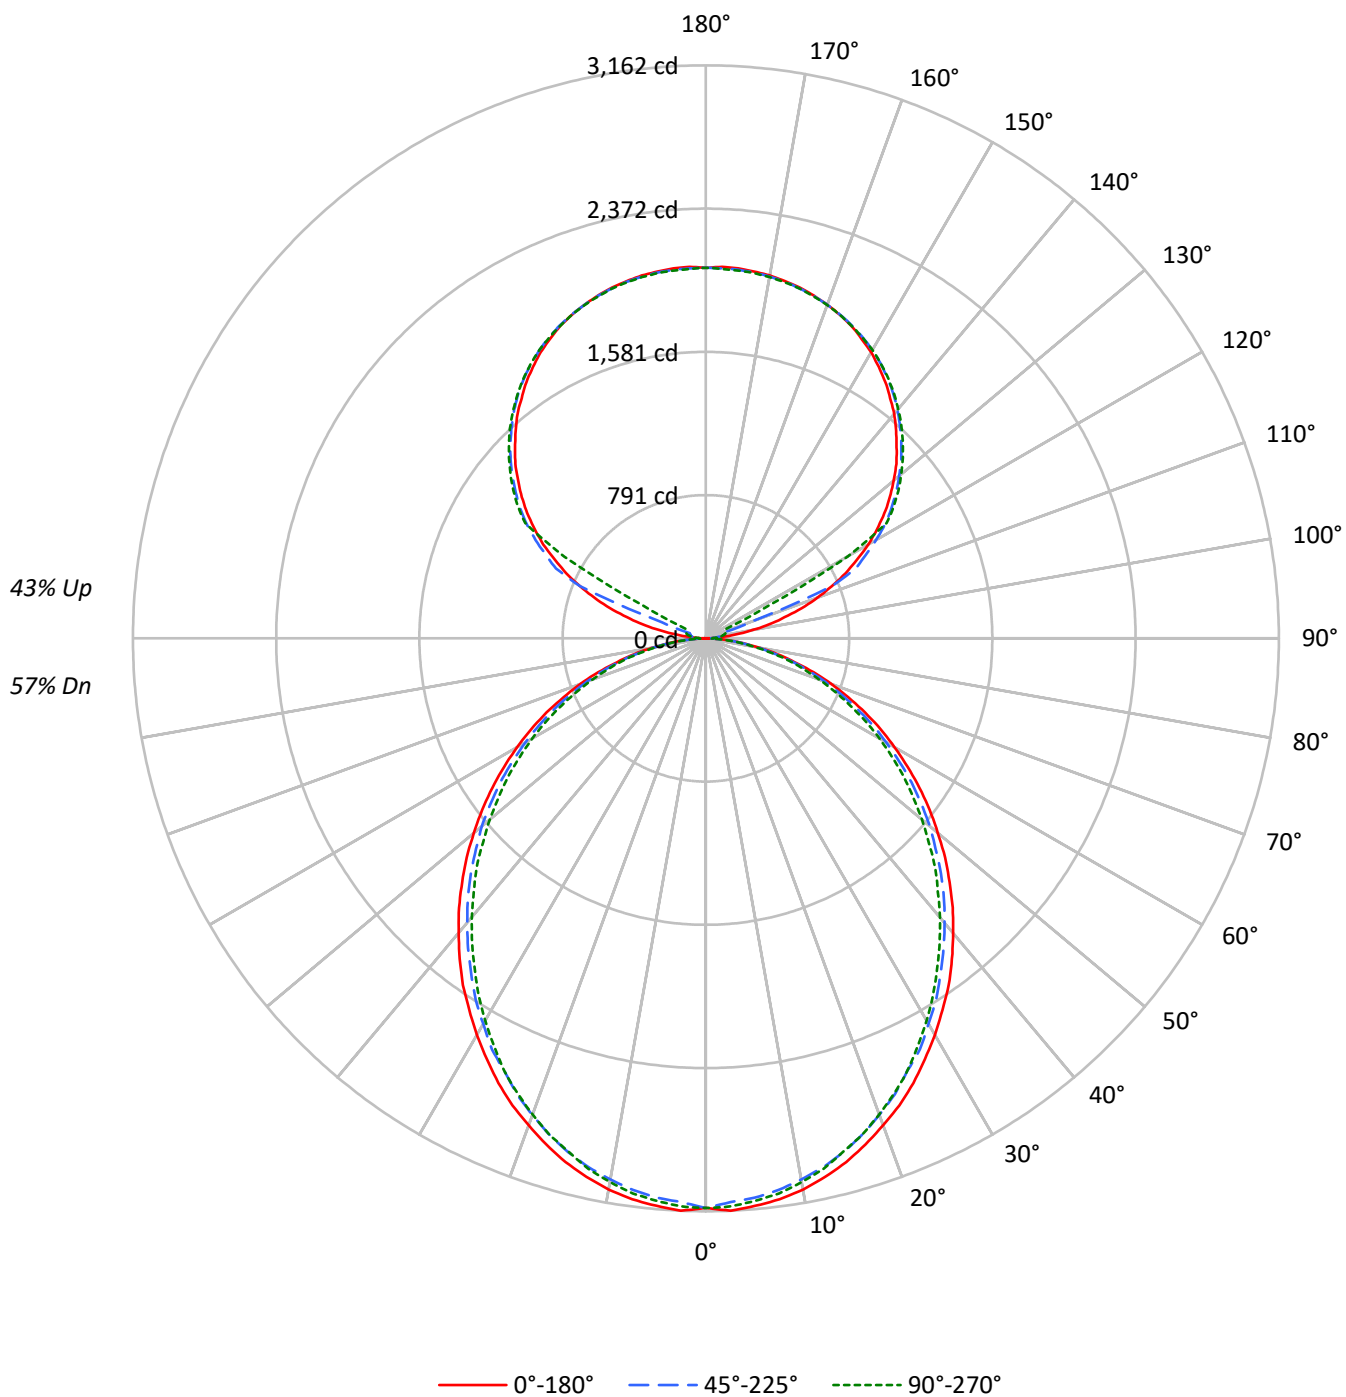

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	55	54	53
2	91	83	77	72	84	77	72	67	67	63	59	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	40	38
4	76	65	57	50	70	61	53	48	53	47	43	45	41	38	39	35	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	31	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	22	30	24	20	26	22	18	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3641	3641	3641
5°	3645	3588	3613
10°	3614	3537	3562
15°	3560	3476	3483
20°	3486	3393	3403
25°	3413	3294	3311
30°	3322	3201	3194
35°	3235	3092	3070
40°	3129	2982	2952
45°	3023	2872	2832
50°	2906	2756	2692
55°	2785	2622	2563
60°	2647	2463	2416
65°	2497	2298	2242
70°	2305	2097	2054
75°	2040	1856	1877
80°	1720	1548	1545
85°	1220	1025	1002

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3023 cd/sqm

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.1
10°-20°	832.5	5.9
20°-30°	1223.4	8.7
30°-40°	1420.9	10.2
40°-50°	1419.1	10.1
50°-60°	1237.5	8.8
60°-70°	914.7	6.5
70°-80°	517.6	3.7
80°-90°	140.2	1.0
90°-100°	67.4	0.5
100°-110°	251.4	1.8
110°-120°	666.7	4.8
120°-130°	1105.7	7.9
130°-140°	1174.5	8.4
140°-150°	1091.6	7.8
150°-160°	877.6	6.3
160°-170°	565.5	4.0
170°-180°	194.6	1.4
0°-30°	2351.8	16.8
0°-40°	3772.7	27.0
0°-60°	6429.3	45.9
0°-90°	8001.8	57.2
90°-120°	985.5	7.0
90°-150°	4357.2	31.1
90°-180°	5995.0	42.8
0°-180°	13996.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	1	18	30	37	40	13
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P908107

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.36	13.29	13.25	14.20	15.36	11.93	12.86	12.82	13.77	14.93
	3H	14.01	14.85	14.92	15.77	16.96	13.54	14.38	14.45	15.30	16.49
	4H	14.60	15.39	15.52	16.32	17.51	14.13	14.92	15.05	15.85	17.05
	6H	15.00	15.72	15.93	16.66	17.87	14.53	15.25	15.46	16.19	17.40
	8H	15.10	15.79	16.04	16.74	17.95	14.63	15.32	15.57	16.27	17.49
	12H	15.15	15.81	16.09	16.75	17.99	14.67	15.33	15.62	16.28	17.51
4H	2H	12.82	13.61	13.75	14.54	15.74	12.48	13.27	13.40	14.20	15.40
	3H	14.69	15.34	15.62	16.30	17.52	14.30	14.95	15.23	15.91	17.13
	4H	15.40	16.00	16.34	16.95	18.19	14.99	15.60	15.94	16.55	17.79
	6H	15.91	16.43	16.87	17.40	18.64	15.50	16.02	16.46	17.00	18.24
	8H	16.06	16.54	17.02	17.51	18.76	15.65	16.13	16.61	17.10	18.36
	12H	16.13	16.57	17.11	17.55	18.81	15.71	16.15	16.69	17.14	18.40
8H	4H	15.60	16.08	16.56	17.05	18.30	15.24	15.72	16.20	16.69	17.95
	6H	16.22	16.62	17.21	17.63	18.89	15.86	16.26	16.85	17.28	18.53
	8H	16.44	16.79	17.43	17.79	19.06	16.07	16.43	17.07	17.43	18.70
	12H	16.57	16.88	17.57	17.87	19.19	16.19	16.50	17.19	17.49	18.81
12H	4H	15.58	16.02	16.56	17.01	18.27	15.23	15.67	16.22	16.66	17.92
	6H	16.25	16.60	17.25	17.61	18.87	15.90	16.26	16.90	17.26	18.53
	8H	16.49	16.80	17.49	17.80	19.11	16.14	16.45	17.14	17.44	18.76

END OF REPORT