

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908109

Luminaire Tested: DFN2DIP-HX3F0-080D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908109
REPORT IS A COMBINATION OF REPORTS P900774 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D060US840-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12865.7 lumens
Efficiency: N/A
Efficacy: 102.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLLONL

Luminous Intensity Polar Plot

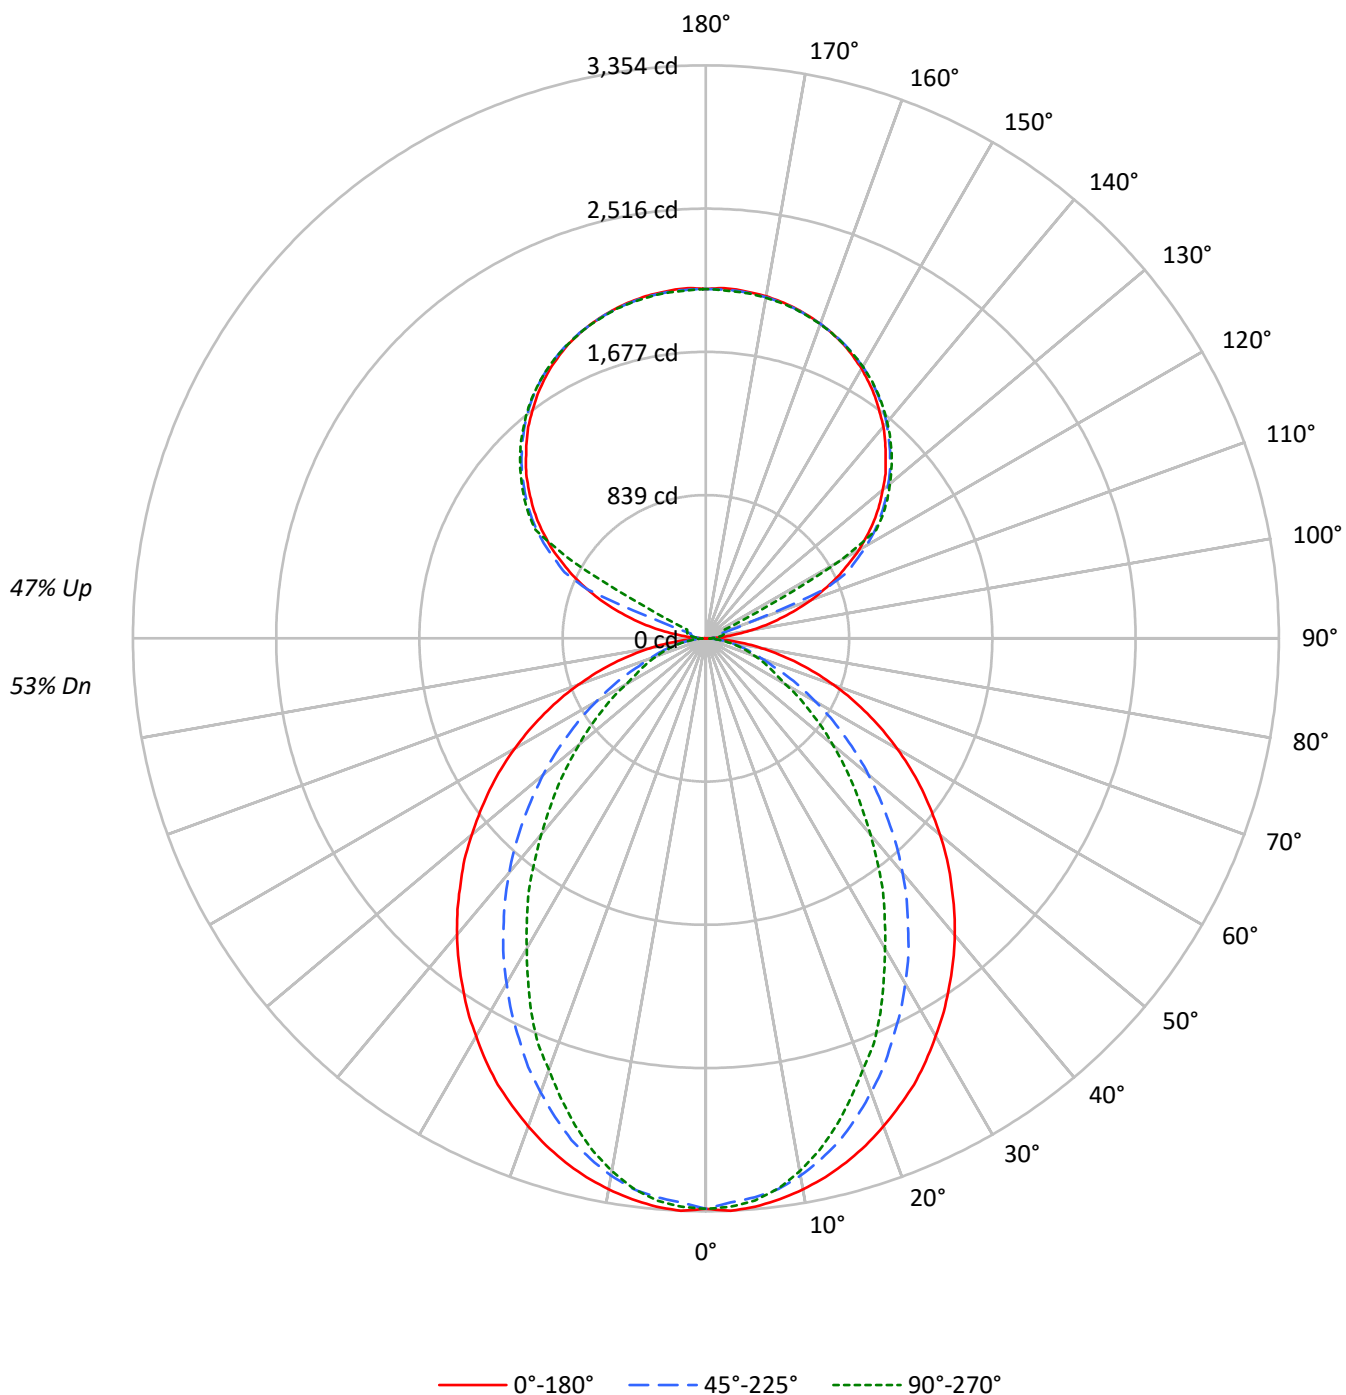

TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	83	78	73	84	78	73	68	67	63	60	57	54	52	47	45	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	42	40	38
4	76	66	58	52	70	61	55	49	53	48	44	45	42	38	38	35	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	28	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	26	29	26	23
8	56	44	36	31	52	41	34	29	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	26	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3868	3868	3868
5°	3872	3804	3829
10°	3832	3726	3702
15°	3778	3601	3507
20°	3706	3428	3269
25°	3633	3236	3040
30°	3535	3039	2749
35°	3439	2827	2494
40°	3341	2608	2201
45°	3228	2365	1937
50°	3111	2121	1678
55°	2988	1860	1430
60°	2846	1587	1175
65°	2682	1310	1054
70°	2484	1052	951
75°	2233	922	861
80°	1872	765	739
85°	1280	498	544

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3228 cd/sqm

TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	2.4
10°-20°	859.1	6.7
20°-30°	1206.1	9.4
30°-40°	1314.7	10.2
40°-50°	1208.4	9.4
50°-60°	949.0	7.4
60°-70°	617.7	4.8
70°-80°	318.0	2.5
80°-90°	84.8	0.7
90°-100°	67.4	0.5
100°-110°	251.4	2.0
110°-120°	666.7	5.2
120°-130°	1105.7	8.6
130°-140°	1174.5	9.1
140°-150°	1091.6	8.5
150°-160°	877.6	6.8
160°-170°	565.5	4.4
170°-180°	194.6	1.5
0°-30°	2378.1	18.5
0°-40°	3692.9	28.7
0°-60°	5850.2	45.5
0°-90°	6870.7	53.4
90°-120°	985.5	7.7
90°-150°	4357.2	33.9
90°-180°	5995.0	46.6
0°-180°	12865.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	1	18	30	37	40	12
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8



TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P908109

CATALOG NUMBER: DFN2DIP-HX3F0-080D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.12	12.97	13.05	13.92	15.15	8.09	8.95	9.03	9.90	11.12
	3H	13.79	14.56	14.73	15.51	16.76	9.28	10.05	10.22	11.00	12.25
	4H	14.39	15.12	15.35	16.08	17.34	9.73	10.45	10.69	11.41	12.67
	6H	14.81	15.48	15.78	16.44	17.71	10.05	10.71	11.02	11.68	12.95
	8H	14.93	15.57	15.91	16.55	17.82	10.14	10.77	11.11	11.75	13.02
	12H	14.99	15.60	15.98	16.57	17.86	10.18	10.78	11.16	11.76	13.05
4H	2H	12.14	12.86	13.10	13.82	15.08	8.69	9.41	9.65	10.37	11.63
	3H	13.96	14.56	14.94	15.55	16.82	10.03	10.64	11.01	11.63	12.90
	4H	14.65	15.20	15.63	16.18	17.48	10.58	11.13	11.56	12.11	13.41
	6H	15.16	15.63	16.15	16.64	17.93	11.00	11.47	11.99	12.48	13.77
	8H	15.33	15.77	16.33	16.77	18.08	11.12	11.56	12.12	12.56	13.87
	12H	15.42	15.82	16.44	16.83	18.15	11.19	11.58	12.20	12.60	13.91
8H	4H	14.62	15.06	15.61	16.06	17.37	10.86	11.30	11.85	12.30	13.61
	6H	15.17	15.54	16.20	16.58	17.89	11.37	11.73	12.39	12.78	14.08
	8H	15.39	15.71	16.42	16.74	18.06	11.56	11.88	12.59	12.91	14.23
	12H	15.52	15.80	16.55	16.83	18.20	11.67	11.96	12.71	12.98	14.35
12H	4H	14.57	14.97	15.58	15.98	17.30	10.86	11.26	11.88	12.28	13.59
	6H	15.15	15.47	16.18	16.50	17.82	11.42	11.74	12.45	12.77	14.09
	8H	15.37	15.65	16.40	16.67	18.04	11.62	11.91	12.66	12.93	14.30