

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908134

Luminaire Tested: DFN2DIP-HX3F0-090D070US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908134
REPORT IS A COMBINATION OF REPORTS P899269 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D070US840-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15254.0 lumens
Efficiency: N/A
Efficacy: 104.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFLL

Luminous Intensity Polar Plot

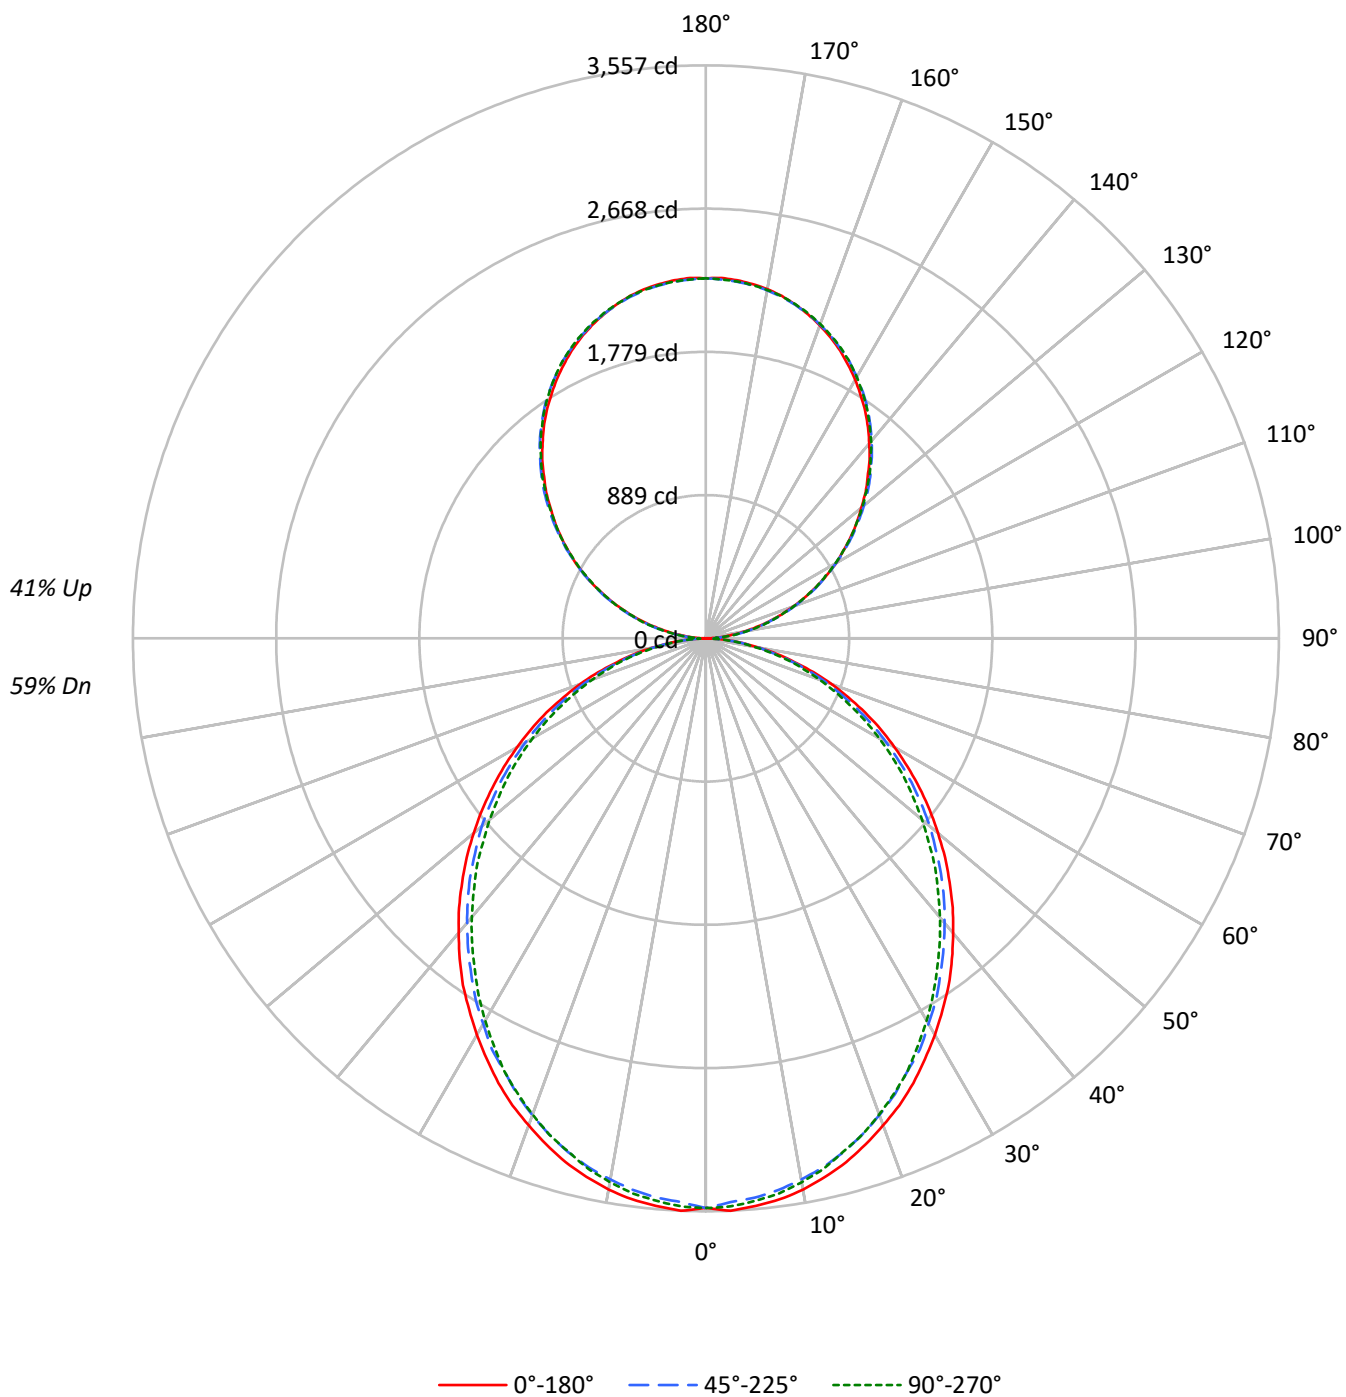

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	95	91	88	93	89	86	83	78	75	73	67	65	63	57	56	54
2	91	83	77	72	85	78	73	68	68	64	60	59	56	53	50	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	44	42	39
4	76	65	57	51	71	61	54	48	53	48	43	46	42	38	40	36	34
5	70	58	50	44	65	54	47	41	48	42	37	42	37	33	36	32	29
6	64	52	44	38	60	49	41	36	43	37	33	38	33	29	33	29	26
7	59	47	39	33	55	44	37	32	39	33	29	34	29	26	30	26	23
8	55	43	35	29	51	40	33	28	36	30	26	31	27	23	27	23	21
9	51	39	31	26	48	37	30	25	33	27	23	29	24	21	25	21	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4096	4096	4096
5°	4101	4037	4064
10°	4066	3979	4007
15°	4005	3911	3919
20°	3922	3817	3829
25°	3840	3705	3725
30°	3737	3601	3593
35°	3640	3479	3454
40°	3520	3355	3321
45°	3400	3231	3186
50°	3270	3100	3029
55°	3133	2949	2884
60°	2978	2771	2718
65°	2809	2585	2522
70°	2593	2359	2311
75°	2295	2087	2112
80°	1934	1740	1739
85°	1372	1152	1128

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3400 cd/sqm

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.9	2.2
10°-20°	936.5	6.1
20°-30°	1376.3	9.0
30°-40°	1598.5	10.5
40°-50°	1596.5	10.5
50°-60°	1392.1	9.1
60°-70°	1029.1	6.7
70°-80°	582.2	3.8
80°-90°	160.0	1.0
90°-100°	138.3	0.9
100°-110°	439.6	2.9
110°-120°	752.2	4.9
120°-130°	989.3	6.5
130°-140°	1110.5	7.3
140°-150°	1088.9	7.1
150°-160°	913.5	6.0
160°-170°	605.8	4.0
170°-180°	211.7	1.4
0°-30°	2645.7	17.3
0°-40°	4244.2	27.8
0°-60°	7232.9	47.4
0°-90°	9004.3	59.0
90°-120°	1330.1	8.7
90°-150°	4518.8	29.6
90°-180°	6250.0	41.0
0°-180°	15254.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3536	3536	3536	3536	3536	
5°	3536	3523	3486	3513	3506	336
15°	3367	3346	3302	3316	3299	948
25°	3047	3020	2962	2969	2962	1402
35°	2629	2595	2540	2520	2503	1642
45°	2139	2115	2064	2027	2013	1651
55°	1619	1598	1558	1517	1500	1447
65°	1092	1071	1037	1007	990	1079
75°	571	565	547	527	534	610
85°	139	136	133	122	119	155
90°	2	24	66	62	64	15
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3536.4	3536.4	3536.4	3536.4	3536.4
2.5°	3557.0	3540.1	3502.6	3536.4	3530.0
5°	3536.4	3523.1	3485.7	3512.7	3506.2
7.5°	3512.7	3492.5	3455.0	3482.4	3475.6
10°	3475.6	3451.7	3410.9	3438.0	3427.9
12.5°	3424.3	3404.1	3363.4	3380.2	3373.5
15°	3366.6	3346.4	3302.0	3315.7	3298.7
17.5°	3295.1	3274.9	3230.6	3247.5	3230.6
20°	3216.8	3196.6	3149.0	3159.1	3145.7
22.5°	3138.9	3108.3	3063.8	3063.8	3057.0
25°	3046.9	3019.8	2962.1	2968.6	2962.1
27.5°	2944.8	2920.9	2877.0	2866.9	2849.9
30°	2843.1	2815.6	2764.7	2754.6	2741.0
32.5°	2734.1	2713.9	2659.4	2638.9	2625.1
35°	2628.8	2594.8	2540.3	2519.8	2502.9
37.5°	2509.7	2479.0	2424.5	2400.8	2383.8
40°	2387.3	2360.0	2305.4	2275.1	2261.5
42.5°	2268.3	2240.9	2186.8	2152.5	2132.3
45°	2139.1	2115.4	2064.1	2026.9	2013.3
47.5°	2013.3	1989.4	1934.9	1897.4	1877.2
50°	1880.5	1863.5	1815.8	1768.3	1751.3
52.5°	1751.3	1727.5	1683.4	1646.0	1622.1
55°	1618.9	1598.3	1557.5	1516.8	1499.9
57.5°	1486.1	1469.2	1424.8	1384.0	1370.3
60°	1353.3	1340.0	1292.3	1254.9	1244.8
62.5°	1224.2	1200.3	1166.4	1132.6	1118.8
65°	1091.8	1071.2	1037.2	1006.6	989.7
67.5°	955.7	938.5	908.1	884.3	870.6
70°	829.8	816.1	785.5	761.6	748.3
72.5°	700.6	686.9	669.9	646.2	636.1
75°	571.2	564.6	547.3	527.1	534.0
77.5°	455.7	442.0	435.2	425.1	415.0
80°	340.2	336.6	329.7	319.6	312.9
82.5°	231.3	231.3	228.0	214.3	214.3
85°	139.3	136.0	132.8	122.3	119.1
87.5°	61.3	54.4	47.7	37.6	33.9
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P908134

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.92	13.87	13.80	14.77	15.90	12.49	13.44	13.37	14.34	15.47
	3H	14.58	15.43	15.47	16.34	17.50	14.11	14.96	15.00	15.87	17.03
	4H	15.17	15.97	16.07	16.88	18.05	14.70	15.50	15.60	16.41	17.59
	6H	15.56	16.31	16.48	17.23	18.41	15.09	15.84	16.01	16.75	17.94
	8H	15.67	16.38	16.59	17.31	18.50	15.20	15.91	16.12	16.84	18.03
	12H	15.72	16.39	16.65	17.32	18.53	15.24	15.92	16.17	16.85	18.05
4H	2H	13.39	14.19	14.30	15.11	16.28	13.05	13.85	13.96	14.76	15.94
	3H	15.25	15.93	16.17	16.87	18.06	14.86	15.54	15.78	16.48	17.67
	4H	15.97	16.58	16.90	17.52	18.73	15.56	16.18	16.49	17.12	18.33
	6H	16.48	17.01	17.42	17.97	19.18	16.07	16.60	17.02	17.57	18.78
	8H	16.63	17.12	17.57	18.08	19.30	16.22	16.71	17.17	17.67	18.90
	12H	16.70	17.15	17.67	18.12	19.35	16.28	16.73	17.25	17.70	18.94
8H	4H	16.17	16.66	17.11	17.62	18.84	15.81	16.30	16.76	17.26	18.49
	6H	16.79	17.20	17.76	18.20	19.42	16.43	16.84	17.41	17.84	19.07
	8H	17.01	17.37	17.99	18.36	19.60	16.64	17.01	17.63	17.99	19.24
	12H	17.14	17.46	18.12	18.44	19.73	16.76	17.08	17.74	18.06	19.35
12H	4H	16.16	16.60	17.12	17.58	18.81	15.81	16.25	16.77	17.23	18.46
	6H	16.82	17.18	17.80	18.17	19.41	16.47	16.84	17.45	17.82	19.07
	8H	17.06	17.38	18.05	18.36	19.65	16.71	17.03	17.69	18.01	19.30