

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P908136

Luminaire Tested: DFN2DIP-HX3F0-090D070US840-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P908136
REPORT IS A COMBINATION OF REPORTS P899270 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D070US840-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13981.6 lumens
Efficiency: N/A
Efficacy: 95.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLLFLL

Luminous Intensity Polar Plot

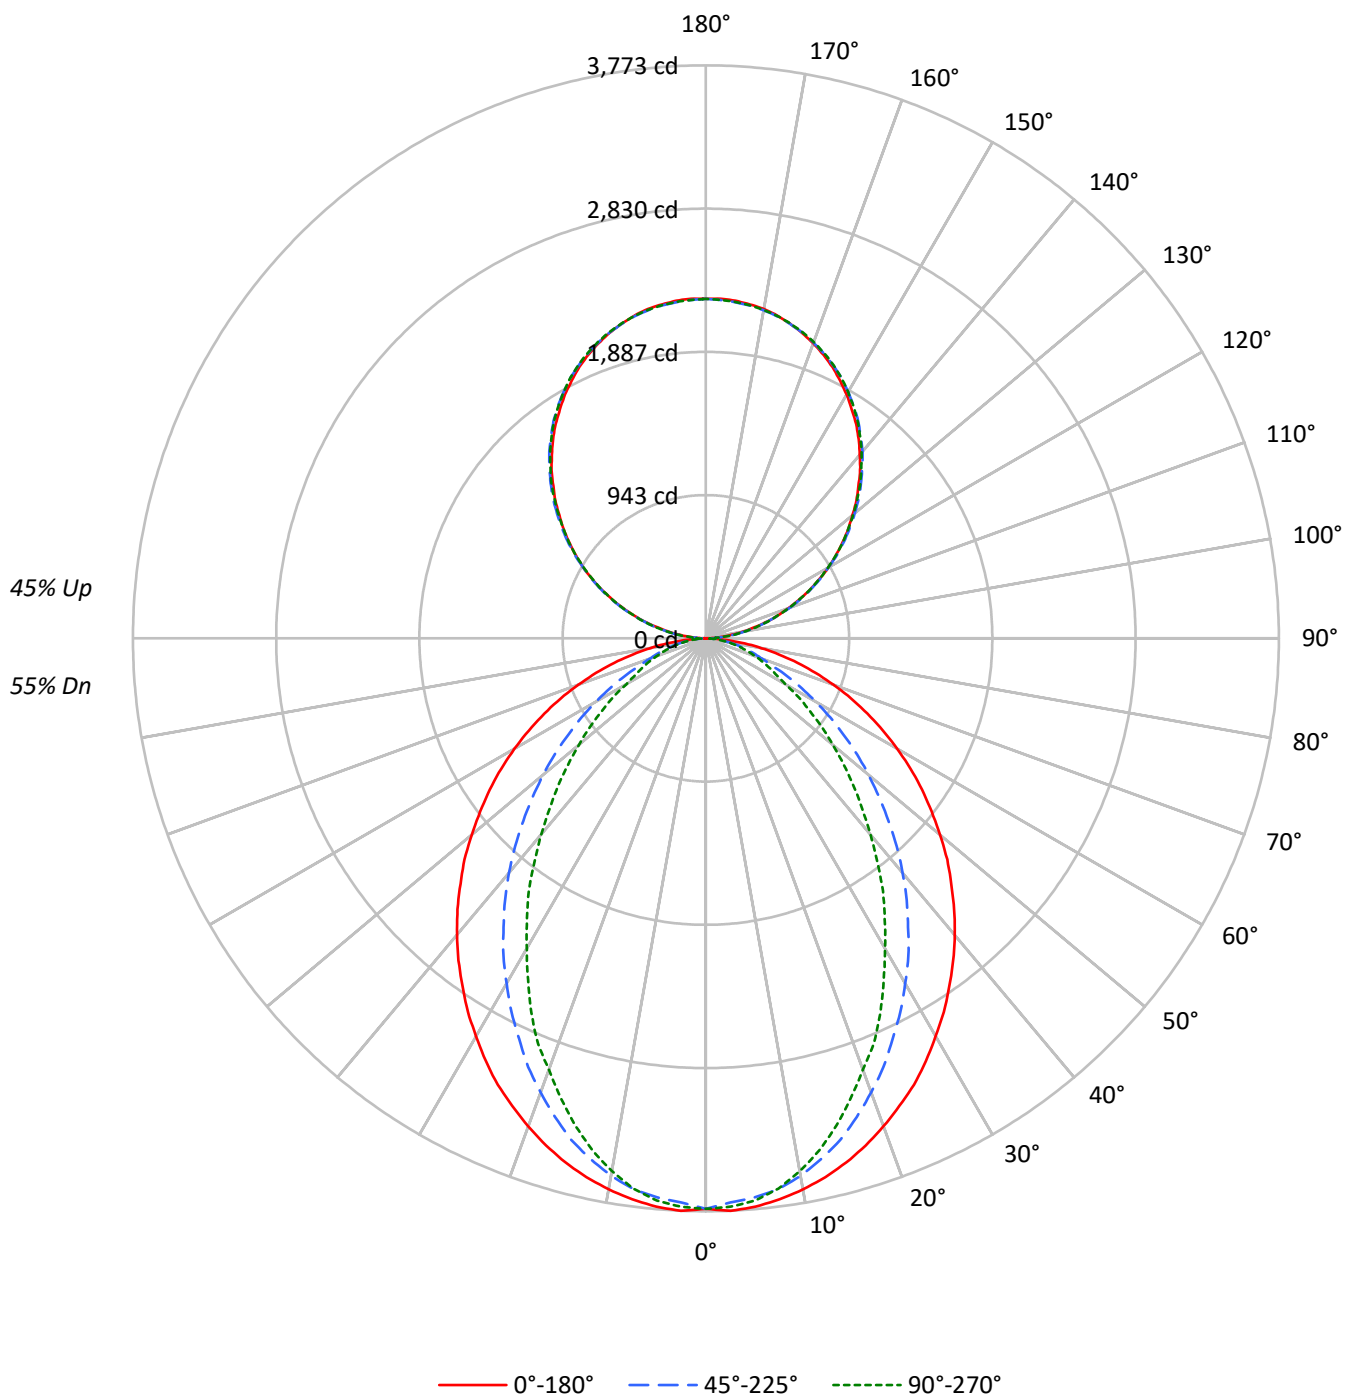

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	92	88	92	89	86	83	76	74	72	65	63	62	55	54	53
2	91	84	78	73	84	78	73	69	68	64	60	58	55	53	49	47	45
3	83	74	67	61	77	69	63	58	60	55	51	52	48	45	44	41	39
4	77	66	58	52	71	62	55	50	54	49	44	46	42	39	39	36	34
5	71	59	51	45	65	55	48	43	48	43	39	42	38	34	36	33	30
6	65	53	45	40	60	50	43	38	44	38	34	38	34	30	33	29	27
7	60	48	41	35	56	45	38	33	40	34	30	35	30	27	30	27	24
8	56	44	36	31	52	41	35	30	37	31	27	32	28	24	28	24	22
9	52	40	33	28	49	38	31	27	34	28	24	30	25	22	26	22	20
10	49	37	30	25	46	35	29	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4351	4351	4351
5°	4356	4279	4307
10°	4311	4192	4165
15°	4250	4051	3946
20°	4169	3857	3678
25°	4087	3640	3420
30°	3977	3418	3092
35°	3869	3180	2805
40°	3759	2934	2476
45°	3632	2661	2178
50°	3500	2386	1887
55°	3361	2092	1608
60°	3201	1786	1321
65°	3017	1474	1186
70°	2794	1184	1070
75°	2513	1037	969
80°	2106	860	832
85°	1439	560	611

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3632 cd/sqm

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	352.1	2.5
10°-20°	966.5	6.9
20°-30°	1356.9	9.7
30°-40°	1479.1	10.6
40°-50°	1359.4	9.7
50°-60°	1067.6	7.6
60°-70°	694.9	5.0
70°-80°	357.7	2.6
80°-90°	97.7	0.7
90°-100°	138.3	1.0
100°-110°	439.6	3.1
110°-120°	752.2	5.4
120°-130°	989.3	7.1
130°-140°	1110.5	7.9
140°-150°	1088.9	7.8
150°-160°	913.5	6.5
160°-170°	605.8	4.3
170°-180°	211.7	1.5
0°-30°	2675.4	19.1
0°-40°	4154.5	29.7
0°-60°	6581.5	47.1
0°-90°	7731.8	55.3
90°-120°	1330.1	9.5
90°-150°	4518.8	32.3
90°-180°	6250.0	44.7
0°-180°	13981.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3756	3756	3756	3756	3756	
5°	3756	3739	3695	3726	3716	356
15°	3573	3535	3420	3355	3321	1007
25°	3243	3134	2910	2771	2720	1492
35°	2794	2621	2322	2108	2033	1749
45°	2284	2057	1700	1458	1377	1764
55°	1737	1472	1105	901	836	1552
65°	1173	897	592	476	466	1163
75°	625	387	272	248	245	661
85°	146	75	64	64	64	168
90°	2	24	66	62	64	14
95°	98	117	121	121	117	109
105°	406	411	415	419	419	428
115°	755	766	762	760	755	747
125°	1098	1115	1109	1103	1101	981
135°	1420	1441	1445	1443	1438	1098
145°	1724	1738	1748	1750	1743	1077
155°	1972	1977	1983	1992	1986	907
165°	2145	2143	2143	2156	2147	605
175°	2232	2226	2222	2236	2224	212
180°	2236	2236	2236	2236	2236	

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3756.4	3756.4	3756.4	3756.4	3756.4
2.5°	3773.4	3756.4	3718.8	3753.2	3746.3
5°	3756.4	3739.4	3695.1	3725.7	3715.6
7.5°	3725.7	3705.5	3657.9	3671.3	3654.3
10°	3685.0	3661.2	3593.4	3582.9	3562.7
12.5°	3634.1	3603.5	3511.5	3491.3	3453.7
15°	3572.8	3535.3	3419.9	3355.3	3321.4
17.5°	3501.4	3447.0	3304.1	3229.4	3175.0
20°	3419.9	3351.7	3181.8	3097.1	3022.0
22.5°	3331.5	3253.3	3056.0	2940.5	2889.7
25°	3243.2	3134.2	2909.9	2770.7	2719.5
27.5°	3137.9	3022.0	2773.9	2614.1	2535.9
30°	3025.7	2896.2	2624.2	2451.1	2359.1
32.5°	2916.7	2760.2	2481.7	2277.7	2192.5
35°	2794.5	2621.0	2322.0	2107.8	2032.8
37.5°	2675.4	2488.3	2172.3	1937.5	1852.8
40°	2549.6	2345.8	2015.8	1774.5	1686.2
42.5°	2420.4	2203.0	1859.6	1607.9	1523.1
45°	2284.5	2056.6	1699.8	1458.1	1376.6
47.5°	2155.4	1914.1	1546.9	1305.3	1230.6
50°	2012.6	1771.2	1397.2	1162.5	1091.4
52.5°	1873.0	1618.0	1254.5	1030.1	965.5
55°	1737.0	1471.9	1104.7	901.0	836.4
57.5°	1597.8	1325.9	972.4	781.9	727.5
60°	1454.9	1183.0	832.8	659.6	605.2
62.5°	1315.8	1043.8	713.8	550.8	523.7
65°	1172.9	897.4	591.5	476.1	465.6
67.5°	1036.9	761.3	476.1	418.0	407.9
70°	894.1	629.0	394.3	360.3	346.6
72.5°	758.1	506.3	329.6	302.6	295.8
75°	625.4	387.4	272.0	248.1	244.9
77.5°	493.0	275.2	214.2	200.6	193.7
80°	370.4	197.3	163.0	149.7	149.7
82.5°	258.2	132.7	112.2	105.3	105.3
85°	146.0	74.6	64.5	64.5	64.5
87.5°	54.4	27.1	27.1	23.8	23.8
90°	2.0	24.2	66.0	62.0	64.0
92.5°	41.8	56.7	58.7	60.7	60.7
95°	98.4	117.2	120.7	120.7	117.2
97.5°	163.8	181.3	188.7	188.7	188.7
100°	239.2	254.8	260.1	260.1	258.1
102.5°	318.8	330.2	337.7	339.7	337.7
105°	405.8	411.1	415.2	418.6	418.6
107.5°	492.0	500.1	500.1	501.5	492.0
110°	575.6	586.4	586.4	586.4	581.0

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	665.9	677.4	675.4	669.9	665.9
115°	754.9	765.7	762.3	760.3	754.9
117.5°	843.1	858.0	848.6	843.1	837.8
120°	932.1	947.0	932.1	932.1	926.0
122.5°	1013.0	1031.9	1022.5	1017.0	1013.0
125°	1097.9	1114.8	1109.4	1103.4	1101.4
127.5°	1180.8	1201.7	1194.4	1186.3	1180.8
130°	1258.4	1282.6	1279.3	1275.3	1267.8
132.5°	1345.3	1364.2	1365.5	1356.1	1350.7
135°	1420.2	1441.0	1445.1	1443.0	1437.6
137.5°	1503.7	1520.6	1523.9	1522.6	1514.5
140°	1577.2	1594.1	1603.5	1603.5	1596.1
142.5°	1652.6	1669.5	1674.9	1676.9	1669.5
145°	1724.1	1737.6	1748.4	1750.4	1743.0
147.5°	1788.2	1805.0	1813.1	1816.4	1809.1
150°	1854.2	1865.6	1873.1	1879.2	1873.1
152.5°	1912.8	1924.3	1933.7	1941.2	1933.7
155°	1971.5	1976.8	1983.0	1992.4	1986.3
157.5°	2022.1	2026.1	2029.4	2043.0	2033.5
160°	2067.2	2071.2	2073.3	2084.7	2076.6
162.5°	2109.0	2109.0	2111.0	2123.7	2114.4
165°	2144.7	2142.6	2142.6	2156.2	2146.7
167.5°	2177.1	2171.0	2171.0	2184.4	2175.0
170°	2201.3	2196.0	2193.9	2207.4	2196.0
172.5°	2218.2	2212.7	2210.7	2224.2	2212.7
175°	2231.6	2226.2	2222.2	2235.6	2224.2
177.5°	2239.1	2233.6	2229.6	2241.1	2229.6
180°	2235.6	2235.6	2235.6	2235.6	2235.6

TEST NUMBER: P908136

CATALOG NUMBER: DFN2DIP-HX3F0-090D070US840-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.69	13.57	13.61	14.50	15.70	8.67	9.54	9.59	10.47	11.67
	3H	14.37	15.15	15.30	16.09	17.31	9.86	10.64	10.79	11.58	12.80
	4H	14.97	15.71	15.92	16.66	17.89	10.31	11.05	11.25	11.99	13.22
	6H	15.39	16.07	16.34	17.02	18.26	10.63	11.31	11.58	12.26	13.50
	8H	15.51	16.16	16.48	17.13	18.37	10.72	11.36	11.68	12.33	13.57
	12H	15.57	16.19	16.54	17.15	18.41	10.76	11.37	11.72	12.34	13.60
4H	2H	12.72	13.46	13.67	14.40	15.63	9.27	10.00	10.21	10.95	12.18
	3H	14.54	15.15	15.50	16.13	17.37	10.61	11.23	11.57	12.20	13.45
	4H	15.23	15.79	16.20	16.76	18.03	11.16	11.72	12.13	12.69	13.96
	6H	15.74	16.22	16.72	17.21	18.48	11.58	12.06	12.56	13.05	14.32
	8H	15.91	16.36	16.89	17.35	18.63	11.70	12.15	12.69	13.14	14.42
	12H	16.00	16.41	17.00	17.41	18.70	11.77	12.17	12.77	13.18	14.46
8H	4H	15.20	15.65	16.18	16.63	17.92	11.44	11.89	12.42	12.88	14.16
	6H	15.76	16.13	16.76	17.16	18.44	11.95	12.32	12.96	13.35	14.63
	8H	15.97	16.30	16.98	17.31	18.61	12.14	12.47	13.16	13.48	14.78
	12H	16.10	16.39	17.12	17.40	18.75	12.26	12.55	13.28	13.56	14.90
12H	4H	15.15	15.56	16.15	16.56	17.85	11.44	11.85	12.45	12.85	14.14
	6H	15.73	16.06	16.75	17.08	18.37	12.00	12.33	13.02	13.34	14.64
	8H	15.95	16.24	16.97	17.25	18.59	12.21	12.50	13.23	13.51	14.85

END OF REPORT