

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913546

Luminaire Tested: DFN2DIP-HX3F0-070D080US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913546
REPORT IS A COMBINATION OF REPORTS P899279 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D080US927-FLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11098.5 lumens
Efficiency: N/A
Efficacy: 85.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 130.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFLL

Luminous Intensity Polar Plot

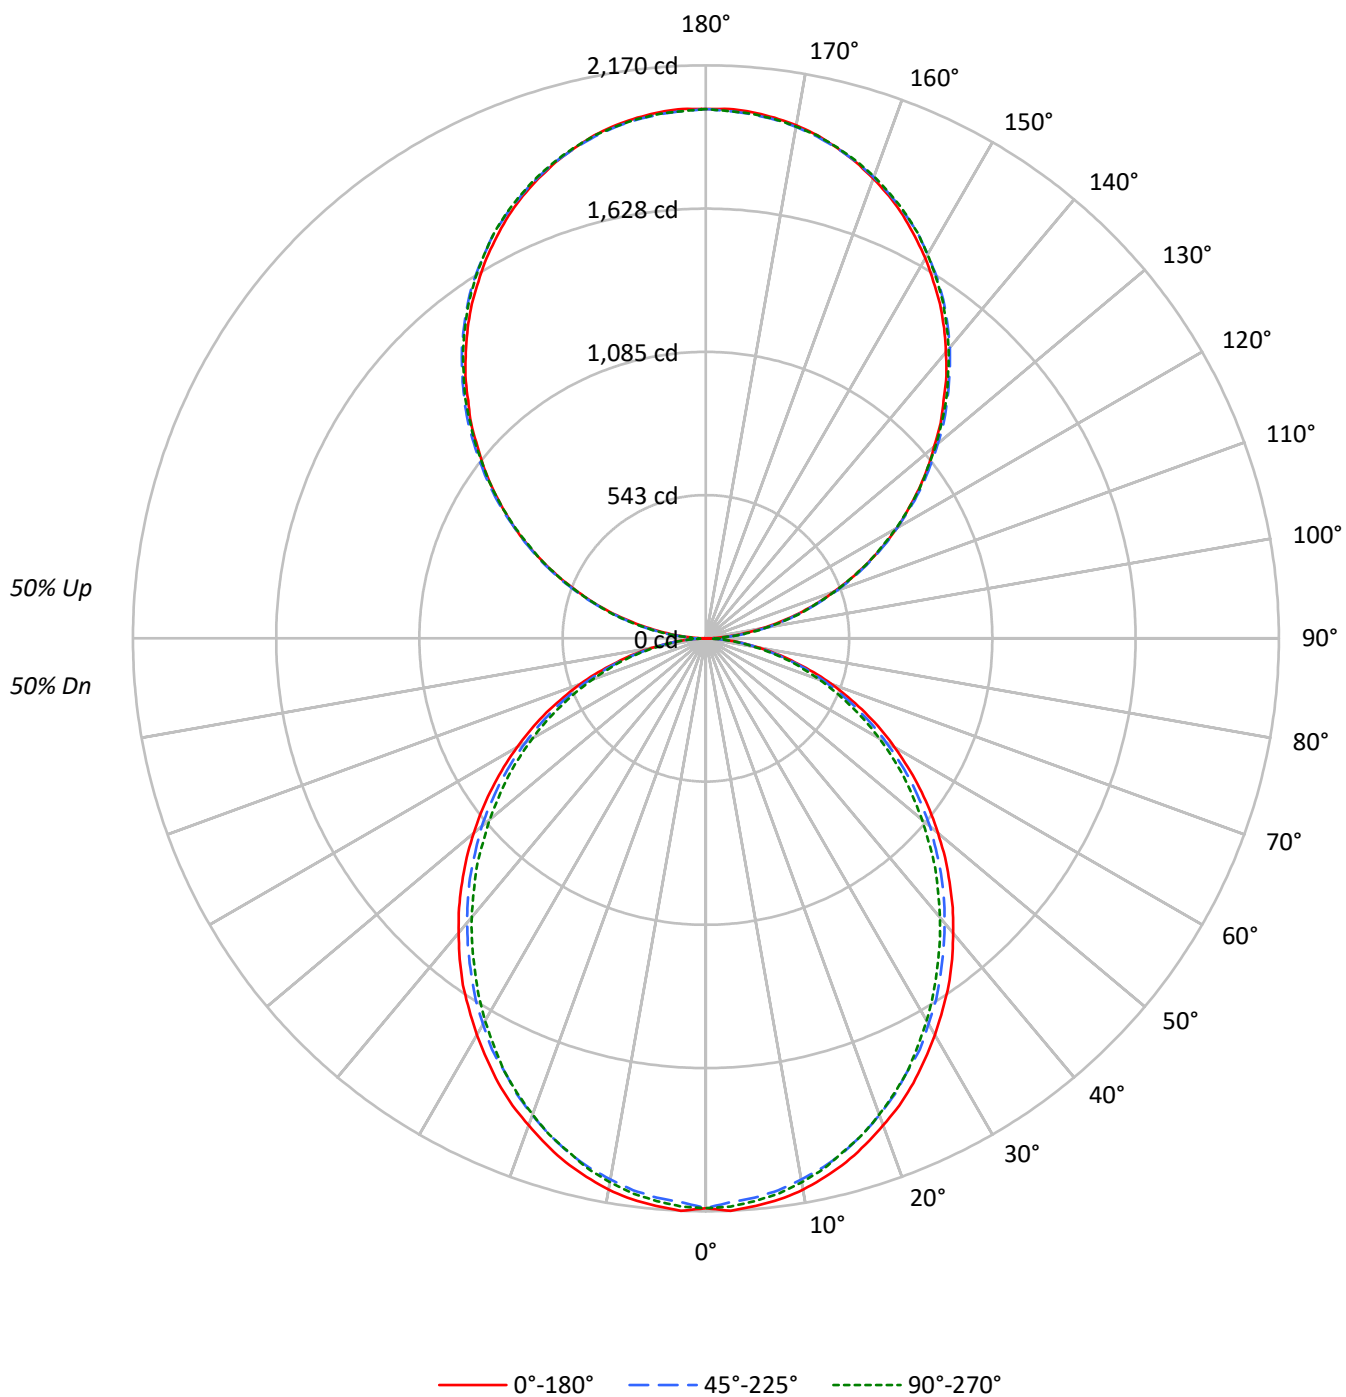

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	89	86	90	86	83	80	73	70	68	61	59	57	49	48	47
2	89	82	75	70	82	75	70	66	64	60	56	53	50	48	43	41	40
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	34
4	74	63	56	49	68	59	52	46	50	45	40	42	38	35	34	31	29
5	68	57	48	42	63	52	45	40	45	39	35	38	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	30	26	28	25	22
7	58	46	38	32	53	43	35	30	37	31	27	31	27	23	26	22	20
8	54	42	34	28	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	18	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2499	2499	2499
5°	2502	2463	2480
10°	2481	2428	2445
15°	2443	2386	2391
20°	2393	2329	2336
25°	2343	2261	2273
30°	2280	2197	2192
35°	2220	2123	2107
40°	2148	2047	2026
45°	2075	1971	1944
50°	1995	1892	1848
55°	1911	1800	1759
60°	1817	1691	1658
65°	1714	1577	1539
70°	1582	1439	1410
75°	1400	1273	1289
80°	1180	1062	1061
85°	837	703	688

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2075 cd/sqm

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.1	1.8
10°-20°	571.4	5.1
20°-30°	839.7	7.6
30°-40°	975.3	8.8
40°-50°	974.1	8.8
50°-60°	849.4	7.7
60°-70°	627.9	5.7
70°-80°	355.2	3.2
80°-90°	99.5	0.9
90°-100°	124.0	1.1
100°-110°	394.1	3.6
110°-120°	674.4	6.1
120°-130°	886.9	8.0
130°-140°	995.5	9.0
140°-150°	976.2	8.8
150°-160°	818.9	7.4
160°-170°	543.1	4.9
170°-180°	189.8	1.7
0°-30°	1614.2	14.5
0°-40°	2589.5	23.3
0°-60°	4412.9	39.8
0°-90°	5495.5	49.5
90°-120°	1192.5	10.7
90°-150°	4051.1	36.5
90°-180°	5603.0	50.5
0°-180°	11098.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2158	2158	2158	2158	2158	
5°	2158	2150	2127	2143	2139	205
15°	2054	2042	2015	2023	2013	578
25°	1859	1842	1807	1811	1807	855
35°	1604	1583	1550	1537	1527	1002
45°	1305	1291	1259	1237	1228	1007
55°	988	975	950	925	915	883
65°	666	654	633	614	604	659
75°	348	344	334	322	326	372
85°	85	83	81	75	73	95
90°	2	22	59	56	57	11
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2157.7	2157.7	2157.7	2157.7	2157.7
2.5°	2170.3	2159.9	2137.0	2157.7	2153.7
5°	2157.7	2149.6	2126.7	2143.2	2139.2
7.5°	2143.2	2130.8	2107.9	2124.7	2120.5
10°	2120.5	2105.9	2081.1	2097.6	2091.4
12.5°	2089.2	2076.9	2052.1	2062.4	2058.2
15°	2054.0	2041.7	2014.6	2023.0	2012.6
17.5°	2010.4	1998.1	1971.0	1981.4	1971.0
20°	1962.6	1950.4	1921.3	1927.5	1919.3
22.5°	1915.1	1896.4	1869.3	1869.3	1865.1
25°	1859.0	1842.5	1807.3	1811.2	1807.3
27.5°	1796.7	1782.2	1755.3	1749.1	1738.8
30°	1734.6	1717.8	1686.9	1680.7	1672.3
32.5°	1668.1	1655.8	1622.5	1610.0	1601.6
35°	1603.8	1583.2	1549.9	1537.4	1527.0
37.5°	1531.2	1512.5	1479.2	1464.7	1454.4
40°	1456.6	1439.9	1406.6	1388.1	1379.7
42.5°	1383.9	1367.2	1334.2	1313.3	1300.9
45°	1305.1	1290.6	1259.3	1236.7	1228.3
47.5°	1228.3	1213.8	1180.5	1157.6	1145.3
50°	1147.3	1136.9	1107.9	1078.9	1068.5
52.5°	1068.5	1054.0	1027.1	1004.2	989.7
55°	987.7	975.2	950.3	925.4	915.0
57.5°	906.7	896.4	869.3	844.4	836.1
60°	825.7	817.5	788.5	765.6	759.5
62.5°	746.9	732.4	711.7	691.0	682.6
65°	666.1	653.5	632.9	614.2	603.8
67.5°	583.1	572.6	554.1	539.6	531.2
70°	506.3	498.0	479.2	464.7	456.5
72.5°	427.5	419.1	408.8	394.3	388.1
75°	348.5	344.5	333.9	321.6	325.8
77.5°	278.1	269.7	265.5	259.3	253.2
80°	207.6	205.4	201.2	195.0	190.8
82.5°	141.1	141.1	139.1	130.8	130.8
85°	85.0	83.0	81.0	74.6	72.6
87.5°	37.4	33.3	29.1	22.9	20.7
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P913546

CATALOG NUMBER: DFN2DIP-HX3F0-070D080US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.36	11.22	11.33	12.20	13.48	9.94	10.79	10.90	11.77	13.05
	3H	12.02	12.79	12.99	13.77	15.07	11.55	12.32	12.52	13.30	14.60
	4H	12.60	13.33	13.59	14.32	15.62	12.13	12.86	13.12	13.85	15.16
	6H	12.99	13.66	13.99	14.66	15.98	12.52	13.19	13.52	14.19	15.51
	8H	13.09	13.73	14.10	14.74	16.06	12.62	13.26	13.63	14.27	15.59
	12H	13.14	13.75	14.15	14.75	16.09	12.66	13.27	13.67	14.28	15.62
4H	2H	10.82	11.55	11.81	12.54	13.85	10.48	11.21	11.47	12.20	13.51
	3H	12.68	13.29	13.68	14.31	15.63	12.29	12.90	13.29	13.92	15.24
	4H	13.39	13.94	14.40	14.95	16.30	12.99	13.54	14.00	14.55	15.90
	6H	13.90	14.37	14.92	15.41	16.75	13.49	13.97	14.51	15.00	16.35
	8H	14.04	14.49	15.06	15.52	16.87	13.63	14.08	14.66	15.11	16.47
	12H	14.11	14.51	15.15	15.56	16.92	13.69	14.10	14.73	15.14	16.50
8H	4H	13.58	14.03	14.60	15.06	16.41	13.22	13.67	14.24	14.70	16.06
	6H	14.20	14.57	15.25	15.64	17.00	13.84	14.21	14.89	15.28	16.64
	8H	14.42	14.74	15.47	15.80	17.17	14.05	14.38	15.11	15.43	16.81
	12H	14.54	14.83	15.60	15.88	17.30	14.16	14.45	15.22	15.50	16.92
12H	4H	13.57	13.97	14.61	15.01	16.37	13.22	13.62	14.26	14.66	16.03
	6H	14.23	14.56	15.28	15.61	16.99	13.88	14.21	14.94	15.26	16.64
	8H	14.47	14.75	15.52	15.80	17.22	14.11	14.40	15.17	15.45	16.87

END OF REPORT