

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913560

Luminaire Tested: DFN2DIP-HX3F0-080D050US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913560
REPORT IS A COMBINATION OF REPORTS P899240 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D050US927-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8892.3 lumens
Efficiency: N/A
Efficacy: 76.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 116.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLLFLL

Luminous Intensity Polar Plot

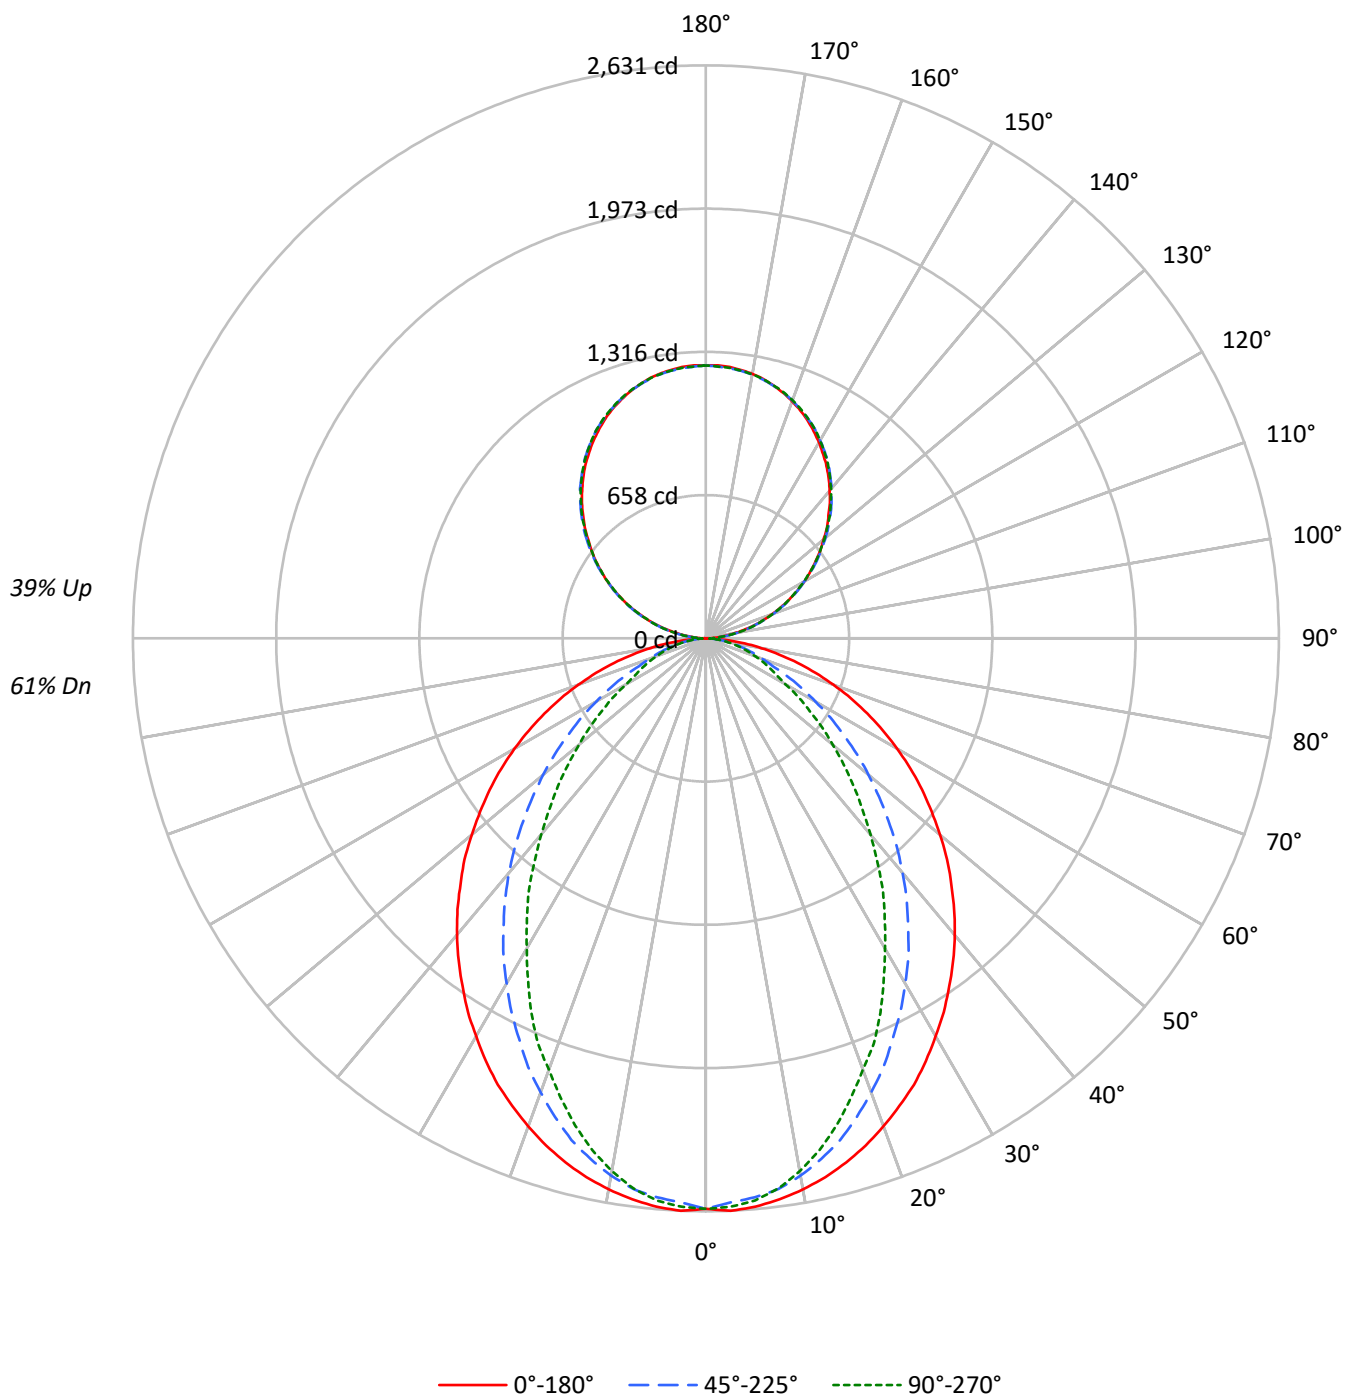

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	89	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	64	59	62	57	53	55	51	48	47	45	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	43	39	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	32
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	32	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	26	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3034	3034	3034
5°	3038	2984	3003
10°	3006	2923	2904
15°	2963	2824	2751
20°	2907	2689	2565
25°	2850	2538	2384
30°	2773	2384	2156
35°	2698	2217	1956
40°	2621	2046	1727
45°	2532	1855	1519
50°	2440	1664	1316
55°	2344	1459	1121
60°	2232	1245	921
65°	2104	1028	827
70°	1948	826	746
75°	1752	723	676
80°	1469	600	580
85°	1004	390	426

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2532 cd/sqm

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	2.8
10°-20°	673.9	7.6
20°-30°	946.1	10.6
30°-40°	1031.3	11.6
40°-50°	947.9	10.7
50°-60°	744.4	8.4
60°-70°	484.5	5.4
70°-80°	249.4	2.8
80°-90°	67.2	0.8
90°-100°	77.5	0.9
100°-110°	246.3	2.8
110°-120°	421.5	4.7
120°-130°	554.3	6.2
130°-140°	622.2	7.0
140°-150°	610.1	6.9
150°-160°	511.8	5.8
160°-170°	339.4	3.8
170°-180°	118.6	1.3
0°-30°	1865.5	21.0
0°-40°	2896.8	32.6
0°-60°	4589.2	51.6
0°-90°	5390.4	60.6
90°-120°	745.3	8.4
90°-150°	2532.0	28.5
90°-180°	3502.0	39.4
0°-180°	8892.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	1	14	37	35	36	9
95°	55	66	68	68	66	61
105°	227	230	233	234	234	240
115°	423	429	427	426	423	418
125°	615	625	622	618	617	550
135°	796	807	810	809	806	615
145°	966	974	980	981	977	604
155°	1105	1108	1111	1116	1113	508
165°	1202	1201	1201	1208	1203	339
175°	1250	1247	1245	1253	1246	119
180°	1253	1253	1253	1253	1253	

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	1.1	13.6	37.0	34.8	35.9
92.5°	23.4	31.7	32.9	34.0	34.0
95°	55.1	65.8	67.6	67.6	65.8
97.5°	91.7	101.6	105.8	105.8	105.8
100°	134.0	142.8	145.8	145.8	144.7
102.5°	178.6	185.1	189.2	190.4	189.2
105°	227.4	230.4	232.7	234.5	234.5
107.5°	275.7	280.2	280.2	281.0	275.7
110°	322.5	328.6	328.6	328.6	325.5

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	373.1	379.5	378.4	375.4	373.1
115°	422.9	429.0	427.1	426.0	422.9
117.5°	472.5	480.8	475.5	472.5	469.4
120°	522.3	530.6	522.3	522.3	518.9
122.5°	567.6	578.2	572.9	569.9	567.6
125°	615.2	624.6	621.6	618.2	617.1
127.5°	661.6	673.4	669.2	664.6	661.6
130°	705.1	718.7	716.8	714.5	710.3
132.5°	753.8	764.4	765.2	759.9	756.8
135°	795.7	807.4	809.7	808.6	805.6
137.5°	842.6	852.0	853.9	853.1	848.6
140°	883.7	893.2	898.4	898.4	894.3
142.5°	926.0	935.5	938.5	939.6	935.5
145°	966.1	973.6	979.6	980.8	976.6
147.5°	1002.0	1011.4	1015.9	1017.8	1013.6
150°	1038.9	1045.4	1049.5	1052.9	1049.5
152.5°	1071.8	1078.2	1083.5	1087.7	1083.5
155°	1104.6	1107.6	1111.0	1116.3	1112.9
157.5°	1133.0	1135.2	1137.1	1144.7	1139.4
160°	1158.2	1160.5	1161.7	1168.1	1163.6
162.5°	1181.7	1181.7	1182.8	1190.0	1184.7
165°	1201.7	1200.6	1200.6	1208.2	1202.8
167.5°	1219.8	1216.4	1216.4	1224.0	1218.7
170°	1233.4	1230.4	1229.3	1236.8	1230.4
172.5°	1242.9	1239.8	1238.7	1246.3	1239.8
175°	1250.5	1247.4	1245.2	1252.7	1246.3
177.5°	1254.6	1251.6	1249.3	1255.7	1249.3
180°	1252.7	1252.7	1252.7	1252.7	1252.7

TEST NUMBER: P913560

CATALOG NUMBER: DFN2DIP-HX3F0-080D050US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.90	12.82	12.76	13.71	14.82	7.87	8.80	8.74	9.68	10.80
	3H	13.57	14.40	14.45	15.29	16.43	9.06	9.89	9.94	10.78	11.93
	4H	14.18	14.96	15.08	15.86	17.01	9.52	10.30	10.41	11.20	12.35
	6H	14.60	15.32	15.51	16.23	17.39	9.84	10.56	10.75	11.46	12.63
	8H	14.73	15.41	15.64	16.33	17.50	9.93	10.61	10.84	11.54	12.70
	12H	14.79	15.44	15.71	16.36	17.54	9.97	10.62	10.89	11.54	12.73
4H	2H	11.92	12.71	12.83	13.60	14.76	8.48	9.26	9.38	10.16	11.31
	3H	13.75	14.40	14.67	15.33	16.50	9.83	10.48	10.74	11.41	12.57
	4H	14.44	15.03	15.37	15.96	17.15	10.38	10.97	11.30	11.89	13.08
	6H	14.96	15.47	15.89	16.42	17.61	10.80	11.30	11.73	12.25	13.45
	8H	15.13	15.60	16.07	16.55	17.75	10.92	11.40	11.86	12.34	13.55
	12H	15.22	15.65	16.18	16.61	17.82	10.99	11.42	11.95	12.38	13.59
8H	4H	14.42	14.89	15.36	15.84	17.04	10.66	11.13	11.60	12.08	13.28
	6H	14.98	15.37	15.94	16.36	17.56	11.17	11.57	12.14	12.55	13.76
	8H	15.19	15.54	16.16	16.51	17.74	11.36	11.71	12.34	12.68	13.91
	12H	15.33	15.63	16.30	16.60	17.87	11.48	11.79	12.46	12.75	14.03
12H	4H	14.37	14.80	15.33	15.76	16.97	10.67	11.09	11.62	12.06	13.27
	6H	14.95	15.30	15.93	16.28	17.50	11.22	11.57	12.19	12.54	13.77
	8H	15.17	15.48	16.15	16.45	17.72	11.43	11.74	12.41	12.71	13.98

END OF REPORT