

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P913595

Luminaire Tested: DFN2DIP-HX3F0-090D080US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P913595
REPORT IS A COMBINATION OF REPORTS P899284 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D080US927-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11668.8 lumens
Efficiency: N/A
Efficacy: 75.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 154
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLLFLL

Luminous Intensity Polar Plot

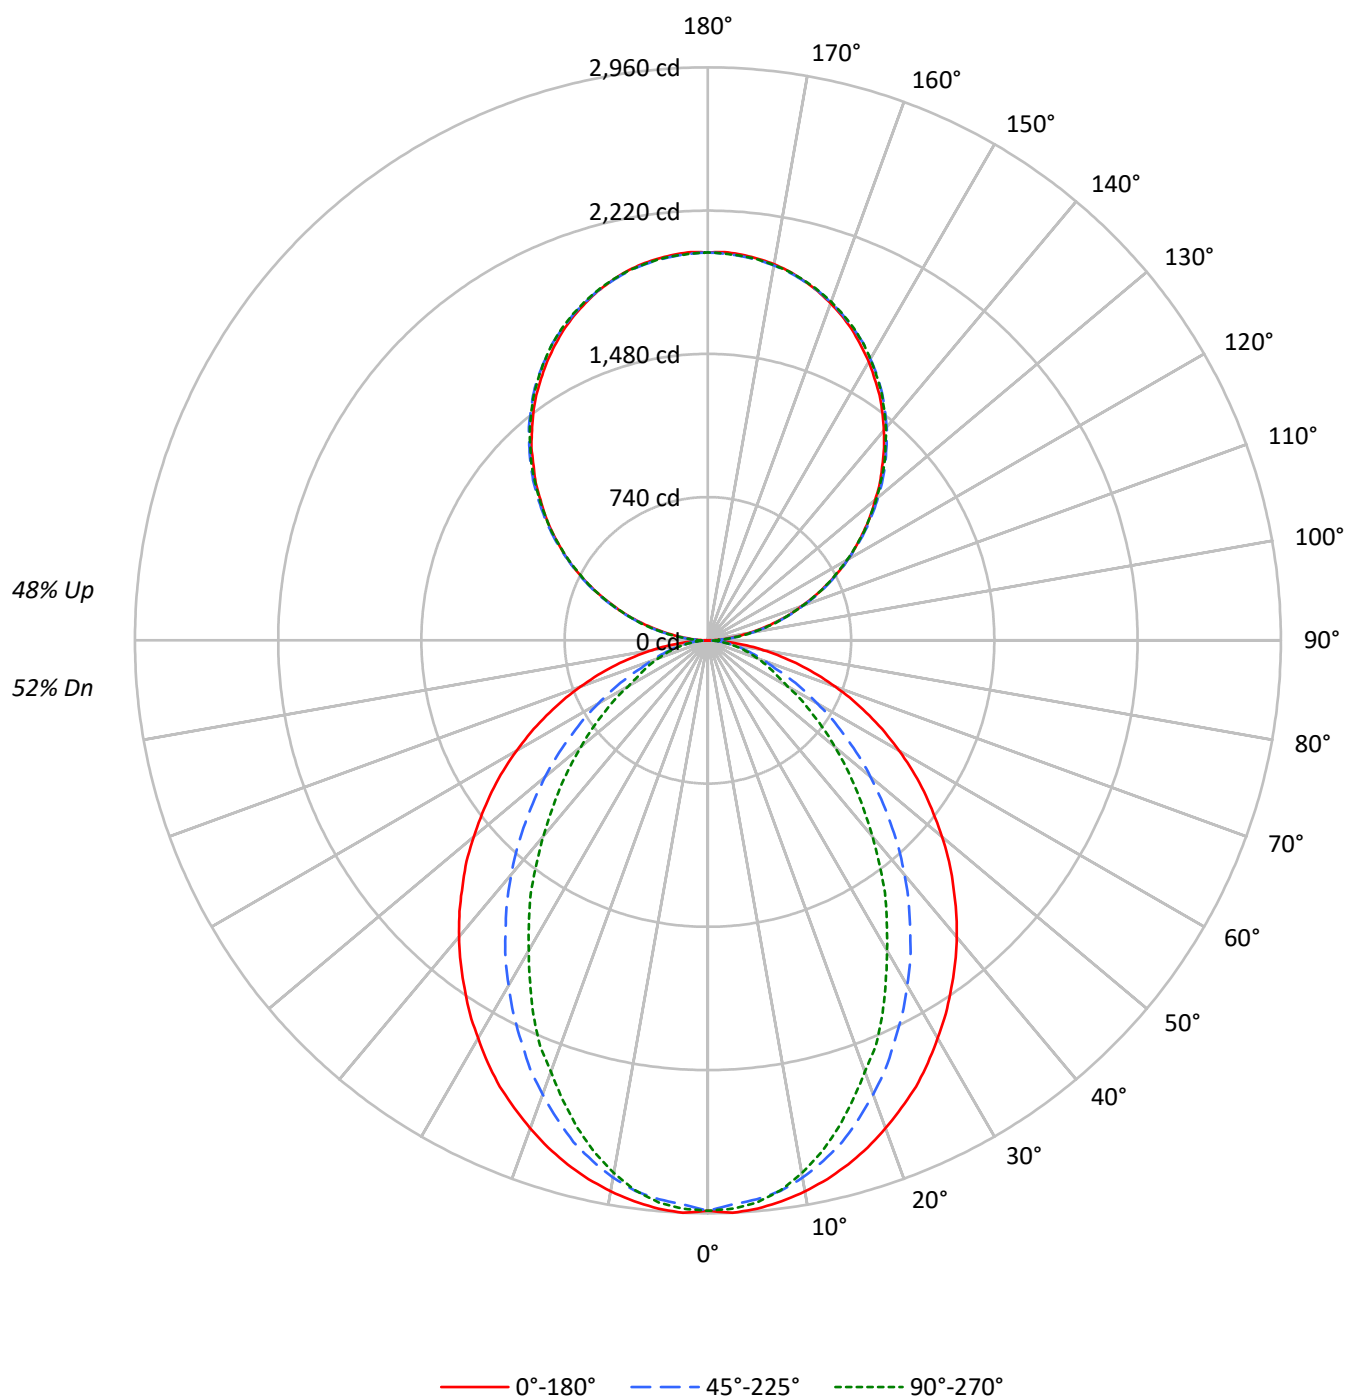

TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	84	84	84	71	71	71	58	58	58
1	99	95	91	88	91	88	84	82	75	72	70	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	46	44	43
3	83	74	66	61	76	68	62	57	59	54	50	50	46	44	42	39	37
4	76	65	58	52	70	61	54	49	53	47	43	45	41	38	37	35	32
5	70	59	51	45	65	55	48	42	47	42	38	40	36	33	34	31	28
6	65	53	45	39	60	49	42	37	43	37	33	37	32	29	31	28	25
7	60	48	40	35	55	45	38	33	39	33	29	34	29	26	28	25	23
8	56	44	36	31	51	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	37	31	26	33	27	24	28	24	21	24	21	19
10	49	37	30	25	45	34	28	24	30	25	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3413	3413	3413
5°	3417	3357	3379
10°	3382	3289	3267
15°	3334	3178	3095
20°	3271	3025	2885
25°	3206	2856	2682
30°	3120	2681	2426
35°	3035	2495	2201
40°	2949	2301	1943
45°	2849	2087	1709
50°	2745	1872	1481
55°	2637	1641	1261
60°	2511	1401	1037
65°	2367	1156	931
70°	2192	929	840
75°	1971	813	760
80°	1652	675	653
85°	1128	439	479

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2849 cd/sqm

TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.2	2.4
10°-20°	758.1	6.5
20°-30°	1064.4	9.1
30°-40°	1160.3	9.9
40°-50°	1066.4	9.1
50°-60°	837.5	7.2
60°-70°	545.1	4.7
70°-80°	280.6	2.4
80°-90°	77.3	0.7
90°-100°	124.0	1.1
100°-110°	394.1	3.4
110°-120°	674.4	5.8
120°-130°	886.9	7.6
130°-140°	995.5	8.5
140°-150°	976.2	8.4
150°-160°	818.9	7.0
160°-170°	543.1	4.7
170°-180°	189.8	1.6
0°-30°	2098.7	18.0
0°-40°	3258.9	27.9
0°-60°	5162.8	44.2
0°-90°	6065.9	52.0
90°-120°	1192.5	10.2
90°-150°	4051.1	34.7
90°-180°	5603.0	48.0
0°-180°	11668.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2947	2947	2947	2947	2947	
5°	2947	2933	2899	2923	2915	279
15°	2803	2773	2683	2632	2606	790
25°	2544	2459	2283	2173	2133	1170
35°	2192	2056	1822	1653	1595	1372
45°	1792	1613	1333	1144	1080	1384
55°	1363	1155	867	707	656	1218
65°	920	704	464	373	365	912
75°	491	304	213	195	192	519
85°	114	58	51	51	51	132
90°	2	22	59	56	57	11
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	

TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2946.7	2946.7	2946.7	2946.7	2946.7
2.5°	2960.0	2946.7	2917.2	2944.1	2938.8
5°	2946.7	2933.4	2898.6	2922.6	2914.7
7.5°	2922.6	2906.8	2869.4	2879.9	2866.6
10°	2890.7	2872.0	2818.8	2810.6	2794.7
12.5°	2850.7	2826.7	2754.6	2738.7	2709.3
15°	2802.7	2773.3	2682.7	2632.0	2605.5
17.5°	2746.7	2704.0	2591.9	2533.3	2490.6
20°	2682.7	2629.2	2495.9	2429.5	2370.6
22.5°	2613.4	2552.0	2397.2	2306.7	2266.8
25°	2544.1	2458.6	2282.7	2173.4	2133.3
27.5°	2461.5	2370.6	2176.0	2050.6	1989.2
30°	2373.5	2271.9	2058.6	1922.8	1850.6
32.5°	2288.0	2165.2	1946.8	1786.7	1719.9
35°	2192.1	2056.0	1821.5	1653.4	1594.6
37.5°	2098.7	1951.9	1704.1	1519.9	1453.4
40°	2000.0	1840.2	1581.3	1392.0	1322.7
42.5°	1898.7	1728.1	1458.7	1261.3	1194.8
45°	1792.1	1613.3	1333.4	1143.8	1079.9
47.5°	1690.8	1501.5	1213.5	1023.9	965.4
50°	1578.7	1389.4	1096.1	911.9	856.1
52.5°	1469.3	1269.2	984.0	808.0	757.4
55°	1362.6	1154.6	866.6	706.8	656.1
57.5°	1253.4	1040.1	762.8	613.4	570.7
60°	1141.3	928.0	653.3	517.5	474.8
62.5°	1032.1	818.8	559.9	432.1	410.8
65°	920.0	703.9	464.0	373.4	365.3
67.5°	813.4	597.2	373.4	327.9	320.0
70°	701.4	493.4	309.3	282.7	271.9
72.5°	594.7	397.2	258.6	237.3	232.0
75°	490.6	303.9	213.3	194.6	192.1
77.5°	386.7	215.9	168.0	157.3	151.9
80°	290.6	154.8	127.9	117.4	117.4
82.5°	202.6	104.1	88.0	82.6	82.6
85°	114.5	58.5	50.6	50.6	50.6
87.5°	42.7	21.2	21.2	18.7	18.7
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9



TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3

TEST NUMBER: P913595

CATALOG NUMBER: DFN2DIP-HX3F0-090D080US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.55	12.40	12.50	13.36	14.60	7.53	8.37	8.47	9.33	10.58
	3H	13.22	13.98	14.18	14.95	16.22	8.71	9.47	9.67	10.44	11.71
	4H	13.83	14.54	14.80	15.51	16.79	9.16	9.88	10.13	10.85	12.13
	6H	14.24	14.90	15.23	15.88	17.17	9.48	10.14	10.46	11.11	12.40
	8H	14.37	14.99	15.36	15.99	17.27	9.57	10.19	10.56	11.19	12.47
	12H	14.42	15.02	15.42	16.01	17.32	9.61	10.21	10.60	11.19	12.50
4H	2H	11.57	12.29	12.55	13.26	14.54	8.12	8.84	9.10	9.81	11.09
	3H	13.39	13.99	14.38	14.99	16.28	9.47	10.06	10.45	11.06	12.35
	4H	14.08	14.62	15.08	15.62	16.93	10.01	10.55	11.01	11.55	12.86
	6H	14.59	15.05	15.60	16.07	17.39	10.43	10.89	11.43	11.91	13.22
	8H	14.76	15.19	15.77	16.21	17.53	10.55	10.99	11.56	12.00	13.33
	12H	14.85	15.24	15.88	16.27	17.60	10.62	11.01	11.64	12.04	13.37
8H	4H	14.05	14.48	15.06	15.49	16.82	10.29	10.72	11.30	11.74	13.06
	6H	14.61	14.97	15.64	16.02	17.34	10.80	11.16	11.83	12.21	13.54
	8H	14.82	15.13	15.86	16.17	17.52	10.99	11.31	12.03	12.34	13.69
	12H	14.95	15.23	15.99	16.26	17.65	11.10	11.38	12.15	12.42	13.80
12H	4H	14.00	14.39	15.03	15.42	16.75	10.29	10.69	11.32	11.71	13.04
	6H	14.58	14.90	15.62	15.94	17.28	10.85	11.17	11.89	12.20	13.55
	8H	14.80	15.08	15.84	16.11	17.50	11.06	11.33	12.10	12.37	13.75

END OF REPORT