

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916164

Luminaire Tested: DFN2DIP-HX3F0-030D040US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916164
REPORT IS A COMBINATION OF REPORTS P899216 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-030D040US930-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 4965.2 lumens
Efficiency: N/A
Efficacy: 93.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 53.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLLFLL

Luminous Intensity Polar Plot

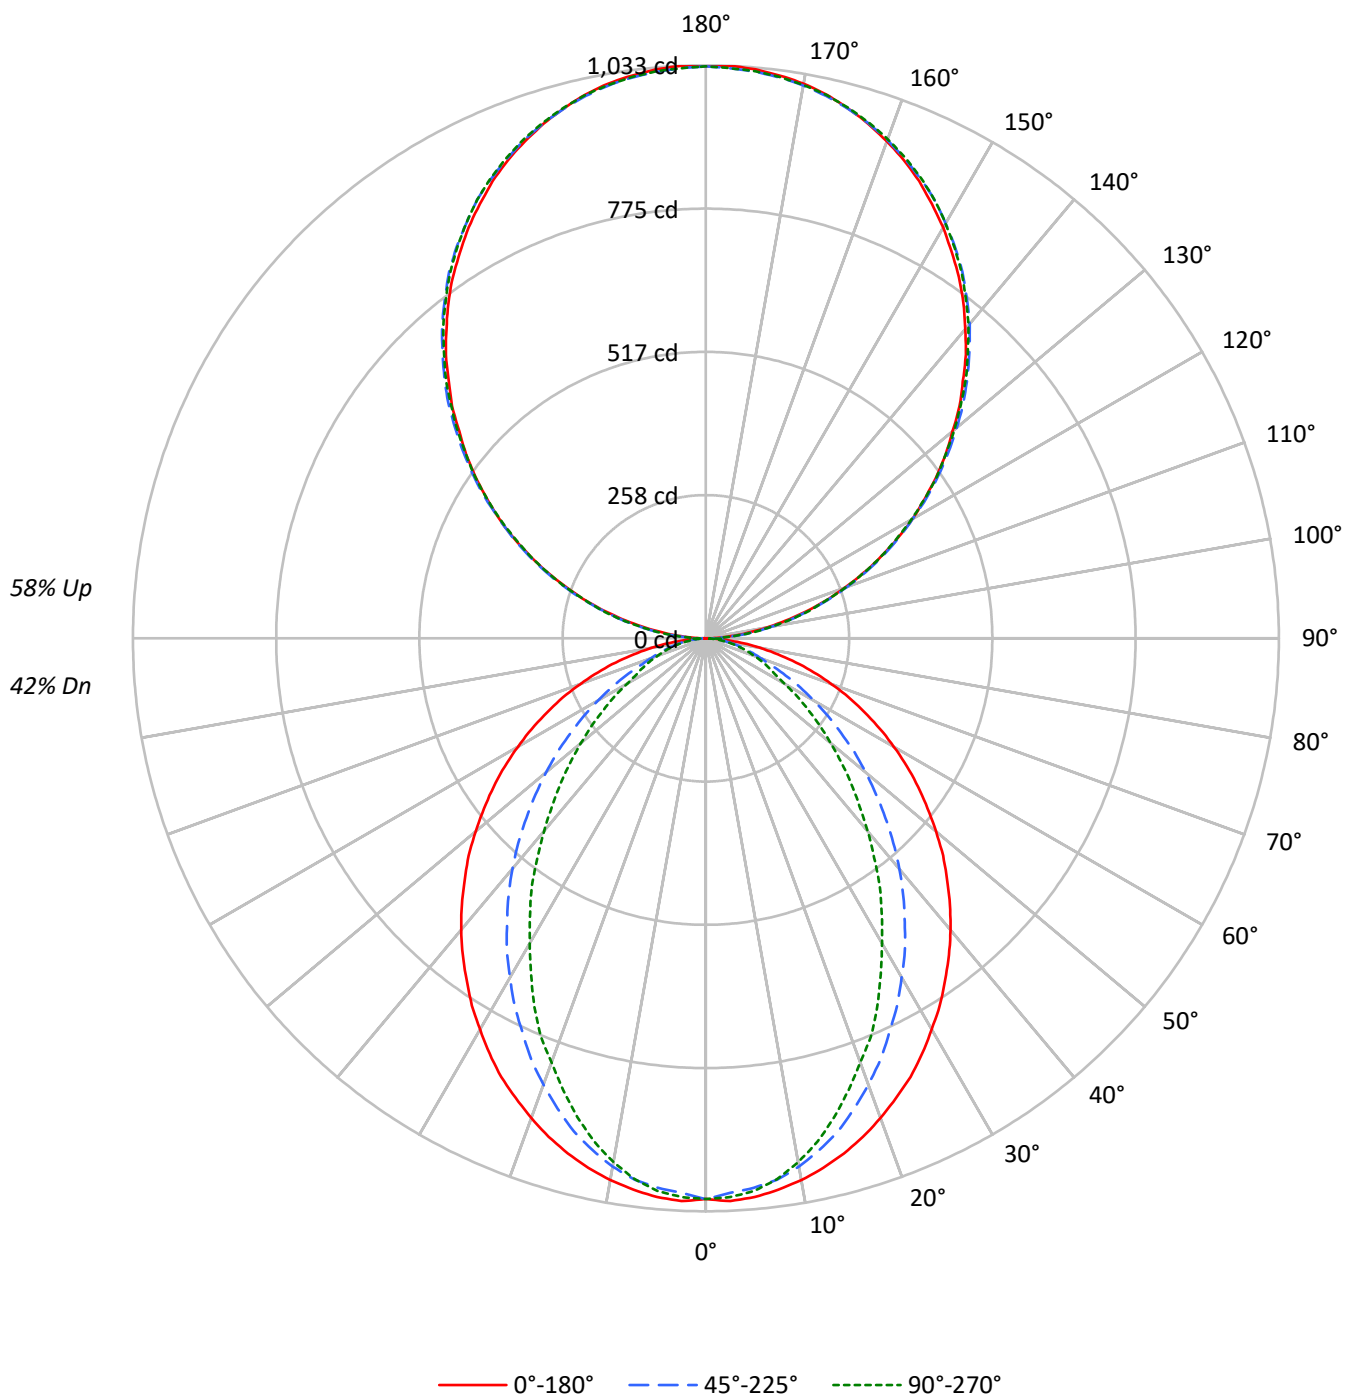

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1171	1171	1171
5°	1172	1152	1159
10°	1160	1128	1121
15°	1144	1090	1062
20°	1122	1038	990
25°	1100	980	920
30°	1070	920	832
35°	1041	856	755
40°	1012	790	666
45°	977	716	586
50°	942	642	508
55°	904	563	433
60°	861	480	356
65°	812	397	319
70°	752	319	288
75°	676	279	261
80°	567	232	224
85°	387	151	165

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 977 cd/sqm

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	94.7	1.9
10°-20°	260.1	5.2
20°-30°	365.1	7.4
30°-40°	398.0	8.0
40°-50°	365.8	7.4
50°-60°	287.3	5.8
60°-70°	187.0	3.8
70°-80°	96.3	1.9
80°-90°	27.5	0.6
90°-100°	63.8	1.3
100°-110°	202.8	4.1
110°-120°	347.0	7.0
120°-130°	456.4	9.2
130°-140°	512.3	10.3
140°-150°	502.4	10.1
150°-160°	421.4	8.5
160°-170°	279.5	5.6
170°-180°	97.7	2.0
0°-30°	720.0	14.5
0°-40°	1118.0	22.5
0°-60°	1771.2	35.7
0°-90°	2081.9	41.9
90°-120°	613.6	12.4
90°-150°	2084.7	42.0
90°-180°	2883.0	58.1
0°-180°	4965.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1011	1011	1011	1011	1011	
5°	1011	1006	994	1003	1000	96
15°	962	951	920	903	894	271
25°	873	843	783	746	732	401
35°	752	705	625	567	547	471
45°	615	553	458	392	370	475
55°	467	396	297	242	225	418
65°	316	242	159	128	125	313
75°	168	104	73	67	66	178
85°	39	20	17	17	17	45
90°	1	11	30	29	30	5
95°	45	54	56	56	54	51
105°	187	190	192	193	193	198
115°	348	353	352	351	348	344
125°	506	514	512	509	508	453
135°	655	665	667	666	663	506
145°	795	802	807	808	804	497
155°	910	912	915	919	916	419
165°	989	988	988	995	990	279
175°	1030	1027	1025	1031	1026	98
180°	1031	1031	1031	1031	1031	

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1010.9	1010.9	1010.9	1010.9	1010.9
2.5°	1015.5	1010.9	1000.8	1010.0	1008.2
5°	1010.9	1006.3	994.4	1002.7	999.9
7.5°	1002.7	997.2	984.4	988.0	983.4
10°	991.6	985.3	967.0	964.2	958.8
12.5°	978.0	969.7	945.0	939.5	929.4
15°	961.5	951.4	920.3	902.9	893.8
17.5°	942.2	927.6	889.2	869.1	854.4
20°	920.3	902.0	856.2	833.5	813.3
22.5°	896.6	875.5	822.4	791.3	777.6
25°	872.8	843.4	783.1	745.6	731.8
27.5°	844.4	813.3	746.5	703.5	682.4
30°	814.2	779.4	706.2	659.7	634.9
32.5°	784.9	742.8	667.9	612.9	590.0
35°	752.0	705.3	624.8	567.2	547.1
37.5°	720.0	669.6	584.6	521.4	498.6
40°	686.2	631.3	542.5	477.5	453.8
42.5°	651.3	592.9	500.4	432.7	409.9
45°	614.8	553.4	457.5	392.4	370.5
47.5°	580.0	515.1	416.3	351.2	331.2
50°	541.6	476.6	376.0	312.8	293.7
52.5°	504.0	435.5	337.6	277.2	259.8
55°	467.4	396.1	297.3	242.5	225.1
57.5°	430.0	356.8	261.7	210.4	195.8
60°	391.5	318.4	224.1	177.5	162.9
62.5°	354.1	280.9	192.1	148.2	141.0
65°	315.6	241.5	159.1	128.1	125.3
67.5°	279.1	204.9	128.1	112.5	109.7
70°	240.6	169.3	106.1	96.9	93.3
72.5°	204.0	136.2	88.7	81.4	79.6
75°	168.3	104.3	73.2	66.8	65.9
77.5°	132.6	74.0	57.6	54.0	52.1
80°	99.7	53.1	43.9	40.3	40.3
82.5°	69.5	35.7	30.2	28.4	28.4
85°	39.3	20.1	17.4	17.4	17.4
87.5°	14.7	7.3	7.3	6.4	6.4
90°	0.9	11.2	30.5	28.6	29.5
92.5°	19.2	26.1	27.1	28.0	28.0
95°	45.4	54.1	55.7	55.7	54.1
97.5°	75.6	83.6	87.1	87.1	87.1
100°	110.4	117.6	120.0	120.0	119.1
102.5°	147.1	152.4	155.8	156.7	155.8
105°	187.2	189.6	191.5	193.1	193.1
107.5°	227.0	230.7	230.7	231.3	227.0
110°	265.5	270.5	270.5	270.5	268.1

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	307.2	312.5	311.5	309.1	307.2
115°	348.2	353.3	351.6	350.7	348.2
117.5°	389.0	395.8	391.5	389.0	386.5
120°	430.1	436.8	430.1	430.1	427.2
122.5°	467.3	476.1	471.7	469.2	467.3
125°	506.5	514.3	511.8	509.0	508.1
127.5°	544.8	554.4	551.0	547.2	544.8
130°	580.5	591.7	590.2	588.3	584.9
132.5°	620.6	629.3	630.0	625.6	623.1
135°	655.2	664.8	666.7	665.7	663.2
137.5°	693.7	701.5	703.0	702.4	698.7
140°	727.6	735.4	739.7	739.7	736.3
142.5°	762.5	770.2	772.7	773.6	770.2
145°	795.4	801.6	806.6	807.6	804.1
147.5°	824.9	832.7	836.4	838.0	834.5
150°	855.4	860.7	864.1	866.9	864.1
152.5°	882.5	887.7	892.1	895.5	892.1
155°	909.5	912.0	914.8	919.2	916.3
157.5°	932.9	934.7	936.2	942.5	938.1
160°	953.7	955.5	956.4	961.7	958.0
162.5°	972.9	972.9	973.9	979.7	975.4
165°	989.4	988.5	988.5	994.7	990.3
167.5°	1004.4	1001.5	1001.5	1007.8	1003.4
170°	1015.5	1013.0	1012.1	1018.3	1013.0
172.5°	1023.3	1020.8	1019.9	1026.1	1020.8
175°	1029.6	1027.0	1025.2	1031.4	1026.1
177.5°	1033.0	1030.5	1028.6	1033.9	1028.6
180°	1031.4	1031.4	1031.4	1031.4	1031.4

TEST NUMBER: P916164

CATALOG NUMBER: DFN2DIP-HX3F0-030D040US930-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.85	7.62	7.88	8.65	10.03	2.82	3.59	3.85	4.62	6.01
	3H	8.51	9.20	9.55	10.24	11.65	4.00	4.69	5.04	5.73	7.13
	4H	9.11	9.76	10.16	10.81	12.22	4.45	5.10	5.50	6.14	7.55
	6H	9.52	10.12	10.59	11.17	12.59	4.76	5.36	5.82	6.41	7.83
	8H	9.65	10.21	10.71	11.28	12.70	4.85	5.42	5.91	6.48	7.90
	12H	9.70	10.24	10.77	11.30	12.74	4.89	5.43	5.96	6.49	7.93
4H	2H	6.86	7.51	7.91	8.55	9.96	3.41	4.06	4.46	5.10	6.51
	3H	8.67	9.21	9.74	10.28	11.71	4.74	5.29	5.81	6.36	7.78
	4H	9.36	9.85	10.43	10.91	12.36	5.29	5.78	6.36	6.84	8.29
	6H	9.86	10.28	10.94	11.37	12.81	5.70	6.12	6.78	7.21	8.65
	8H	10.03	10.43	11.11	11.50	12.96	5.82	6.22	6.90	7.30	8.75
	12H	10.12	10.48	11.21	11.57	13.03	5.88	6.24	6.98	7.33	8.79
8H	4H	9.32	9.71	10.40	10.79	12.25	5.56	5.95	6.64	7.03	8.49
	6H	9.87	10.20	10.98	11.32	12.77	6.07	6.40	7.17	7.52	8.97
	8H	10.08	10.37	11.19	11.47	12.95	6.26	6.54	7.37	7.65	9.12
	12H	10.21	10.47	11.33	11.56	13.08	6.37	6.62	7.48	7.72	9.23
12H	4H	9.27	9.62	10.36	10.72	12.18	5.56	5.92	6.66	7.01	8.47
	6H	9.85	10.13	10.96	11.24	12.71	6.11	6.40	7.22	7.50	8.98
	8H	10.06	10.31	11.17	11.41	12.92	6.32	6.57	7.43	7.67	9.18

END OF REPORT