

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916267

Luminaire Tested: DFN2DIP-HX3F0-070D060US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916267
REPORT IS A COMBINATION OF REPORTS P900771 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D060US930-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10492.9 lumens
Efficiency: N/A
Efficacy: 91.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 114.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

Luminous Intensity Polar Plot

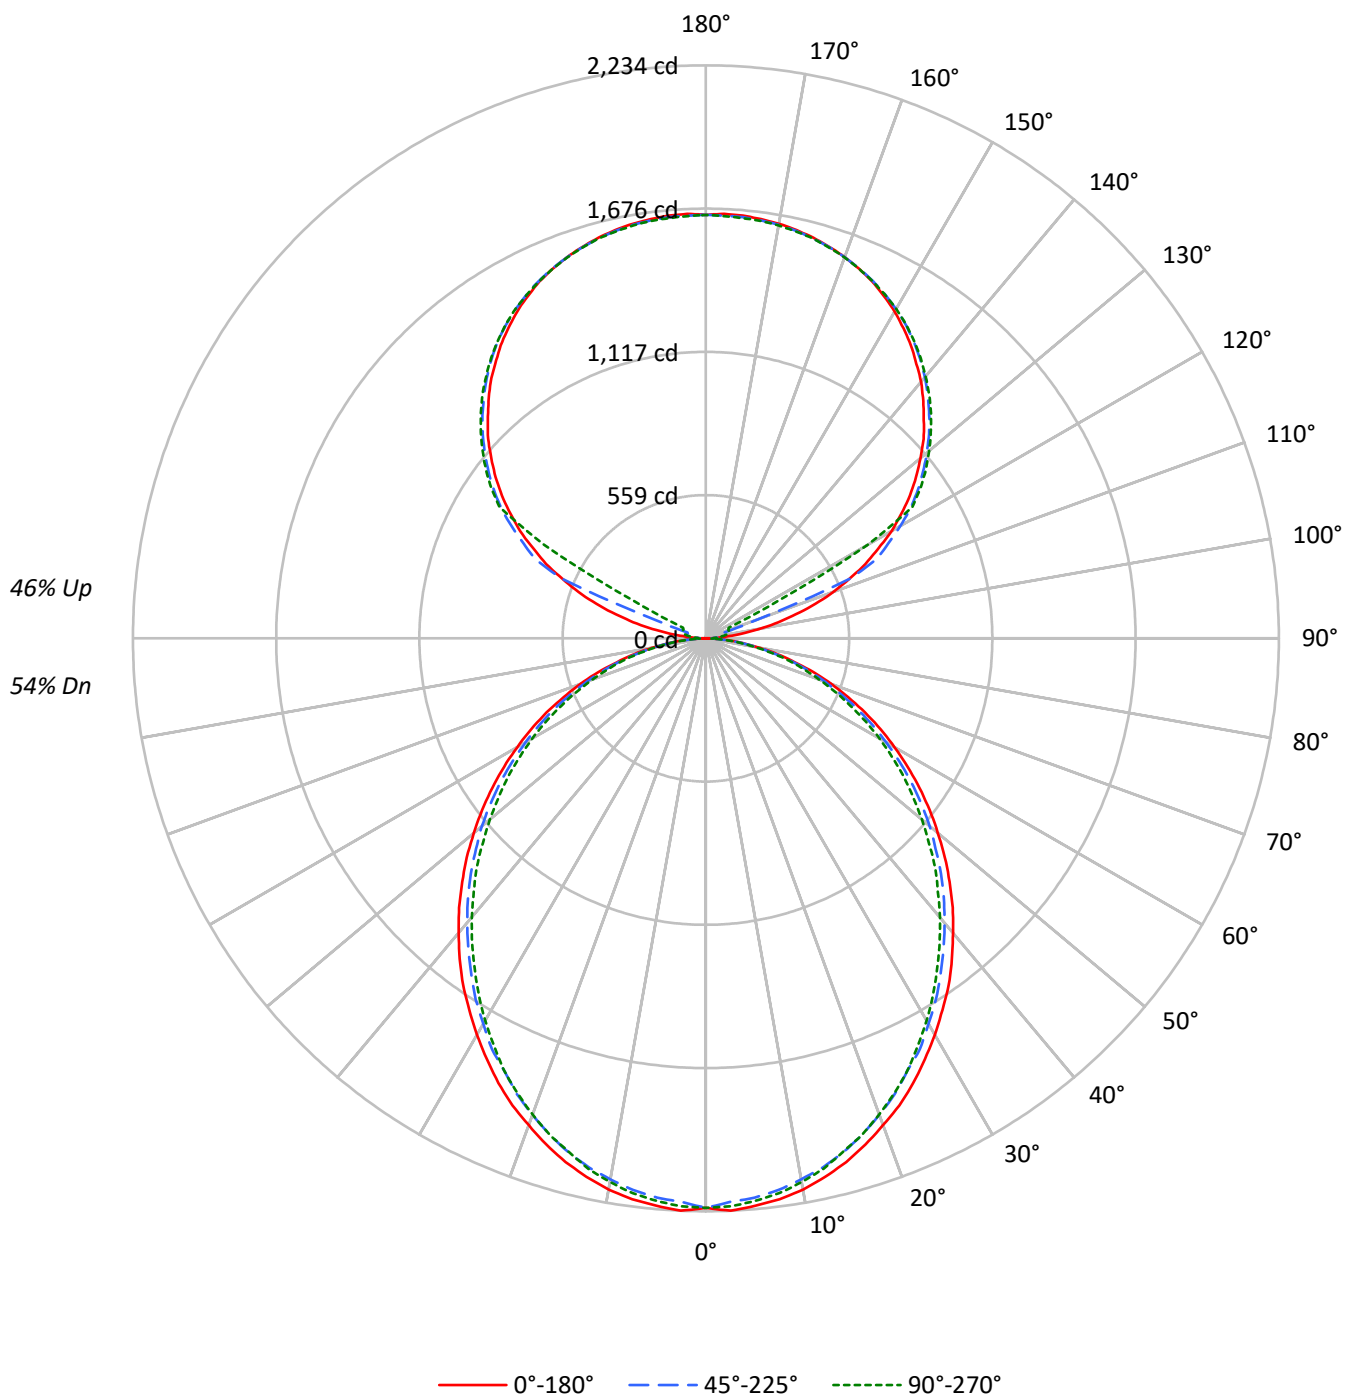

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	60	60	60
1	99	94	90	87	91	88	84	81	75	73	70	63	62	60	53	52	50
2	90	82	76	71	83	77	71	67	66	62	58	56	53	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	46	42	41	38	36
4	75	64	56	50	69	60	53	47	52	46	42	44	40	36	37	34	31
5	69	57	49	43	64	53	46	41	46	40	36	39	35	32	33	30	27
6	63	51	43	37	59	48	41	35	42	36	31	36	31	28	30	27	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	28	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	32	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	27	22	29	24	20	25	21	18	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2572	2572	2572
5°	2575	2535	2552
10°	2553	2499	2516
15°	2515	2456	2461
20°	2463	2397	2404
25°	2411	2327	2339
30°	2347	2261	2256
35°	2285	2184	2169
40°	2210	2107	2086
45°	2135	2029	2000
50°	2053	1947	1902
55°	1967	1852	1811
60°	1870	1740	1707
65°	1764	1623	1583
70°	1628	1481	1451
75°	1441	1310	1326
80°	1215	1093	1092
85°	862	724	709

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2135 cd/sqm

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	209.0	2.0
10°-20°	588.1	5.6
20°-30°	864.2	8.2
30°-40°	1003.7	9.6
40°-50°	1002.5	9.6
50°-60°	874.2	8.3
60°-70°	646.2	6.2
70°-80°	365.6	3.5
80°-90°	99.4	0.9
90°-100°	54.4	0.5
100°-110°	202.9	1.9
110°-120°	538.2	5.1
120°-130°	892.7	8.5
130°-140°	948.2	9.0
140°-150°	881.3	8.4
150°-160°	708.5	6.8
160°-170°	456.5	4.4
170°-180°	157.1	1.5
0°-30°	1661.3	15.8
0°-40°	2665.1	25.4
0°-60°	4541.7	43.3
0°-90°	5652.9	53.9
90°-120°	795.6	7.6
90°-150°	3517.8	33.5
90°-180°	4840.0	46.1
0°-180°	10492.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2221	2221	2221	2221	2221	
5°	2221	2212	2189	2206	2202	211
15°	2114	2101	2073	2082	2071	595
25°	1913	1896	1860	1864	1860	880
35°	1651	1629	1595	1582	1572	1031
45°	1343	1328	1296	1273	1264	1037
55°	1016	1004	978	952	942	909
65°	686	673	651	632	621	678
75°	359	355	344	331	335	383
85°	88	85	83	77	75	98
90°	1	14	24	30	32	10
95°	78	38	47	53	51	92
105°	363	399	73	86	91	388
115°	687	707	737	184	98	676
125°	971	987	1009	1018	1021	866
135°	1202	1221	1232	1244	1241	928
145°	1394	1393	1413	1422	1416	872
155°	1535	1524	1539	1546	1536	707
165°	1618	1610	1614	1622	1614	457
175°	1654	1646	1648	1657	1645	157
180°	1651	1651	1651	1651	1651	

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2220.6	2220.6	2220.6	2220.6	2220.6
2.5°	2233.6	2222.9	2199.3	2220.6	2216.6
5°	2220.6	2212.3	2188.7	2205.7	2201.6
7.5°	2205.7	2193.0	2169.4	2186.7	2182.4
10°	2182.4	2167.4	2141.8	2158.8	2152.5
12.5°	2150.2	2137.5	2111.9	2122.5	2118.2
15°	2114.0	2101.3	2073.4	2082.0	2071.3
17.5°	2069.1	2056.4	2028.5	2039.2	2028.5
20°	2019.9	2007.3	1977.3	1983.7	1975.3
22.5°	1971.0	1951.7	1923.9	1923.9	1919.5
25°	1913.3	1896.2	1860.0	1864.1	1860.0
27.5°	1849.1	1834.2	1806.5	1800.2	1789.5
30°	1785.3	1768.0	1736.1	1729.7	1721.1
32.5°	1716.8	1704.1	1669.9	1657.0	1648.4
35°	1650.7	1629.4	1595.1	1582.2	1571.6
37.5°	1575.9	1556.6	1522.4	1507.5	1496.8
40°	1499.1	1481.9	1447.6	1428.6	1420.0
42.5°	1424.3	1407.1	1373.1	1351.6	1338.9
45°	1343.2	1328.3	1296.1	1272.8	1264.1
47.5°	1264.1	1249.2	1215.0	1191.4	1178.8
50°	1180.8	1170.1	1140.2	1110.4	1099.7
52.5°	1099.7	1084.8	1057.1	1033.6	1018.6
55°	1016.5	1003.6	978.0	952.4	941.8
57.5°	933.2	922.5	894.6	869.0	860.5
60°	849.8	841.4	811.5	788.0	781.6
62.5°	768.7	753.7	732.5	711.2	702.5
65°	685.6	672.6	651.3	632.1	621.4
67.5°	600.1	589.3	570.2	555.3	546.7
70°	521.1	512.5	493.2	478.3	469.9
72.5°	439.9	431.4	420.7	405.8	399.4
75°	358.6	354.6	343.6	331.0	335.3
77.5°	286.2	277.5	273.2	266.8	260.6
80°	213.6	211.4	207.1	200.7	196.4
82.5°	145.2	145.2	143.2	134.6	134.6
85°	87.5	85.4	83.4	76.8	74.8
87.5°	38.5	34.2	29.9	23.6	21.3
90°	1.1	14.3	23.8	29.9	32.2
92.5°	29.9	25.1	28.6	31.1	32.2
95°	77.6	38.2	46.6	52.7	51.4
97.5°	139.7	41.8	60.8	64.6	65.7
100°	211.5	47.8	68.1	77.6	80.0
102.5°	290.2	288.0	70.5	83.6	87.2
105°	363.1	399.0	72.9	85.9	90.8
107.5°	448.0	477.8	75.3	88.4	93.2
110°	529.3	554.2	209.1	89.7	94.3

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	605.7	627.1	606.8	91.9	95.6
115°	686.9	707.2	737.1	184.0	98.0
117.5°	757.3	781.2	801.6	630.7	317.7
120°	836.3	854.1	875.7	890.0	728.7
122.5°	903.0	922.2	946.2	953.2	954.6
125°	971.2	986.8	1009.4	1017.8	1021.3
127.5°	1033.3	1050.0	1068.0	1079.9	1081.1
130°	1091.8	1111.0	1124.1	1137.3	1136.1
132.5°	1151.6	1167.2	1180.2	1191.0	1189.8
135°	1201.8	1221.0	1231.6	1243.7	1241.2
137.5°	1254.3	1268.6	1280.7	1292.6	1289.1
140°	1305.6	1315.3	1328.4	1339.1	1333.2
142.5°	1348.7	1357.1	1372.6	1382.1	1376.1
145°	1394.2	1392.9	1413.2	1421.6	1415.6
147.5°	1433.5	1429.9	1450.2	1456.1	1451.5
150°	1471.8	1463.4	1482.5	1489.6	1483.7
152.5°	1504.0	1494.4	1512.3	1519.6	1511.2
155°	1535.0	1524.4	1538.7	1545.8	1536.3
157.5°	1560.2	1550.6	1561.4	1569.8	1560.2
160°	1581.7	1574.4	1581.7	1588.8	1580.5
162.5°	1600.7	1593.6	1599.5	1607.9	1597.2
165°	1617.5	1610.4	1613.9	1622.3	1613.9
167.5°	1630.6	1623.4	1627.1	1635.5	1624.6
170°	1641.4	1634.2	1636.6	1644.9	1634.2
172.5°	1648.5	1641.4	1643.8	1652.2	1641.4
175°	1654.5	1646.1	1648.5	1656.8	1644.9
177.5°	1656.8	1648.5	1649.8	1658.2	1647.4
180°	1650.9	1650.9	1650.9	1650.9	1650.9

TEST NUMBER: P916267

CATALOG NUMBER: DFN2DIP-HX3F0-070D060US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.86	11.76	11.78	12.70	13.92	10.43	11.33	11.36	12.27	13.49
	3H	12.52	13.32	13.45	14.27	15.51	12.05	12.85	12.98	13.80	15.04
	4H	13.10	13.86	14.05	14.82	16.07	12.63	13.39	13.58	14.35	15.60
	6H	13.50	14.20	14.46	15.16	16.42	13.03	13.73	13.99	14.69	15.95
	8H	13.60	14.27	14.57	15.25	16.50	13.13	13.80	14.10	14.78	16.03
	12H	13.65	14.28	14.62	15.25	16.54	13.17	13.81	14.14	14.78	16.06
4H	2H	11.32	12.09	12.28	13.04	14.29	10.98	11.74	11.94	12.70	13.95
	3H	13.19	13.82	14.15	14.81	16.07	12.80	13.43	13.76	14.42	15.68
	4H	13.90	14.48	14.87	15.45	16.74	13.49	14.07	14.47	15.05	16.34
	6H	14.41	14.91	15.39	15.91	17.19	14.00	14.50	14.99	15.50	16.79
	8H	14.55	15.02	15.54	16.02	17.31	14.14	14.61	15.13	15.61	16.91
	12H	14.62	15.05	15.63	16.06	17.36	14.21	14.63	15.21	15.64	16.95
8H	4H	14.09	14.56	15.08	15.56	16.85	13.73	14.20	14.72	15.20	16.50
	6H	14.72	15.10	15.73	16.14	17.44	14.36	14.74	15.37	15.78	17.08
	8H	14.93	15.27	15.95	16.30	17.61	14.57	14.91	15.59	15.93	17.25
	12H	15.06	15.36	16.08	16.38	17.74	14.68	14.98	15.71	16.00	17.36
12H	4H	14.08	14.50	15.09	15.51	16.82	13.73	14.15	14.74	15.16	16.47
	6H	14.74	15.09	15.77	16.11	17.43	14.40	14.74	15.42	15.76	17.08
	8H	14.98	15.28	16.01	16.30	17.66	14.63	14.93	15.65	15.95	17.31

END OF REPORT