

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916295

Luminaire Tested: DFN2DIP-HX3F0-080D070US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916295
REPORT IS A COMBINATION OF REPORTS P900787 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D070US930-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12107.2 lumens
Efficiency: N/A
Efficacy: 90.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 133.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLLONL

Luminous Intensity Polar Plot

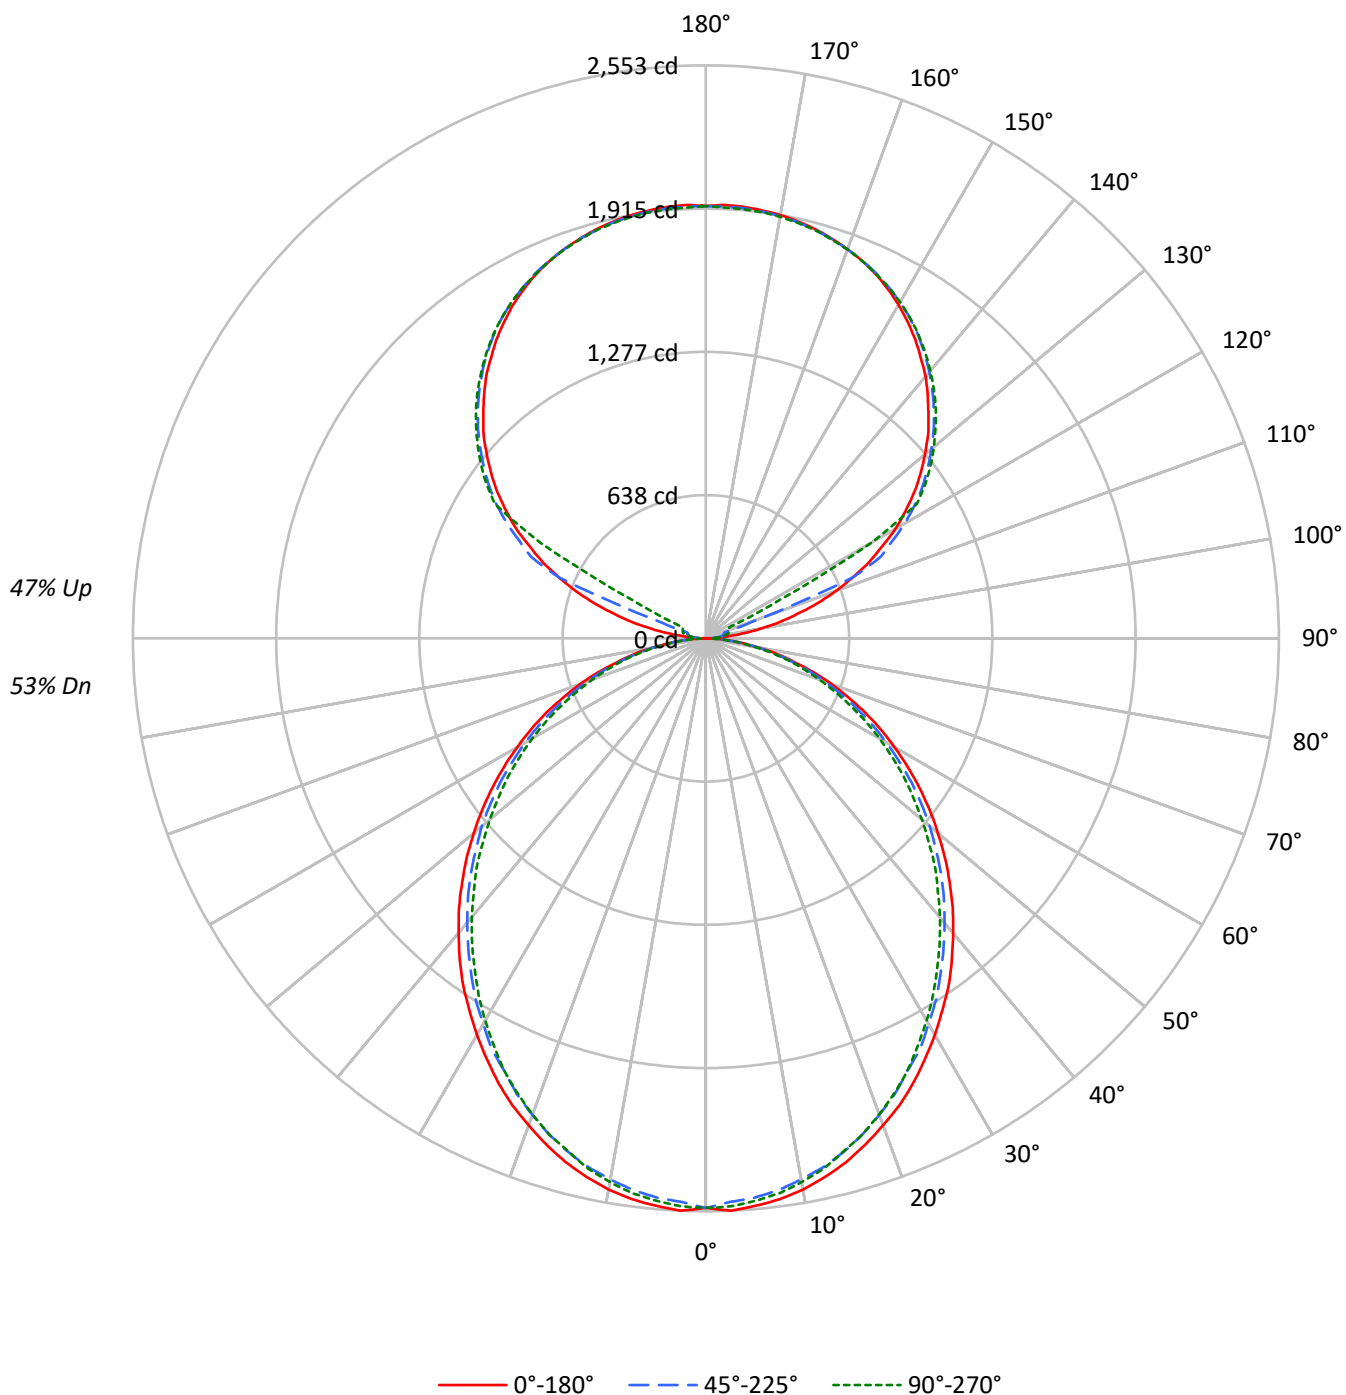

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	94	90	87	91	87	84	81	75	72	70	63	61	60	52	51	50
2	90	82	76	71	83	76	71	66	65	61	58	55	52	50	46	44	42
3	82	72	65	59	76	67	61	56	58	53	49	49	45	42	41	38	36
4	75	64	56	50	69	60	53	47	51	46	42	44	40	36	37	33	31
5	69	57	49	43	63	53	46	41	46	40	36	39	35	31	33	30	27
6	63	51	43	37	59	48	41	35	41	36	31	35	31	28	30	26	24
7	59	46	38	33	54	43	36	31	38	32	28	32	28	24	27	24	21
8	54	42	34	29	50	39	32	27	34	29	25	30	25	22	25	22	19
9	51	38	31	26	47	36	29	25	31	26	22	27	23	20	23	20	17
10	47	35	28	23	44	33	26	22	29	24	20	25	21	18	21	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2940	2940	2940
5°	2943	2897	2917
10°	2918	2856	2876
15°	2874	2807	2812
20°	2814	2739	2748
25°	2755	2659	2673
30°	2682	2584	2578
35°	2612	2497	2479
40°	2526	2408	2384
45°	2440	2319	2286
50°	2347	2225	2174
55°	2248	2117	2069
60°	2137	1988	1950
65°	2016	1855	1810
70°	1861	1693	1658
75°	1647	1498	1516
80°	1389	1249	1248
85°	985	827	809

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2440 cd/sqm

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.9	2.0
10°-20°	672.1	5.6
20°-30°	987.7	8.2
30°-40°	1147.1	9.5
40°-50°	1145.7	9.5
50°-60°	999.0	8.3
60°-70°	738.5	6.1
70°-80°	417.8	3.5
80°-90°	113.7	0.9
90°-100°	63.5	0.5
100°-110°	236.8	2.0
110°-120°	627.9	5.2
120°-130°	1041.5	8.6
130°-140°	1106.3	9.1
140°-150°	1028.1	8.5
150°-160°	826.6	6.8
160°-170°	532.6	4.4
170°-180°	183.3	1.5
0°-30°	1898.6	15.7
0°-40°	3045.8	25.2
0°-60°	5190.5	42.9
0°-90°	6460.6	53.4
90°-120°	928.2	7.7
90°-150°	4104.1	33.9
90°-180°	5647.0	46.6
0°-180°	12107.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2538	2538	2538	2538	2538	
5°	2538	2528	2501	2521	2516	241
15°	2416	2402	2370	2379	2367	680
25°	2186	2167	2126	2130	2126	1006
35°	1886	1862	1823	1808	1796	1178
45°	1535	1518	1481	1455	1445	1185
55°	1162	1147	1118	1088	1076	1039
65°	784	769	744	722	710	775
75°	410	405	393	378	383	438
85°	100	98	95	88	85	112
90°	1	17	28	35	38	11
95°	90	44	54	61	60	107
105°	424	466	85	100	106	453
115°	801	825	860	215	114	789
125°	1133	1151	1178	1188	1192	1010
135°	1402	1424	1437	1451	1448	1083
145°	1626	1625	1649	1658	1652	1017
155°	1791	1778	1795	1803	1792	825
165°	1887	1879	1883	1893	1883	533
175°	1930	1920	1923	1933	1919	184
180°	1926	1926	1926	1926	1926	

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2537.9	2537.9	2537.9	2537.9	2537.9
2.5°	2552.6	2540.5	2513.6	2537.9	2533.2
5°	2537.9	2528.3	2501.4	2520.8	2516.2
7.5°	2520.8	2506.3	2479.4	2499.1	2494.2
10°	2494.2	2477.0	2447.8	2467.2	2460.0
12.5°	2457.4	2442.9	2413.6	2425.8	2420.9
15°	2416.0	2401.5	2369.6	2379.4	2367.3
17.5°	2364.7	2350.2	2318.3	2330.5	2318.3
20°	2308.5	2294.0	2259.8	2267.1	2257.5
22.5°	2252.6	2230.6	2198.7	2198.7	2193.8
25°	2186.5	2167.1	2125.7	2130.4	2125.7
27.5°	2113.3	2096.2	2064.6	2057.3	2045.2
30°	2040.3	2020.6	1984.1	1976.9	1967.0
32.5°	1962.1	1947.6	1908.5	1893.7	1883.9
35°	1886.4	1862.1	1823.0	1808.2	1796.1
37.5°	1801.0	1779.0	1739.9	1722.8	1710.7
40°	1713.3	1693.5	1654.5	1632.7	1622.9
42.5°	1627.8	1608.1	1569.3	1544.7	1530.2
45°	1535.1	1518.0	1481.2	1454.6	1444.8
47.5°	1444.8	1427.7	1388.5	1361.6	1347.1
50°	1349.5	1337.3	1303.1	1268.9	1256.8
52.5°	1256.8	1239.7	1208.1	1181.2	1164.1
55°	1161.7	1147.0	1117.8	1088.5	1076.3
57.5°	1066.5	1054.3	1022.5	993.2	983.3
60°	971.2	961.6	927.4	900.5	893.2
62.5°	878.5	861.4	837.1	812.8	802.9
65°	783.5	768.7	744.4	722.4	710.2
67.5°	685.8	673.4	651.7	634.6	624.8
70°	595.5	585.6	563.7	546.6	537.0
72.5°	502.8	493.0	480.8	463.7	456.5
75°	409.9	405.2	392.8	378.3	383.2
77.5°	327.0	317.2	312.3	305.0	297.7
80°	244.2	241.6	236.7	229.4	224.5
82.5°	166.0	166.0	163.6	153.8	153.8
85°	100.0	97.6	95.3	87.8	85.4
87.5°	44.0	39.1	34.2	26.9	24.4
90°	1.3	16.7	27.8	34.9	37.6
92.5°	34.9	29.3	33.4	36.3	37.6
95°	90.5	44.5	54.3	61.4	59.9
97.5°	163.0	48.8	71.0	75.3	76.6
100°	246.8	55.8	79.4	90.5	93.4
102.5°	338.6	336.0	82.3	97.5	101.7
105°	423.7	465.5	85.0	100.3	105.9
107.5°	522.6	557.4	87.9	103.1	108.8
110°	617.5	646.6	243.9	104.6	110.1

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	706.7	731.6	708.0	107.2	111.5
115°	801.4	825.0	859.9	214.7	114.4
117.5°	883.6	911.4	935.2	735.8	370.7
120°	975.6	996.5	1021.7	1038.4	850.2
122.5°	1053.5	1075.9	1103.9	1112.1	1113.6
125°	1133.0	1151.2	1177.7	1187.5	1191.6
127.5°	1205.5	1225.0	1246.0	1260.0	1261.3
130°	1273.8	1296.2	1311.4	1326.8	1325.5
132.5°	1343.5	1361.7	1377.0	1389.5	1388.2
135°	1402.1	1424.4	1436.9	1450.9	1448.1
137.5°	1463.3	1480.1	1494.1	1508.1	1503.9
140°	1523.2	1534.5	1549.7	1562.3	1555.3
142.5°	1573.5	1583.3	1601.3	1612.4	1605.5
145°	1626.5	1625.1	1648.7	1658.5	1651.5
147.5°	1672.3	1668.3	1691.9	1698.8	1693.4
150°	1717.0	1707.3	1729.7	1737.9	1731.0
152.5°	1754.6	1743.5	1764.4	1772.8	1763.1
155°	1790.9	1778.4	1795.1	1803.4	1792.4
157.5°	1820.2	1809.1	1821.6	1831.4	1820.2
160°	1845.3	1836.9	1845.3	1853.6	1843.8
162.5°	1867.5	1859.2	1866.1	1875.9	1863.4
165°	1887.0	1878.8	1882.8	1892.6	1882.8
167.5°	1902.4	1893.9	1898.3	1908.0	1895.5
170°	1915.0	1906.6	1909.3	1919.1	1906.6
172.5°	1923.3	1915.0	1917.8	1927.5	1915.0
175°	1930.2	1920.4	1923.3	1933.0	1919.1
177.5°	1933.0	1923.3	1924.8	1934.5	1921.9
180°	1926.1	1926.1	1926.1	1926.1	1926.1

TEST NUMBER: P916295

CATALOG NUMBER: DFN2DIP-HX3F0-080D070US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.28	12.17	12.21	13.12	14.34	10.85	11.74	11.78	12.69	13.91
	3H	12.94	13.74	13.87	14.69	15.94	12.47	13.27	13.41	14.22	15.47
	4H	13.52	14.28	14.47	15.24	16.49	13.05	13.81	14.00	14.77	16.02
	6H	13.91	14.61	14.88	15.58	16.85	13.44	14.14	14.41	15.11	16.38
	8H	14.02	14.68	14.99	15.66	16.93	13.55	14.21	14.52	15.19	16.46
	12H	14.06	14.70	15.04	15.67	16.96	13.59	14.22	14.57	15.20	16.49
4H	2H	11.74	12.50	12.70	13.46	14.71	11.40	12.16	12.36	13.12	14.37
	3H	13.60	14.23	14.57	15.22	16.49	13.21	13.85	14.18	14.83	16.10
	4H	14.31	14.89	15.29	15.87	17.17	13.91	14.49	14.89	15.47	16.76
	6H	14.82	15.32	15.81	16.33	17.62	14.42	14.91	15.41	15.92	17.21
	8H	14.97	15.43	15.96	16.43	17.74	14.56	15.03	15.55	16.03	17.33
	12H	15.04	15.46	16.05	16.48	17.79	14.62	15.04	15.63	16.06	17.37
8H	4H	14.51	14.97	15.50	15.97	17.28	14.15	14.62	15.14	15.62	16.92
	6H	15.13	15.52	16.15	16.56	17.86	14.77	15.16	15.79	16.20	17.50
	8H	15.35	15.69	16.37	16.72	18.04	14.98	15.32	16.01	16.35	17.67
	12H	15.48	15.77	16.50	16.80	18.16	15.10	15.39	16.13	16.42	17.78
12H	4H	14.49	14.91	15.51	15.93	17.24	14.15	14.57	15.16	15.58	16.89
	6H	15.16	15.50	16.19	16.53	17.85	14.81	15.15	15.84	16.18	17.50
	8H	15.40	15.70	16.43	16.72	18.09	15.04	15.34	16.07	16.37	17.73

END OF REPORT