

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P916304

Luminaire Tested: DFN2DIP-HX3F0-090D030US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P916304
REPORT IS A COMBINATION OF REPORTS P899214 AND P896089
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-090D030US930-RLLFLL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8401.6 lumens
Efficiency: N/A
Efficacy: 72.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 115.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLLFLL

Luminous Intensity Polar Plot

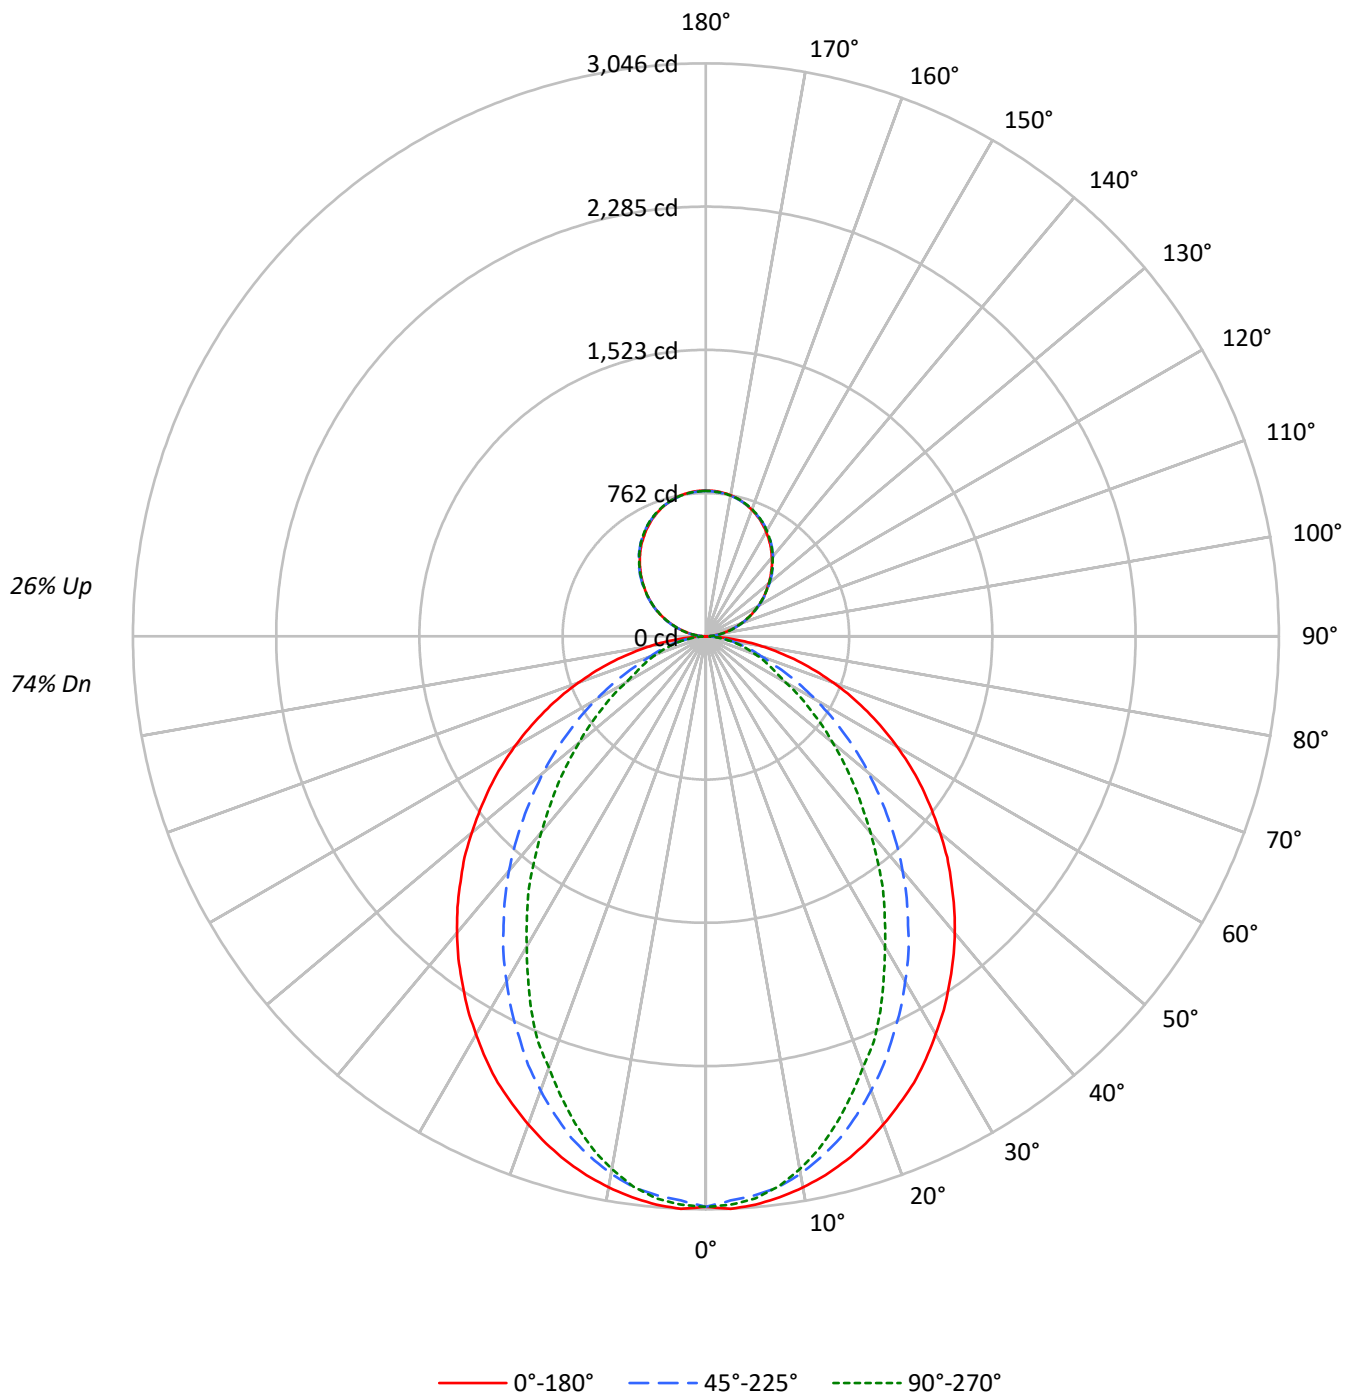

TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	97	97	97	87	87	87	78	78	78
1	104	100	96	93	99	95	92	89	86	84	81	78	76	74	70	69	68
2	95	88	82	77	90	84	79	74	76	72	68	69	66	63	63	60	58
3	87	78	71	65	83	75	68	63	68	63	58	62	58	54	56	53	50
4	80	70	62	56	76	67	60	54	61	55	51	56	51	47	51	47	44
5	74	63	54	48	70	60	53	47	55	49	44	51	45	42	46	42	39
6	69	57	48	43	65	54	47	41	50	44	39	46	41	37	42	38	35
7	64	51	43	38	61	49	42	37	46	39	35	42	37	33	39	34	31
8	59	47	39	34	57	45	38	33	42	36	31	39	34	30	36	31	28
9	56	43	36	31	53	42	35	30	39	33	28	36	31	27	33	29	26
10	52	40	33	28	50	39	32	27	36	30	26	33	28	25	31	27	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3513	3513	3513
5°	3517	3455	3477
10°	3481	3385	3362
15°	3431	3270	3186
20°	3366	3114	2969
25°	3299	2939	2761
30°	3211	2760	2497
35°	3124	2567	2265
40°	3035	2368	1999
45°	2932	2148	1759
50°	2825	1926	1524
55°	2714	1689	1298
60°	2585	1442	1067
65°	2436	1190	958
70°	2256	956	864
75°	2029	837	782
80°	1701	695	672
85°	1162	452	494

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2932 cd/sqm

TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.2	3.4
10°-20°	780.3	9.3
20°-30°	1095.5	13.0
30°-40°	1194.1	14.2
40°-50°	1097.5	13.1
50°-60°	861.9	10.3
60°-70°	561.0	6.7
70°-80°	288.8	3.4
80°-90°	75.9	0.9
90°-100°	47.9	0.6
100°-110°	152.1	1.8
110°-120°	260.3	3.1
120°-130°	342.3	4.1
130°-140°	384.2	4.6
140°-150°	376.8	4.5
150°-160°	316.1	3.8
160°-170°	209.6	2.5
170°-180°	73.3	0.9
0°-30°	2159.9	25.7
0°-40°	3354.0	39.9
0°-60°	5313.5	63.2
0°-90°	6239.2	74.3
90°-120°	460.2	5.5
90°-150°	1563.5	18.6
90°-180°	2162.0	25.7
0°-180°	8401.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3033	3033	3033	3033	3033	
5°	3033	3019	2983	3008	3000	288
15°	2884	2854	2761	2709	2682	813
25°	2618	2530	2349	2237	2196	1204
35°	2256	2116	1875	1702	1641	1412
45°	1844	1660	1372	1177	1111	1424
55°	1402	1188	892	727	675	1253
65°	947	724	478	384	376	939
75°	505	313	220	200	198	534
85°	118	60	52	52	52	135
90°	1	8	23	21	22	8
95°	34	41	42	42	41	38
105°	140	142	144	145	145	148
115°	261	265	264	263	261	258
125°	380	386	384	382	381	339
135°	491	499	500	499	497	380
145°	597	601	605	606	603	373
155°	682	684	686	689	687	314
165°	742	741	741	746	743	209
175°	772	770	769	774	770	73
180°	774	774	774	774	774	

TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3032.7	3032.7	3032.7	3032.7	3032.7
2.5°	3046.4	3032.7	3002.3	3030.1	3024.5
5°	3032.7	3019.0	2983.2	3007.9	2999.7
7.5°	3007.9	2991.6	2953.2	2963.9	2950.2
10°	2975.0	2955.8	2901.1	2892.6	2876.3
12.5°	2933.9	2909.2	2835.0	2818.6	2788.3
15°	2884.4	2854.2	2761.0	2708.8	2681.5
17.5°	2826.8	2782.9	2667.5	2607.2	2563.3
20°	2761.0	2706.0	2568.8	2500.4	2439.8
22.5°	2689.7	2626.5	2467.2	2374.0	2333.0
25°	2618.3	2530.4	2349.3	2236.9	2195.5
27.5°	2533.3	2439.8	2239.5	2110.5	2047.3
30°	2442.7	2338.2	2118.6	1978.9	1904.6
32.5°	2354.7	2228.4	2003.6	1838.8	1770.1
35°	2256.1	2116.0	1874.6	1701.7	1641.1
37.5°	2160.0	2008.9	1753.8	1564.2	1495.8
40°	2058.4	1893.9	1627.4	1432.6	1361.3
42.5°	1954.1	1778.6	1501.3	1298.1	1229.6
45°	1844.4	1660.4	1372.3	1177.2	1111.4
47.5°	1740.1	1545.3	1248.9	1053.8	993.5
50°	1624.8	1430.0	1128.0	938.5	881.1
52.5°	1512.1	1306.3	1012.8	831.6	779.5
55°	1402.3	1188.3	891.9	727.4	675.2
57.5°	1290.0	1070.4	785.1	631.3	587.3
60°	1174.6	955.0	672.4	532.6	488.6
62.5°	1062.3	842.7	576.3	444.7	422.8
65°	946.9	724.5	477.5	384.3	375.9
67.5°	837.1	614.7	384.3	337.5	329.3
70°	721.9	507.8	318.3	290.9	279.8
72.5°	612.0	408.8	266.1	244.3	238.8
75°	504.9	312.7	219.6	200.3	197.7
77.5°	398.0	222.2	172.9	161.9	156.4
80°	299.1	159.3	131.6	120.8	120.8
82.5°	208.5	107.1	90.6	85.0	85.0
85°	117.9	60.3	52.1	52.1	52.1
87.5°	43.9	21.8	21.8	19.2	19.2
90°	0.7	8.4	22.8	21.4	22.2
92.5°	14.4	19.6	20.3	21.0	21.0
95°	34.1	40.6	41.7	41.7	40.6
97.5°	56.7	62.7	65.3	65.3	65.3
100°	82.8	88.1	90.0	90.0	89.4
102.5°	110.3	114.3	116.8	117.6	116.8
105°	140.4	142.3	143.7	144.8	144.8
107.5°	170.2	173.0	173.0	173.5	170.2
110°	199.2	202.9	202.9	202.9	201.1



TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	230.4	234.4	233.7	231.8	230.4
115°	261.2	264.9	263.7	263.1	261.2
117.5°	291.7	296.9	293.6	291.7	289.8
120°	322.5	327.7	322.5	322.5	320.4
122.5°	350.5	357.0	353.8	351.9	350.5
125°	379.9	385.7	383.8	381.7	381.1
127.5°	408.5	415.8	413.3	410.4	408.5
130°	435.4	443.8	442.6	441.2	438.6
132.5°	465.5	472.0	472.5	469.2	467.3
135°	491.4	498.6	500.0	499.3	497.4
137.5°	520.2	526.1	527.3	526.8	524.0
140°	545.7	551.5	554.8	554.8	552.2
142.5°	571.9	577.6	579.5	580.2	577.6
145°	596.6	601.2	605.0	605.6	603.1
147.5°	618.7	624.5	627.3	628.5	625.9
150°	641.6	645.6	648.1	650.2	648.1
152.5°	661.9	665.8	669.0	671.6	669.0
155°	682.2	684.0	686.1	689.3	687.3
157.5°	699.6	701.0	702.2	706.9	703.6
160°	715.3	716.6	717.4	721.3	718.5
162.5°	729.7	729.7	730.4	734.8	731.6
165°	742.1	741.4	741.4	746.0	742.7
167.5°	753.3	751.1	751.1	755.8	752.5
170°	761.7	759.8	759.1	763.8	759.8
172.5°	767.4	765.6	764.9	769.6	765.6
175°	772.2	770.3	768.9	773.6	769.6
177.5°	774.7	772.8	771.4	775.4	771.4
180°	773.6	773.6	773.6	773.6	773.6

TEST NUMBER: P916304

CATALOG NUMBER: DFN2DIP-HX3F0-090D030US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.49	14.57	14.21	15.31	16.18	9.46	10.54	10.19	11.28	12.16
	3H	15.18	16.14	15.91	16.89	17.80	10.67	11.63	11.41	12.38	13.29
	4H	15.79	16.70	16.55	17.46	18.38	11.13	12.03	11.88	12.79	13.72
	6H	16.22	17.06	16.99	17.82	18.76	11.46	12.29	12.22	13.06	14.00
	8H	16.35	17.14	17.13	17.93	18.87	11.55	12.35	12.33	13.13	14.07
	12H	16.42	17.17	17.20	17.95	18.92	11.60	12.36	12.38	13.14	14.10
4H	2H	13.54	14.44	14.30	15.20	16.13	10.09	10.99	10.85	11.75	12.68
	3H	15.38	16.13	16.15	16.93	17.87	11.45	12.21	12.22	13.00	13.94
	4H	16.07	16.76	16.86	17.55	18.52	12.01	12.69	12.79	13.48	14.45
	6H	16.59	17.19	17.40	18.00	18.98	12.43	13.02	13.24	13.84	14.82
	8H	16.77	17.32	17.58	18.14	19.12	12.56	13.12	13.37	13.93	14.92
	12H	16.87	17.37	17.70	18.20	19.20	12.64	13.13	13.47	13.97	14.96
8H	4H	16.06	16.61	16.87	17.42	18.41	12.30	12.85	13.11	13.67	14.65
	6H	16.62	17.08	17.46	17.94	18.93	12.82	13.28	13.66	14.13	15.12
	8H	16.84	17.24	17.69	18.10	19.10	13.01	13.41	13.86	14.27	15.27
	12H	16.98	17.34	17.83	18.18	19.25	13.13	13.49	13.98	14.34	15.40
12H	4H	16.02	16.52	16.85	17.35	18.35	12.31	12.81	13.14	13.65	14.64
	6H	16.60	17.01	17.45	17.86	18.87	12.87	13.27	13.72	14.13	15.13
	8H	16.83	17.18	17.68	18.03	19.09	13.09	13.44	13.93	14.29	15.35

END OF REPORT