

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918935

Luminaire Tested: DFN2DIP-HX3F0-050D030US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918935
REPORT IS A COMBINATION OF REPORTS P900725 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-050D030US935-FLLONL
Description: 3 foot, Hexagon Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6819.1 lumens
Efficiency: N/A
Efficacy: 100.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 67.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

Luminous Intensity Polar Plot

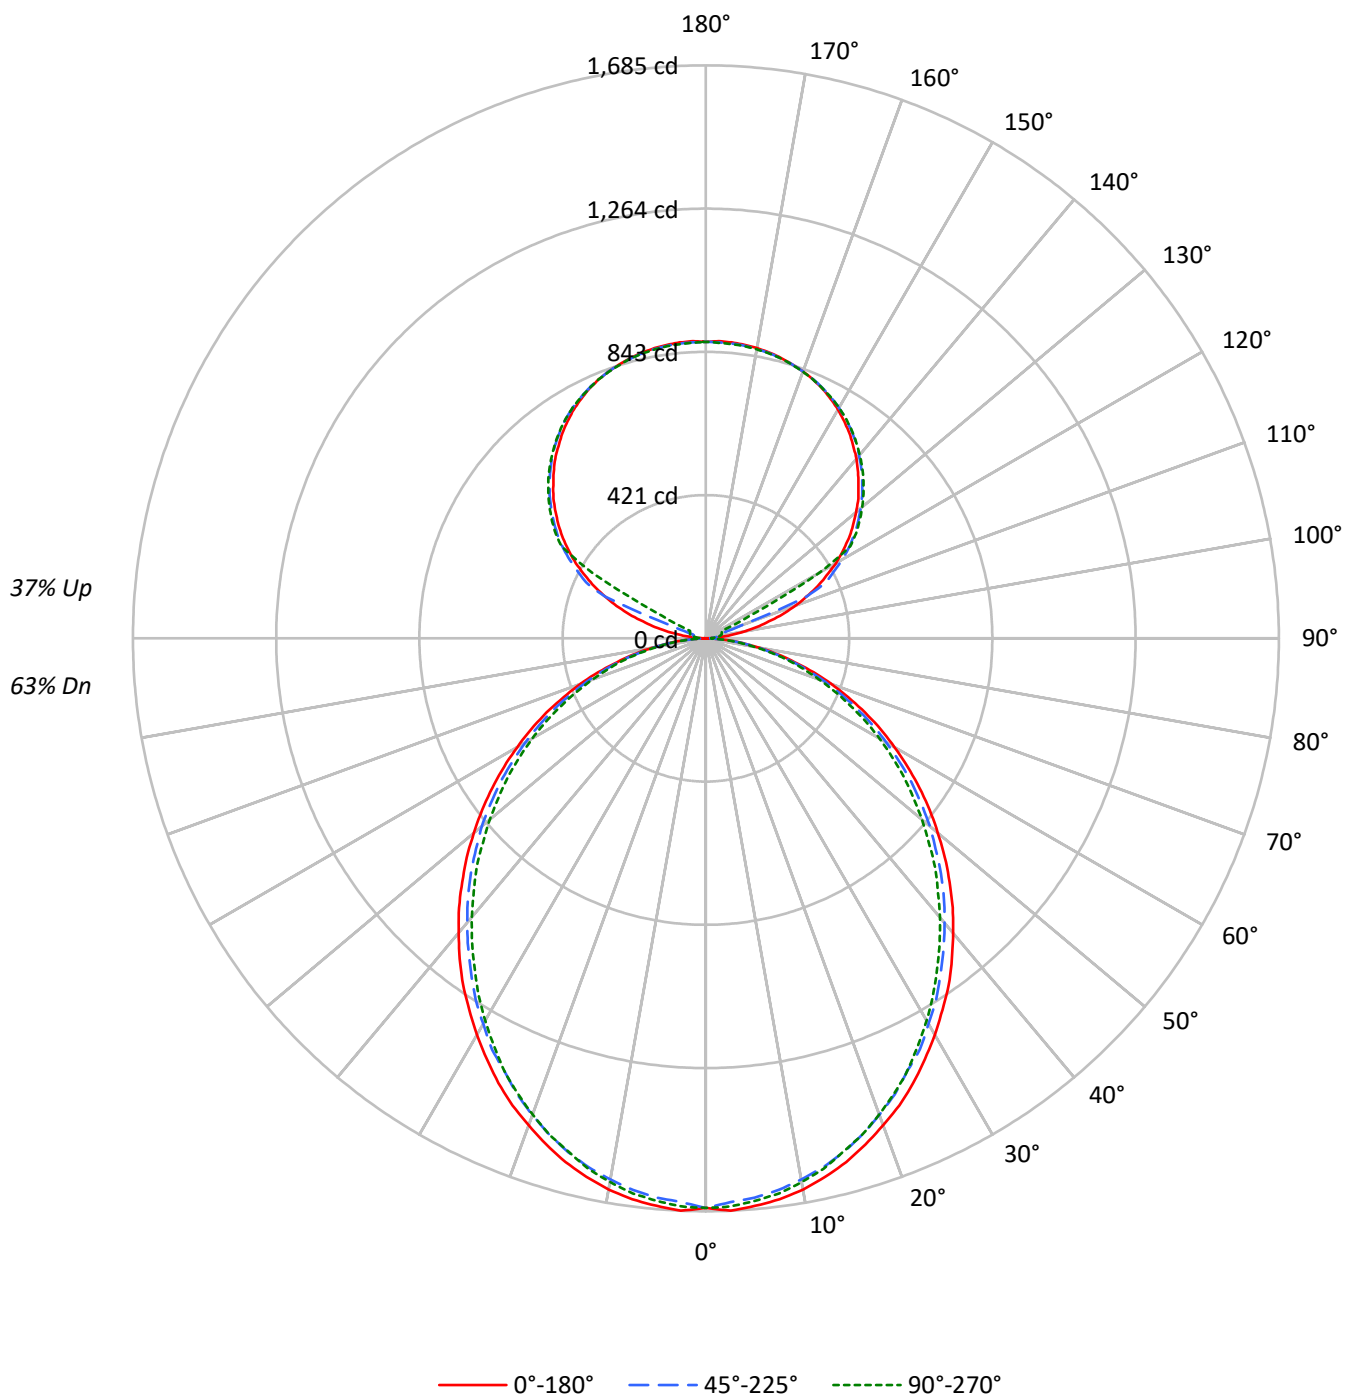

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	68	68	68
1	101	96	92	89	94	90	87	84	79	77	74	69	67	65	60	58	57
2	92	84	78	72	86	79	73	69	69	65	62	61	58	55	53	50	48
3	84	74	66	60	78	70	63	57	61	56	52	54	50	46	47	44	41
4	77	65	57	51	71	62	54	49	55	49	44	48	43	40	42	38	35
5	70	58	50	44	66	55	48	42	49	43	38	43	38	34	38	34	31
6	65	53	44	38	61	50	42	37	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	38	32	40	34	30	35	31	27	31	27	24
8	56	43	35	30	52	41	34	29	37	31	26	33	28	24	29	25	22
9	52	40	32	27	49	37	30	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	34	28	23	31	25	21	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1940	1940	1940
5°	1943	1912	1925
10°	1926	1885	1898
15°	1897	1852	1856
20°	1858	1808	1813
25°	1819	1755	1764
30°	1770	1706	1702
35°	1724	1648	1636
40°	1667	1589	1573
45°	1611	1530	1509
50°	1549	1469	1435
55°	1484	1397	1366
60°	1410	1313	1287
65°	1330	1224	1194
70°	1228	1117	1095
75°	1087	988	1001
80°	917	824	824
85°	650	546	534

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1611 cd/sqm

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.7	2.3
10°-20°	443.6	6.5
20°-30°	651.9	9.6
30°-40°	757.2	11.1
40°-50°	756.2	11.1
50°-60°	659.4	9.7
60°-70°	487.4	7.1
70°-80°	275.8	4.0
80°-90°	74.3	1.1
90°-100°	28.7	0.4
100°-110°	107.2	1.6
110°-120°	284.2	4.2
120°-130°	471.3	6.9
130°-140°	500.7	7.3
140°-150°	465.3	6.8
150°-160°	374.1	5.5
160°-170°	241.1	3.5
170°-180°	83.0	1.2
0°-30°	1253.2	18.4
0°-40°	2010.3	29.5
0°-60°	3425.9	50.2
0°-90°	4263.5	62.5
90°-120°	420.1	6.2
90°-150°	1857.5	27.2
90°-180°	2556.0	37.5
0°-180°	6819.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1675	1675	1675	1675	1675	
5°	1675	1669	1651	1664	1661	159
15°	1595	1585	1564	1570	1562	449
25°	1443	1430	1403	1406	1403	664
35°	1245	1229	1203	1194	1186	778
45°	1013	1002	978	960	954	782
55°	767	757	738	718	710	686
65°	517	507	491	477	469	511
75°	270	267	259	250	253	289
85°	66	64	63	58	56	74
90°	1	8	13	16	17	6
95°	41	20	24	28	27	49
105°	192	211	38	45	48	205
115°	363	373	389	97	52	357
125°	513	521	533	537	539	457
135°	635	645	650	657	655	490
145°	736	736	746	751	747	460
155°	810	805	812	816	811	373
165°	854	850	852	857	852	241
175°	874	869	870	875	869	83
180°	872	872	872	872	872	

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1675.1	1675.1	1675.1	1675.1	1675.1
2.5°	1684.8	1676.8	1659.1	1675.1	1672.1
5°	1675.1	1668.8	1651.0	1663.8	1660.8
7.5°	1663.8	1654.2	1636.5	1649.5	1646.2
10°	1646.2	1634.9	1615.7	1628.4	1623.7
12.5°	1621.9	1612.4	1593.1	1601.1	1597.8
15°	1594.6	1585.0	1564.0	1570.5	1562.5
17.5°	1560.7	1551.2	1530.2	1538.2	1530.2
20°	1523.7	1514.2	1491.6	1496.3	1490.0
22.5°	1486.8	1472.2	1451.2	1451.2	1447.9
25°	1443.2	1430.4	1403.0	1406.1	1403.0
27.5°	1394.8	1383.5	1362.7	1357.9	1349.9
30°	1346.6	1333.7	1309.6	1304.8	1298.3
32.5°	1295.0	1285.5	1259.6	1249.9	1243.5
35°	1245.1	1229.1	1203.2	1193.5	1185.5
37.5°	1188.7	1174.2	1148.4	1137.1	1129.1
40°	1130.8	1117.8	1092.0	1077.6	1071.2
42.5°	1074.4	1061.4	1035.8	1019.5	1010.0
45°	1013.2	1001.9	977.7	960.1	953.6
47.5°	953.6	942.3	916.5	898.7	889.2
50°	890.7	882.7	860.1	837.6	829.5
52.5°	829.5	818.2	797.4	779.6	768.4
55°	766.8	757.1	737.7	718.4	710.4
57.5°	703.9	695.9	674.9	655.6	649.0
60°	641.0	634.7	612.2	594.3	589.6
62.5°	579.9	568.6	552.5	536.4	529.9
65°	517.1	507.4	491.3	476.8	468.7
67.5°	452.7	444.5	430.2	418.9	412.3
70°	393.0	386.6	372.0	360.8	354.5
72.5°	331.9	325.4	317.4	306.1	301.3
75°	270.5	267.4	259.2	249.7	253.0
77.5°	215.9	209.3	206.1	201.3	196.6
80°	161.2	159.5	156.2	151.4	148.2
82.5°	109.5	109.5	108.0	101.5	101.5
85°	66.0	64.4	62.9	57.9	56.4
87.5°	29.0	25.8	22.6	17.7	16.1
90°	0.6	7.6	12.6	15.8	17.0
92.5°	15.8	13.3	15.2	16.4	17.0
95°	41.0	20.1	24.5	27.8	27.1
97.5°	73.8	22.1	32.1	34.1	34.7
100°	111.7	25.2	36.0	41.0	42.3
102.5°	153.3	152.1	37.2	44.1	46.1
105°	191.7	210.7	38.5	45.4	48.0
107.5°	236.5	252.3	39.8	46.7	49.2
110°	279.5	292.7	110.4	47.4	49.9

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	319.9	331.1	320.5	48.6	50.5
115°	362.7	373.4	389.2	97.1	51.7
117.5°	399.9	412.5	423.3	333.0	167.8
120°	441.5	451.0	462.4	469.9	384.8
122.5°	476.8	487.0	499.6	503.3	504.0
125°	512.8	521.0	533.0	537.4	539.3
127.5°	545.6	554.4	564.0	570.2	570.8
130°	576.5	586.7	593.6	600.5	599.9
132.5°	608.0	616.3	623.2	628.9	628.3
135°	634.6	644.7	650.3	656.7	655.4
137.5°	662.3	669.9	676.2	682.5	680.6
140°	689.4	694.5	701.4	707.1	704.0
142.5°	712.2	716.6	724.8	729.8	726.7
145°	736.2	735.5	746.2	750.6	747.4
147.5°	756.9	755.0	765.8	768.9	766.4
150°	777.1	772.7	782.8	786.5	783.4
152.5°	794.1	789.1	798.6	802.4	798.0
155°	810.5	804.9	812.4	816.2	811.2
157.5°	823.8	818.8	824.5	828.9	823.8
160°	835.2	831.4	835.2	839.0	834.5
162.5°	845.2	841.5	844.6	849.0	843.3
165°	854.0	850.3	852.2	856.6	852.2
167.5°	861.0	857.2	859.1	863.6	857.9
170°	866.7	862.9	864.2	868.6	862.9
172.5°	870.5	866.7	868.0	872.4	866.7
175°	873.6	869.2	870.5	874.9	868.6
177.5°	874.9	870.5	871.2	875.5	869.9
180°	871.8	871.8	871.8	871.8	871.8

TEST NUMBER: P918935

CATALOG NUMBER: DFN2DIP-HX3F0-050D030US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.61	11.60	11.45	12.46	13.54	10.18	11.17	11.03	12.03	13.11
	3H	12.27	13.16	13.13	14.03	15.14	11.81	12.69	12.66	13.56	14.67
	4H	12.86	13.70	13.73	14.58	15.70	12.39	13.23	13.27	14.11	15.23
	6H	13.26	14.04	14.15	14.92	16.05	12.79	13.57	13.68	14.45	15.58
	8H	13.37	14.10	14.26	15.01	16.14	12.90	13.63	13.79	14.54	15.67
	12H	13.42	14.12	14.31	15.02	16.17	12.94	13.64	13.84	14.54	15.70
4H	2H	11.09	11.92	11.96	12.80	13.92	10.74	11.58	11.62	12.46	13.58
	3H	12.96	13.65	13.84	14.57	15.70	12.57	13.26	13.45	14.18	15.31
	4H	13.67	14.31	14.57	15.21	16.37	13.27	13.90	14.17	14.81	15.97
	6H	14.18	14.73	15.10	15.67	16.83	13.78	14.33	14.69	15.26	16.42
	8H	14.33	14.85	15.25	15.77	16.95	13.93	14.44	14.84	15.37	16.54
	12H	14.41	14.87	15.34	15.82	17.00	13.99	14.46	14.93	15.40	16.58
8H	4H	13.87	14.39	14.79	15.31	16.49	13.51	14.03	14.43	14.96	16.13
	6H	14.50	14.93	15.44	15.89	17.07	14.14	14.57	15.08	15.53	16.71
	8H	14.72	15.09	15.67	16.05	17.24	14.35	14.73	15.30	15.69	16.88
	12H	14.85	15.18	15.80	16.13	17.37	14.47	14.80	15.42	15.75	16.99
12H	4H	13.86	14.33	14.80	15.27	16.45	13.51	13.98	14.45	14.92	16.10
	6H	14.53	14.91	15.48	15.87	17.06	14.18	14.56	15.13	15.52	16.71
	8H	14.77	15.10	15.73	16.05	17.30	14.42	14.75	15.37	15.70	16.94

END OF REPORT