

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918949

Luminaire Tested: DFN2DIP-HX3F0-050D060US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918949
REPORT IS A COMBINATION OF REPORTS P900768 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-050D060US935-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8773.6 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 90.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLLONL

Luminous Intensity Polar Plot

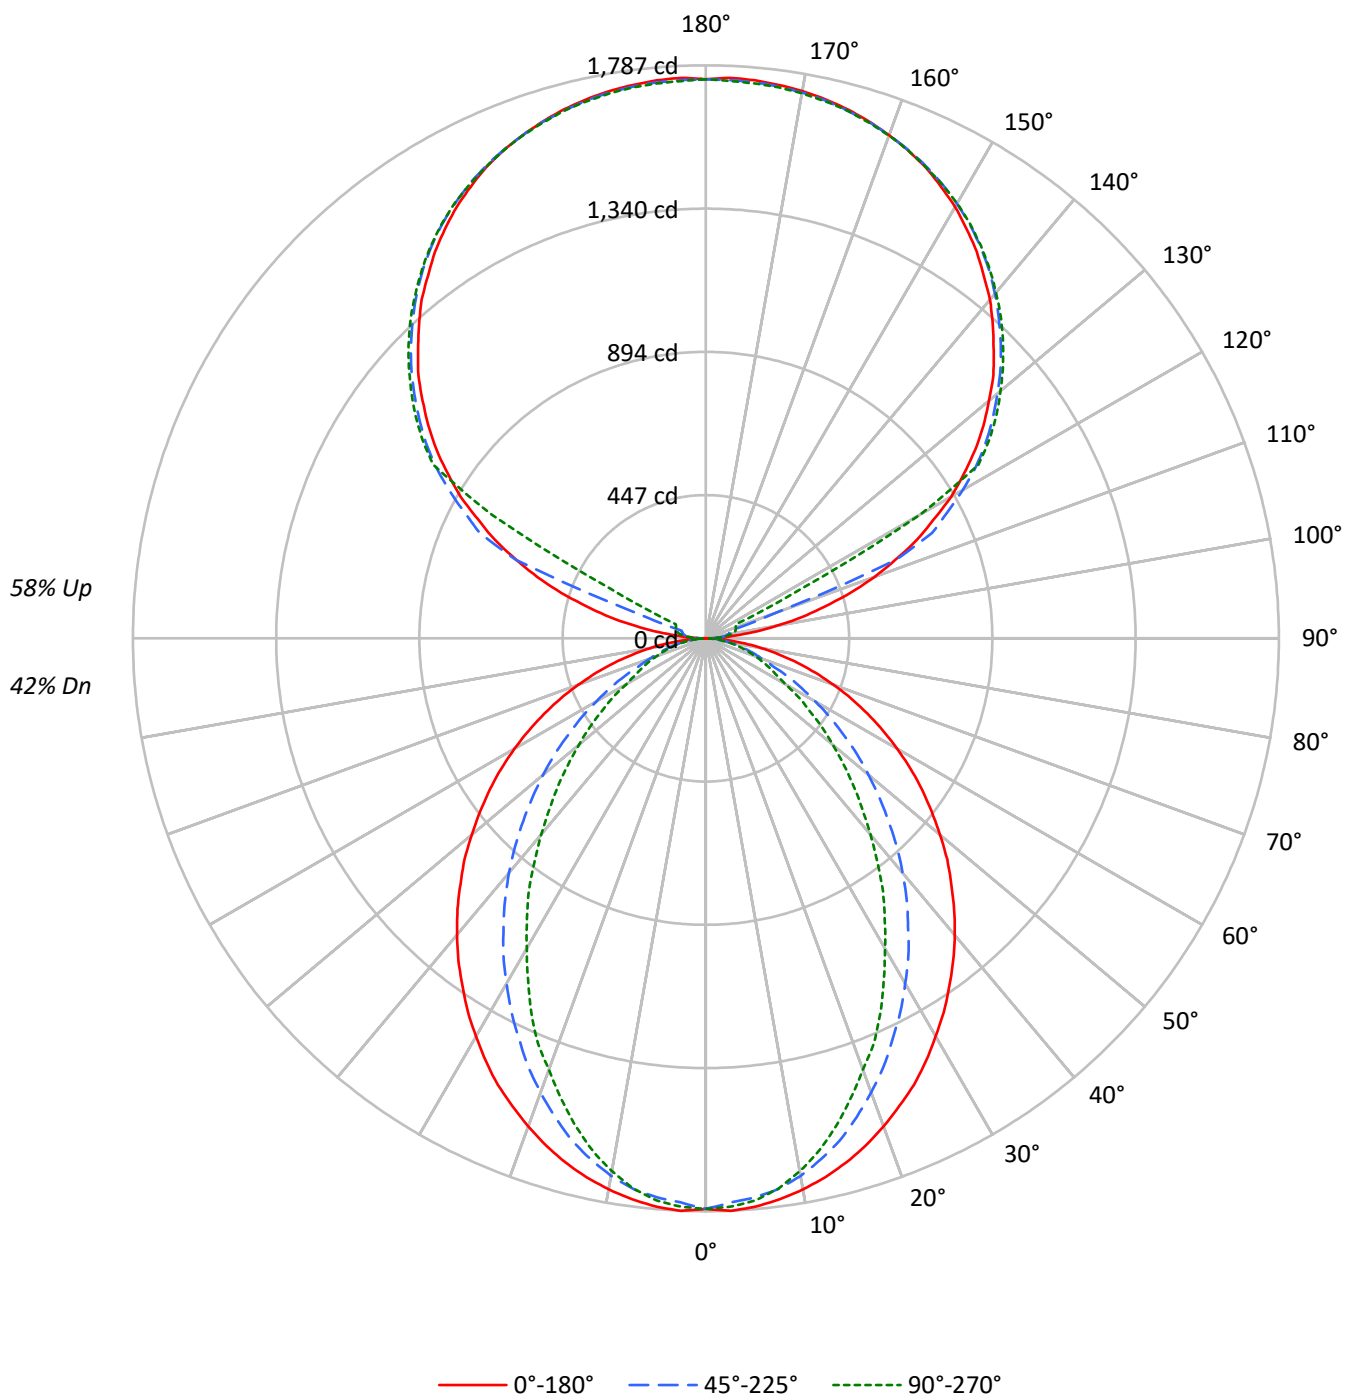

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	43	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	46	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	39	34	30	32	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	27	33	28	24	27	23	20	22	19	17
9	50	38	31	26	46	35	29	25	30	25	22	25	21	18	20	17	15
10	47	35	28	23	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2061	2061	2061
5°	2063	2027	2040
10°	2042	1986	1973
15°	2013	1919	1869
20°	1975	1827	1742
25°	1936	1724	1620
30°	1884	1619	1465
35°	1833	1506	1329
40°	1780	1390	1173
45°	1720	1260	1032
50°	1658	1130	894
55°	1592	991	762
60°	1516	846	626
65°	1429	698	562
70°	1323	561	507
75°	1190	491	459
80°	998	407	394
85°	682	266	290

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1720 cd/sqm

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.8	1.9
10°-20°	457.8	5.2
20°-30°	642.7	7.3
30°-40°	700.6	8.0
40°-50°	643.9	7.3
50°-60°	505.7	5.8
60°-70°	329.2	3.8
70°-80°	169.5	1.9
80°-90°	46.3	0.5
90°-100°	57.5	0.7
100°-110°	214.3	2.4
110°-120°	568.4	6.5
120°-130°	942.7	10.7
130°-140°	1001.4	11.4
140°-150°	930.7	10.6
150°-160°	748.2	8.5
160°-170°	482.1	5.5
170°-180°	165.9	1.9
0°-30°	1267.2	14.4
0°-40°	1967.8	22.4
0°-60°	3117.4	35.5
0°-90°	3662.3	41.7
90°-120°	840.2	9.6
90°-150°	3714.9	42.3
90°-180°	5111.0	58.3
0°-180°	8773.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1779	1779	1779	1779	1779	
5°	1779	1771	1750	1765	1760	169
15°	1692	1675	1620	1589	1573	477
25°	1536	1484	1378	1312	1288	706
35°	1324	1242	1100	998	963	828
45°	1082	974	805	691	652	836
55°	823	697	523	427	396	735
65°	556	425	280	226	221	551
75°	296	184	129	118	116	313
85°	69	35	31	31	31	79
90°	1	15	25	32	34	8
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1779.3	1779.3	1779.3	1779.3	1779.3
2.5°	1787.3	1779.3	1761.5	1777.7	1774.4
5°	1779.3	1771.2	1750.2	1764.7	1760.0
7.5°	1764.7	1755.1	1732.6	1739.0	1730.9
10°	1745.4	1734.1	1702.0	1697.1	1687.5
12.5°	1721.3	1706.8	1663.3	1653.7	1635.9
15°	1692.3	1674.6	1619.9	1589.3	1573.2
17.5°	1658.5	1632.7	1565.0	1529.6	1503.8
20°	1619.9	1587.6	1507.1	1467.0	1431.4
22.5°	1578.0	1540.9	1447.5	1392.8	1368.7
25°	1536.1	1484.5	1378.3	1312.3	1288.1
27.5°	1486.3	1431.4	1313.9	1238.2	1201.2
30°	1433.1	1371.8	1243.0	1161.0	1117.4
32.5°	1381.6	1307.4	1175.5	1078.8	1038.5
35°	1323.6	1241.5	1099.8	998.3	962.9
37.5°	1267.2	1178.6	1029.0	917.7	877.6
40°	1207.6	1111.1	954.8	840.5	798.7
42.5°	1146.5	1043.4	880.8	761.6	721.4
45°	1082.1	974.1	805.1	690.7	652.0
47.5°	1020.9	906.6	732.7	618.3	582.9
50°	953.3	839.0	661.8	550.6	516.9
52.5°	887.2	766.4	594.2	487.9	457.4
55°	822.8	697.1	523.2	426.7	396.1
57.5°	756.8	628.0	460.5	370.4	344.6
60°	689.1	560.3	394.4	312.5	286.6
62.5°	623.2	494.4	338.1	260.9	248.1
65°	555.5	425.1	280.2	225.5	220.6
67.5°	491.1	360.7	225.5	198.0	193.2
70°	423.5	297.9	186.8	170.6	164.2
72.5°	359.1	239.9	156.2	143.4	140.1
75°	296.3	183.5	128.8	117.5	116.0
77.5°	233.5	130.4	101.5	95.0	91.7
80°	175.5	93.4	77.2	70.9	70.9
82.5°	122.3	62.9	53.1	49.9	49.9
85°	69.2	35.4	30.6	30.6	30.6
87.5°	25.8	12.8	12.8	11.3	11.3
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P918949

CATALOG NUMBER: DFN2DIP-HX3F0-050D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.79	9.56	9.82	10.59	11.98	4.77	5.54	5.80	6.57	7.96
	3H	10.46	11.14	11.50	12.19	13.59	5.95	6.63	6.99	7.68	9.08
	4H	11.06	11.71	12.11	12.75	14.17	6.39	7.04	7.45	8.09	9.50
	6H	11.47	12.07	12.53	13.12	14.54	6.71	7.30	7.77	8.35	9.78
	8H	11.59	12.16	12.66	13.23	14.65	6.79	7.36	7.86	8.43	9.85
	12H	11.65	12.19	12.72	13.25	14.69	6.83	7.37	7.91	8.43	9.88
4H	2H	8.80	9.45	9.86	10.50	11.91	5.35	6.00	6.41	7.05	8.46
	3H	10.62	11.16	11.68	12.23	13.66	6.69	7.23	7.76	8.31	9.73
	4H	11.30	11.80	12.37	12.86	14.31	7.23	7.73	8.31	8.79	10.24
	6H	11.81	12.23	12.89	13.32	14.76	7.64	8.07	8.73	9.16	10.60
	8H	11.98	12.37	13.06	13.45	14.91	7.77	8.17	8.85	9.25	10.70
	12H	12.06	12.42	13.16	13.51	14.98	7.83	8.19	8.93	9.28	10.74
8H	4H	11.26	11.66	12.35	12.74	14.20	7.51	7.90	8.59	8.98	10.44
	6H	11.82	12.15	12.92	13.27	14.72	8.01	8.34	9.12	9.46	10.92
	8H	12.03	12.32	13.14	13.42	14.90	8.20	8.49	9.31	9.59	11.07
	12H	12.16	12.41	13.27	13.51	15.03	8.31	8.57	9.43	9.67	11.18
12H	4H	11.21	11.57	12.31	12.66	14.13	7.51	7.86	8.60	8.96	10.42
	6H	11.79	12.08	12.90	13.18	14.66	8.06	8.35	9.17	9.45	10.93
	8H	12.01	12.26	13.12	13.36	14.87	8.27	8.52	9.38	9.62	11.13

END OF REPORT