

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P919009

Luminaire Tested: DFN2DIP-HX3F0-080D030US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P919009
REPORT IS A COMBINATION OF REPORTS P900732 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-080D030US935-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8412.0 lumens
Efficiency: N/A
Efficacy: 81.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 102.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLLONL

Luminous Intensity Polar Plot

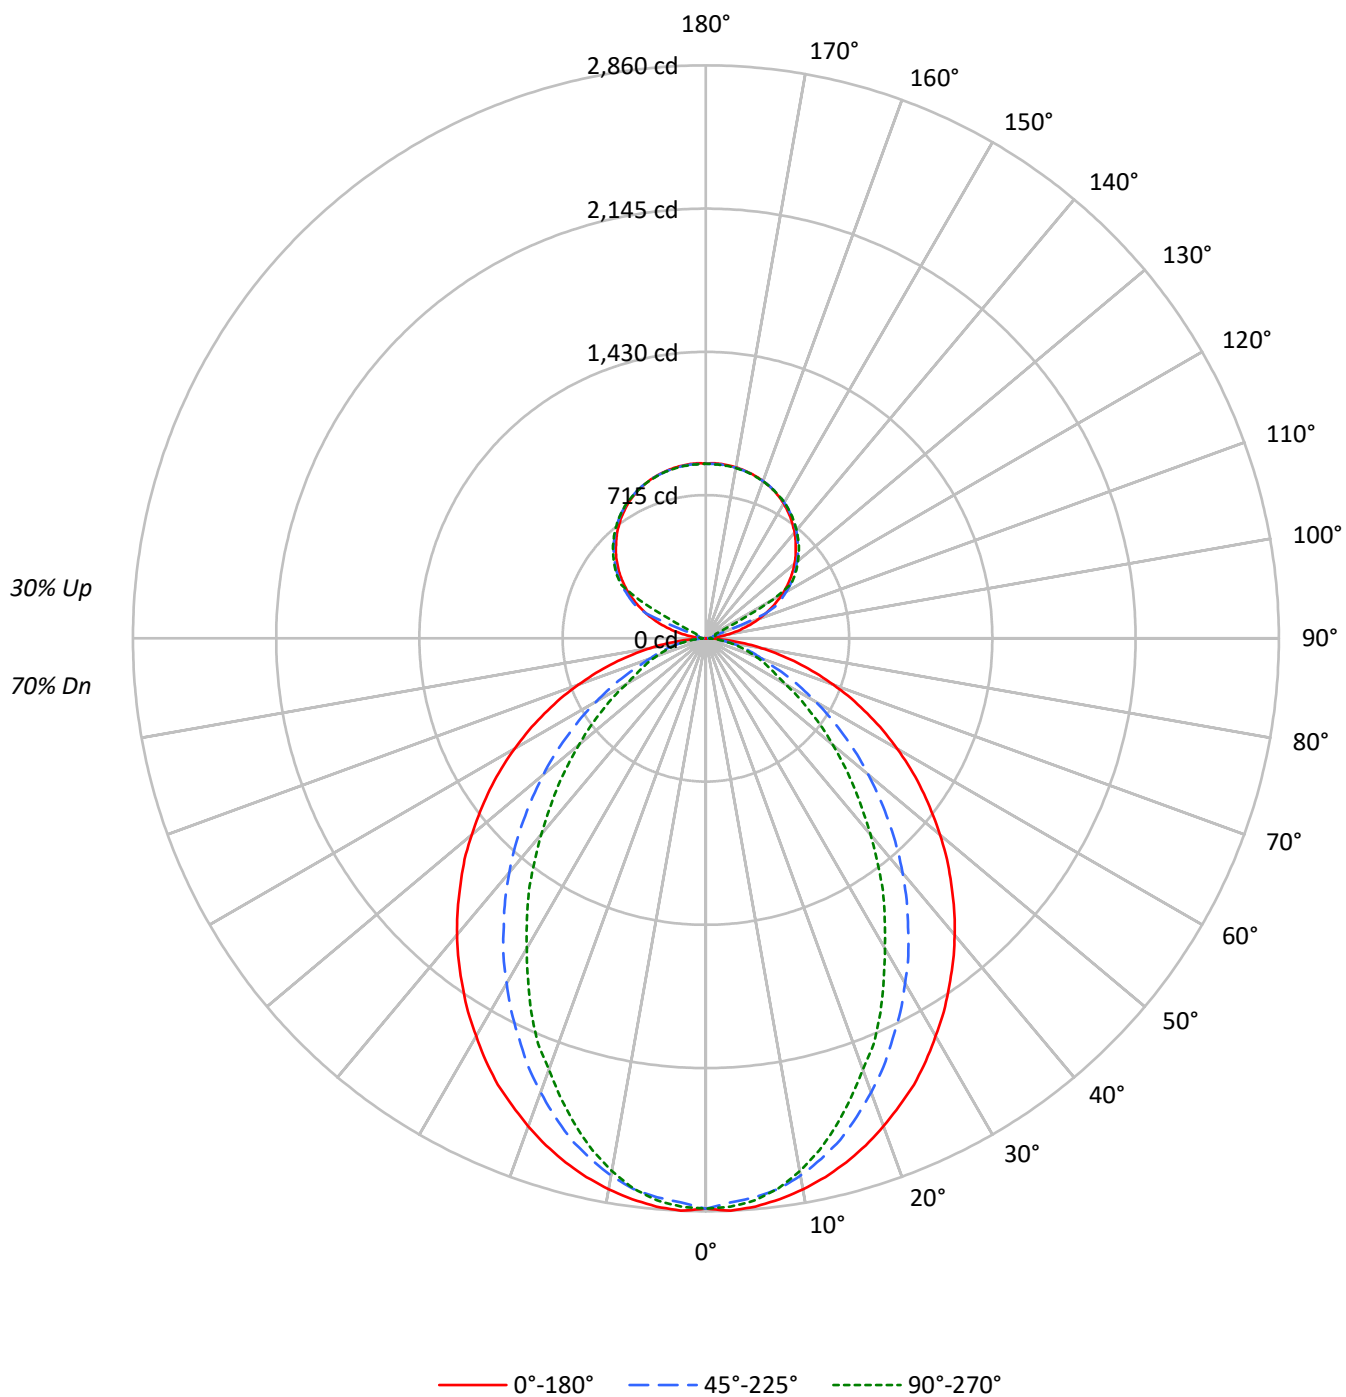

TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	93	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	59	57	55
3	86	77	70	64	82	73	67	62	66	61	57	59	55	52	53	50	48
4	79	69	61	55	75	65	58	53	59	54	49	53	49	45	48	45	42
5	73	62	54	48	69	59	52	46	53	47	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	32	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	37	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3298	3298	3298
5°	3301	3243	3264
10°	3267	3177	3156
15°	3221	3070	2990
20°	3160	2923	2787
25°	3097	2759	2592
30°	3014	2591	2344
35°	2932	2410	2126
40°	2849	2223	1877
45°	2752	2016	1651
50°	2652	1808	1430
55°	2547	1585	1219
60°	2426	1353	1002
65°	2287	1117	899
70°	2117	897	811
75°	1904	786	734
80°	1596	652	630
85°	1091	424	463

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2752 cd/sqm

TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	266.8	3.2
10°-20°	732.4	8.7
20°-30°	1028.3	12.2
30°-40°	1120.9	13.3
40°-50°	1030.3	12.2
50°-60°	809.1	9.6
60°-70°	526.6	6.3
70°-80°	271.1	3.2
80°-90°	70.7	0.8
90°-100°	28.7	0.3
100°-110°	107.2	1.3
110°-120°	284.2	3.4
120°-130°	471.3	5.6
130°-140°	500.7	6.0
140°-150°	465.3	5.5
150°-160°	374.1	4.4
160°-170°	241.1	2.9
170°-180°	83.0	1.0
0°-30°	2027.6	24.1
0°-40°	3148.5	37.4
0°-60°	4987.8	59.3
0°-90°	5856.3	69.6
90°-120°	420.1	5.0
90°-150°	1857.5	22.1
90°-180°	2556.0	30.4
0°-180°	8412.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2847	2847	2847	2847	2847	
5°	2847	2834	2800	2824	2816	270
15°	2708	2679	2592	2543	2517	763
25°	2458	2375	2205	2100	2061	1130
35°	2118	1986	1760	1597	1540	1326
45°	1731	1559	1288	1105	1043	1337
55°	1316	1116	837	683	634	1176
65°	889	680	448	361	353	881
75°	474	294	206	188	186	501
85°	111	57	49	49	49	127
90°	1	8	13	16	17	8
95°	41	20	24	28	27	49
105°	192	211	38	45	48	205
115°	363	373	389	97	52	357
125°	513	521	533	537	539	457
135°	635	645	650	657	655	490
145°	736	736	746	751	747	460
155°	810	805	812	816	811	373
165°	854	850	852	857	852	241
175°	874	869	870	875	869	83
180°	872	872	872	872	872	

TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2846.8	2846.8	2846.8	2846.8	2846.8
2.5°	2859.6	2846.8	2818.4	2844.3	2839.1
5°	2846.8	2834.0	2800.3	2823.6	2815.9
7.5°	2823.6	2808.2	2772.2	2782.3	2769.4
10°	2792.6	2774.7	2723.3	2715.3	2700.0
12.5°	2754.2	2730.9	2661.2	2645.8	2617.4
15°	2707.7	2679.3	2591.8	2542.9	2517.1
17.5°	2653.5	2612.3	2504.0	2447.5	2406.1
20°	2591.8	2540.1	2411.4	2347.2	2290.3
22.5°	2524.8	2465.5	2316.0	2228.5	2189.9
25°	2457.8	2375.3	2205.3	2099.8	2061.0
27.5°	2378.0	2290.3	2102.2	1981.2	1921.8
30°	2293.0	2194.9	1988.8	1857.6	1787.9
32.5°	2210.4	2091.9	1880.8	1726.1	1661.6
35°	2117.8	1986.3	1759.7	1597.4	1540.5
37.5°	2027.6	1885.8	1646.3	1468.3	1404.1
40°	1932.3	1777.8	1527.7	1344.8	1277.8
42.5°	1834.4	1669.6	1409.3	1218.6	1154.3
45°	1731.3	1558.6	1288.2	1105.1	1043.4
47.5°	1633.5	1450.6	1172.3	989.2	932.6
50°	1525.2	1342.4	1058.9	881.0	827.1
52.5°	1419.4	1226.1	950.6	780.7	731.8
55°	1316.4	1115.5	837.2	682.8	633.9
57.5°	1210.9	1004.8	736.9	592.6	551.3
60°	1102.6	896.6	631.1	499.9	458.7
62.5°	997.1	791.0	541.0	417.4	396.9
65°	888.9	680.0	448.2	360.8	352.8
67.5°	785.8	577.0	360.8	316.8	309.2
70°	677.6	476.7	298.8	273.0	262.7
72.5°	574.5	383.7	249.9	229.4	224.1
75°	474.0	293.6	206.1	188.0	185.6
77.5°	373.7	208.5	162.4	152.0	146.8
80°	280.7	149.6	123.6	113.4	113.4
82.5°	195.7	100.6	85.0	79.8	79.8
85°	110.7	56.6	48.9	48.9	48.9
87.5°	41.2	20.5	20.5	18.1	18.1
90°	0.6	7.6	12.6	15.8	17.0
92.5°	15.8	13.3	15.2	16.4	17.0
95°	41.0	20.1	24.5	27.8	27.1
97.5°	73.8	22.1	32.1	34.1	34.7
100°	111.7	25.2	36.0	41.0	42.3
102.5°	153.3	152.1	37.2	44.1	46.1
105°	191.7	210.7	38.5	45.4	48.0
107.5°	236.5	252.3	39.8	46.7	49.2
110°	279.5	292.7	110.4	47.4	49.9



TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	319.9	331.1	320.5	48.6	50.5
115°	362.7	373.4	389.2	97.1	51.7
117.5°	399.9	412.5	423.3	333.0	167.8
120°	441.5	451.0	462.4	469.9	384.8
122.5°	476.8	487.0	499.6	503.3	504.0
125°	512.8	521.0	533.0	537.4	539.3
127.5°	545.6	554.4	564.0	570.2	570.8
130°	576.5	586.7	593.6	600.5	599.9
132.5°	608.0	616.3	623.2	628.9	628.3
135°	634.6	644.7	650.3	656.7	655.4
137.5°	662.3	669.9	676.2	682.5	680.6
140°	689.4	694.5	701.4	707.1	704.0
142.5°	712.2	716.6	724.8	729.8	726.7
145°	736.2	735.5	746.2	750.6	747.4
147.5°	756.9	755.0	765.8	768.9	766.4
150°	777.1	772.7	782.8	786.5	783.4
152.5°	794.1	789.1	798.6	802.4	798.0
155°	810.5	804.9	812.4	816.2	811.2
157.5°	823.8	818.8	824.5	828.9	823.8
160°	835.2	831.4	835.2	839.0	834.5
162.5°	845.2	841.5	844.6	849.0	843.3
165°	854.0	850.3	852.2	856.6	852.2
167.5°	861.0	857.2	859.1	863.6	857.9
170°	866.7	862.9	864.2	868.6	862.9
172.5°	870.5	866.7	868.0	872.4	866.7
175°	873.6	869.2	870.5	874.9	868.6
177.5°	874.9	870.5	871.2	875.5	869.9
180°	871.8	871.8	871.8	871.8	871.8

TEST NUMBER: P919009

CATALOG NUMBER: DFN2DIP-HX3F0-080D030US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.91	13.93	13.69	14.73	15.69	8.89	9.91	9.66	10.70	11.66
	3H	14.60	15.51	15.39	16.31	17.31	10.09	11.00	10.88	11.80	12.80
	4H	15.21	16.07	16.02	16.88	17.88	10.54	11.40	11.35	12.21	13.22
	6H	15.63	16.43	16.45	17.25	18.26	10.87	11.66	11.69	12.48	13.50
	8H	15.76	16.52	16.59	17.35	18.37	10.96	11.72	11.79	12.56	13.57
	12H	15.83	16.54	16.66	17.38	18.42	11.01	11.73	11.84	12.56	13.61
4H	2H	12.95	13.81	13.76	14.62	15.63	9.50	10.36	10.31	11.17	12.18
	3H	14.79	15.50	15.61	16.35	17.37	10.86	11.58	11.69	12.42	13.44
	4H	15.48	16.13	16.32	16.98	18.02	11.42	12.06	12.25	12.91	13.96
	6H	16.00	16.56	16.85	17.43	18.48	11.84	12.40	12.69	13.27	14.32
	8H	16.18	16.70	17.03	17.56	18.63	11.97	12.49	12.83	13.36	14.42
	12H	16.28	16.75	17.15	17.63	18.70	12.04	12.51	12.92	13.39	14.47
8H	4H	15.46	15.99	16.32	16.85	17.92	11.71	12.23	12.56	13.09	14.16
	6H	16.03	16.46	16.91	17.37	18.43	12.22	12.66	13.11	13.56	14.63
	8H	16.24	16.62	17.13	17.52	18.61	12.41	12.80	13.31	13.70	14.78
	12H	16.38	16.72	17.28	17.61	18.75	12.54	12.87	13.43	13.76	14.90
12H	4H	15.42	15.89	16.30	16.78	17.85	11.72	12.19	12.59	13.07	14.14
	6H	16.00	16.39	16.90	17.29	18.37	12.27	12.66	13.17	13.56	14.64
	8H	16.23	16.57	17.12	17.46	18.59	12.49	12.82	13.38	13.71	14.85

END OF REPORT