

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921705

Luminaire Tested: DFN2DIP-HX3F0-060D070US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921705
REPORT IS A COMBINATION OF REPORTS P900784 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-060D070US940-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10727.3 lumens
Efficiency: N/A
Efficacy: 97.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLLONL

Luminous Intensity Polar Plot

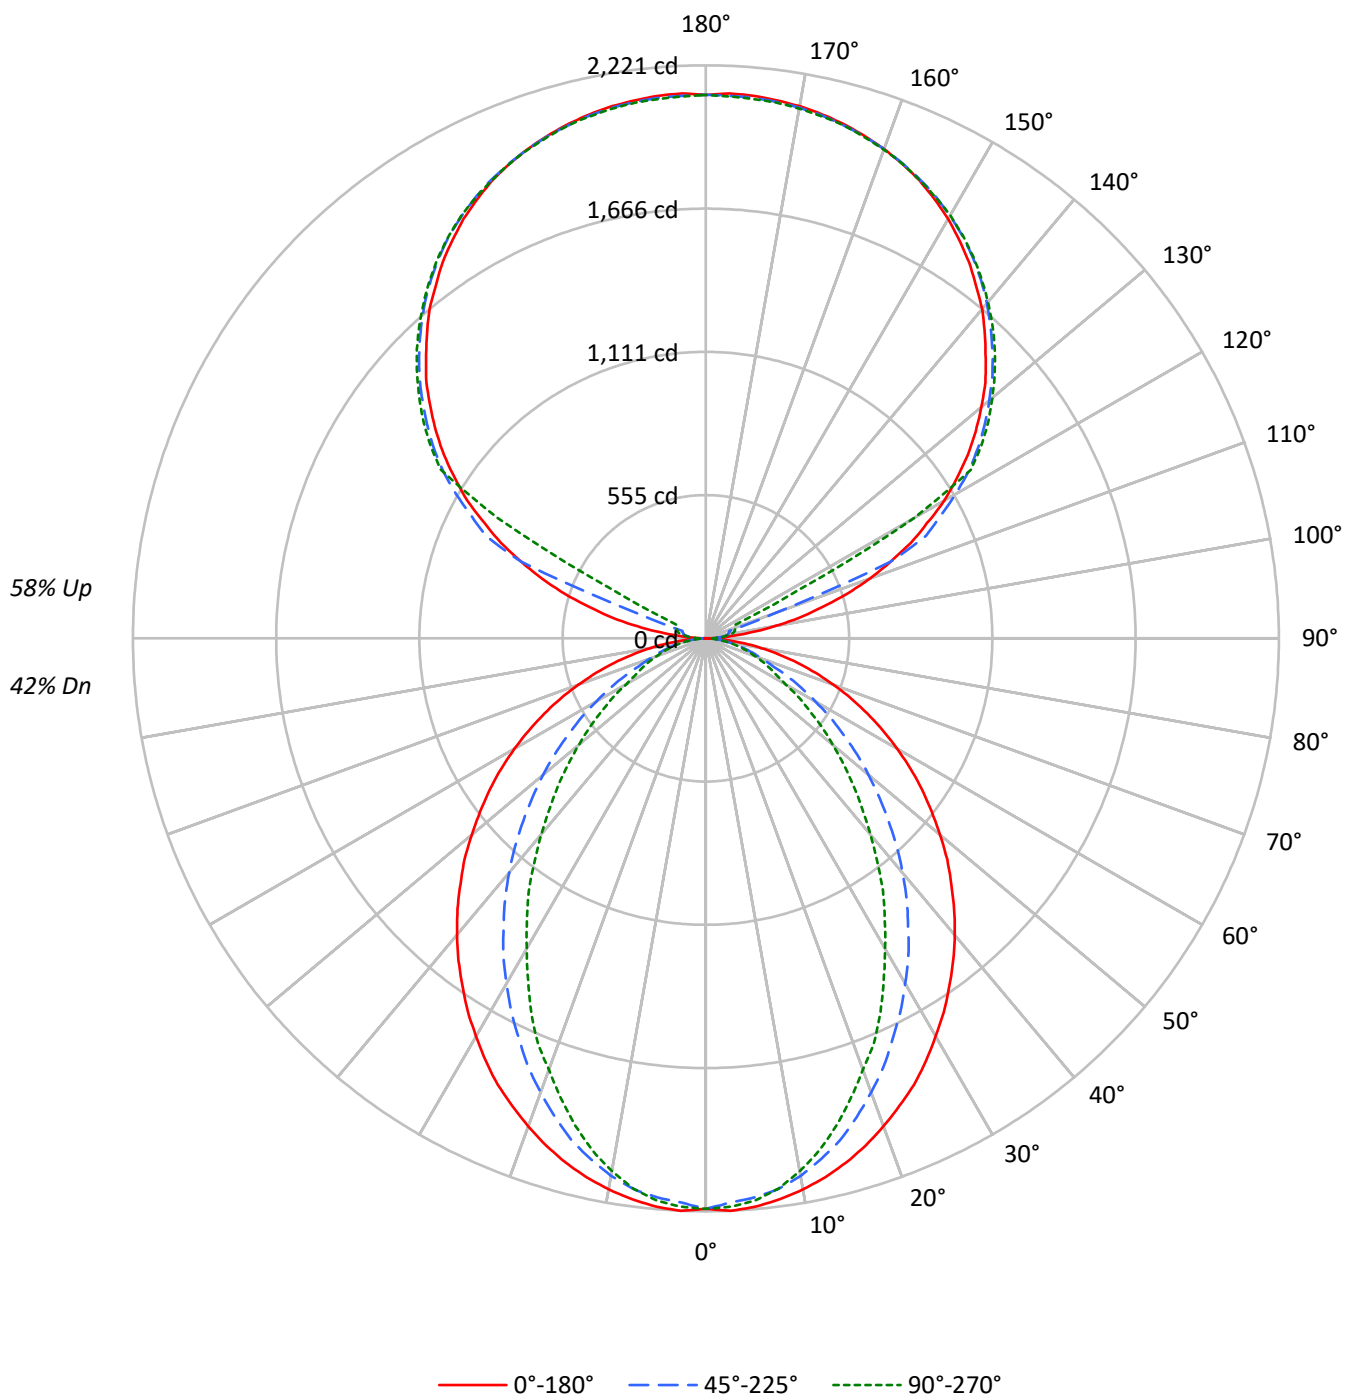

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	89	85	88	85	81	79	70	68	66	56	55	54	44	43	42
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	81	72	65	59	74	66	60	55	55	50	47	45	42	39	35	33	31
4	74	64	56	50	67	59	52	47	49	44	40	40	36	34	32	29	27
5	68	57	49	43	62	52	46	40	44	39	35	36	32	29	29	26	24
6	63	51	43	38	57	47	40	35	40	34	31	33	29	26	26	23	21
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	27	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	21	18	16
10	47	35	28	24	43	33	26	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2561	2561	2561
5°	2564	2519	2536
10°	2538	2468	2452
15°	2502	2384	2323
20°	2454	2270	2165
25°	2406	2143	2013
30°	2341	2012	1820
35°	2277	1872	1651
40°	2213	1727	1458
45°	2138	1566	1282
50°	2060	1404	1111
55°	1979	1231	947
60°	1885	1051	778
65°	1776	868	698
70°	1645	697	630
75°	1479	611	570
80°	1240	506	490
85°	847	330	360

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2138 cd/sqm

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	1.9
10°-20°	568.9	5.3
20°-30°	798.7	7.4
30°-40°	870.7	8.1
40°-50°	800.3	7.5
50°-60°	628.5	5.9
60°-70°	409.1	3.8
70°-80°	210.6	2.0
80°-90°	57.5	0.5
90°-100°	69.5	0.6
100°-110°	259.0	2.4
110°-120°	686.8	6.4
120°-130°	1139.1	10.6
130°-140°	1209.9	11.3
140°-150°	1124.5	10.5
150°-160°	904.1	8.4
160°-170°	582.6	5.4
170°-180°	200.5	1.9
0°-30°	1574.9	14.7
0°-40°	2445.6	22.8
0°-60°	3874.3	36.1
0°-90°	4551.4	42.4
90°-120°	1015.2	9.5
90°-150°	4488.7	41.8
90°-180°	6176.0	57.6
0°-180°	10727.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	1	18	30	38	41	10
95°	99	49	59	67	66	117
105°	463	509	93	110	116	495
115°	876	902	940	235	125	863
125°	1239	1259	1288	1299	1303	1105
135°	1534	1558	1572	1587	1584	1185
145°	1779	1777	1803	1814	1806	1113
155°	1959	1945	1963	1972	1960	903
165°	2064	2055	2059	2070	2059	583
175°	2111	2100	2104	2114	2099	201
180°	2107	2107	2107	2107	2107	

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	1.4	18.3	30.4	38.2	41.1
92.5°	38.2	32.0	36.6	39.7	41.1
95°	99.0	48.7	59.4	67.1	65.5
97.5°	178.3	53.4	77.7	82.4	83.8
100°	269.9	61.0	86.9	99.0	102.1
102.5°	370.3	367.5	90.0	106.6	111.3
105°	463.4	509.2	93.0	109.7	115.8
107.5°	571.6	609.7	96.1	112.8	119.0
110°	675.4	707.2	266.8	114.4	120.4

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	772.9	800.2	774.4	117.3	122.0
115°	876.5	902.3	940.5	234.8	125.1
117.5°	966.4	996.8	1022.9	804.8	405.5
120°	1067.0	1089.8	1117.4	1135.7	929.9
122.5°	1152.3	1176.7	1207.4	1216.4	1218.0
125°	1239.2	1259.1	1288.1	1298.8	1303.2
127.5°	1318.5	1339.8	1362.8	1378.0	1379.5
130°	1393.2	1417.6	1434.3	1451.2	1449.7
132.5°	1469.4	1489.3	1506.0	1519.7	1518.3
135°	1533.5	1557.9	1571.6	1586.9	1583.9
137.5°	1600.4	1618.8	1634.1	1649.4	1644.8
140°	1666.0	1678.3	1695.0	1708.7	1701.1
142.5°	1721.0	1731.7	1751.4	1763.5	1756.0
145°	1779.0	1777.4	1803.2	1813.9	1806.3
147.5°	1829.1	1824.6	1850.5	1858.1	1852.1
150°	1877.9	1867.3	1891.8	1900.8	1893.2
152.5°	1919.0	1906.9	1929.8	1938.9	1928.3
155°	1958.7	1945.1	1963.4	1972.5	1960.3
157.5°	1990.7	1978.6	1992.3	2003.0	1990.7
160°	2018.3	2009.0	2018.3	2027.3	2016.6
162.5°	2042.6	2033.5	2041.0	2051.7	2038.0
165°	2063.9	2054.9	2059.3	2070.0	2059.3
167.5°	2080.7	2071.4	2076.2	2086.9	2073.1
170°	2094.4	2085.3	2088.3	2099.0	2085.3
172.5°	2103.5	2094.4	2097.6	2108.2	2094.4
175°	2111.1	2100.4	2103.5	2114.2	2099.0
177.5°	2114.2	2103.5	2105.1	2115.9	2102.0
180°	2106.6	2106.6	2106.6	2106.6	2106.6

TEST NUMBER: P921705

CATALOG NUMBER: DFN2DIP-HX3F0-060D070US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.62	10.39	10.65	11.42	12.80	5.60	6.37	6.62	7.40	8.78
	3H	11.29	11.98	12.32	13.01	14.41	6.78	7.47	7.81	8.51	9.90
	4H	11.89	12.54	12.93	13.58	14.99	7.22	7.88	8.27	8.92	10.32
	6H	12.30	12.90	13.36	13.95	15.36	7.54	8.14	8.59	9.18	10.60
	8H	12.42	12.99	13.48	14.05	15.46	7.62	8.19	8.69	9.26	10.67
	12H	12.48	13.02	13.54	14.07	15.51	7.66	8.21	8.73	9.26	10.70
4H	2H	9.63	10.28	10.69	11.32	12.73	6.18	6.83	7.24	7.88	9.28
	3H	11.45	11.99	12.51	13.06	14.48	7.52	8.06	8.58	9.13	10.55
	4H	12.13	12.63	13.20	13.69	15.13	8.06	8.56	9.13	9.62	11.06
	6H	12.63	13.06	13.71	14.14	15.58	8.47	8.90	9.55	9.98	11.42
	8H	12.80	13.20	13.88	14.28	15.73	8.60	9.00	9.68	10.07	11.52
	12H	12.89	13.25	13.99	14.34	15.80	8.66	9.02	9.75	10.11	11.56
8H	4H	12.09	12.49	13.17	13.57	15.02	8.33	8.73	9.41	9.81	11.26
	6H	12.65	12.98	13.75	14.09	15.54	8.84	9.17	9.94	10.29	11.74
	8H	12.86	13.15	13.97	14.25	15.71	9.03	9.32	10.14	10.42	11.89
	12H	12.99	13.24	14.10	14.34	15.84	9.14	9.40	10.25	10.49	12.00
12H	4H	12.04	12.40	13.14	13.49	14.94	8.33	8.69	9.43	9.78	11.24
	6H	12.62	12.91	13.73	14.01	15.48	8.89	9.18	10.00	10.28	11.75
	8H	12.84	13.09	13.94	14.18	15.69	9.09	9.35	10.20	10.44	11.95

END OF REPORT