

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P921717

Luminaire Tested: DFN2DIP-HX3F0-070D040US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P921717
REPORT IS A COMBINATION OF REPORTS P900744 AND P897645
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-HX3F0-070D040US940-RLLONL
Description: 3 foot, Hexagon Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8836.8 lumens
Efficiency: N/A
Efficacy: 89.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.84' x L: 3.28' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 98.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLLONL

Luminous Intensity Polar Plot

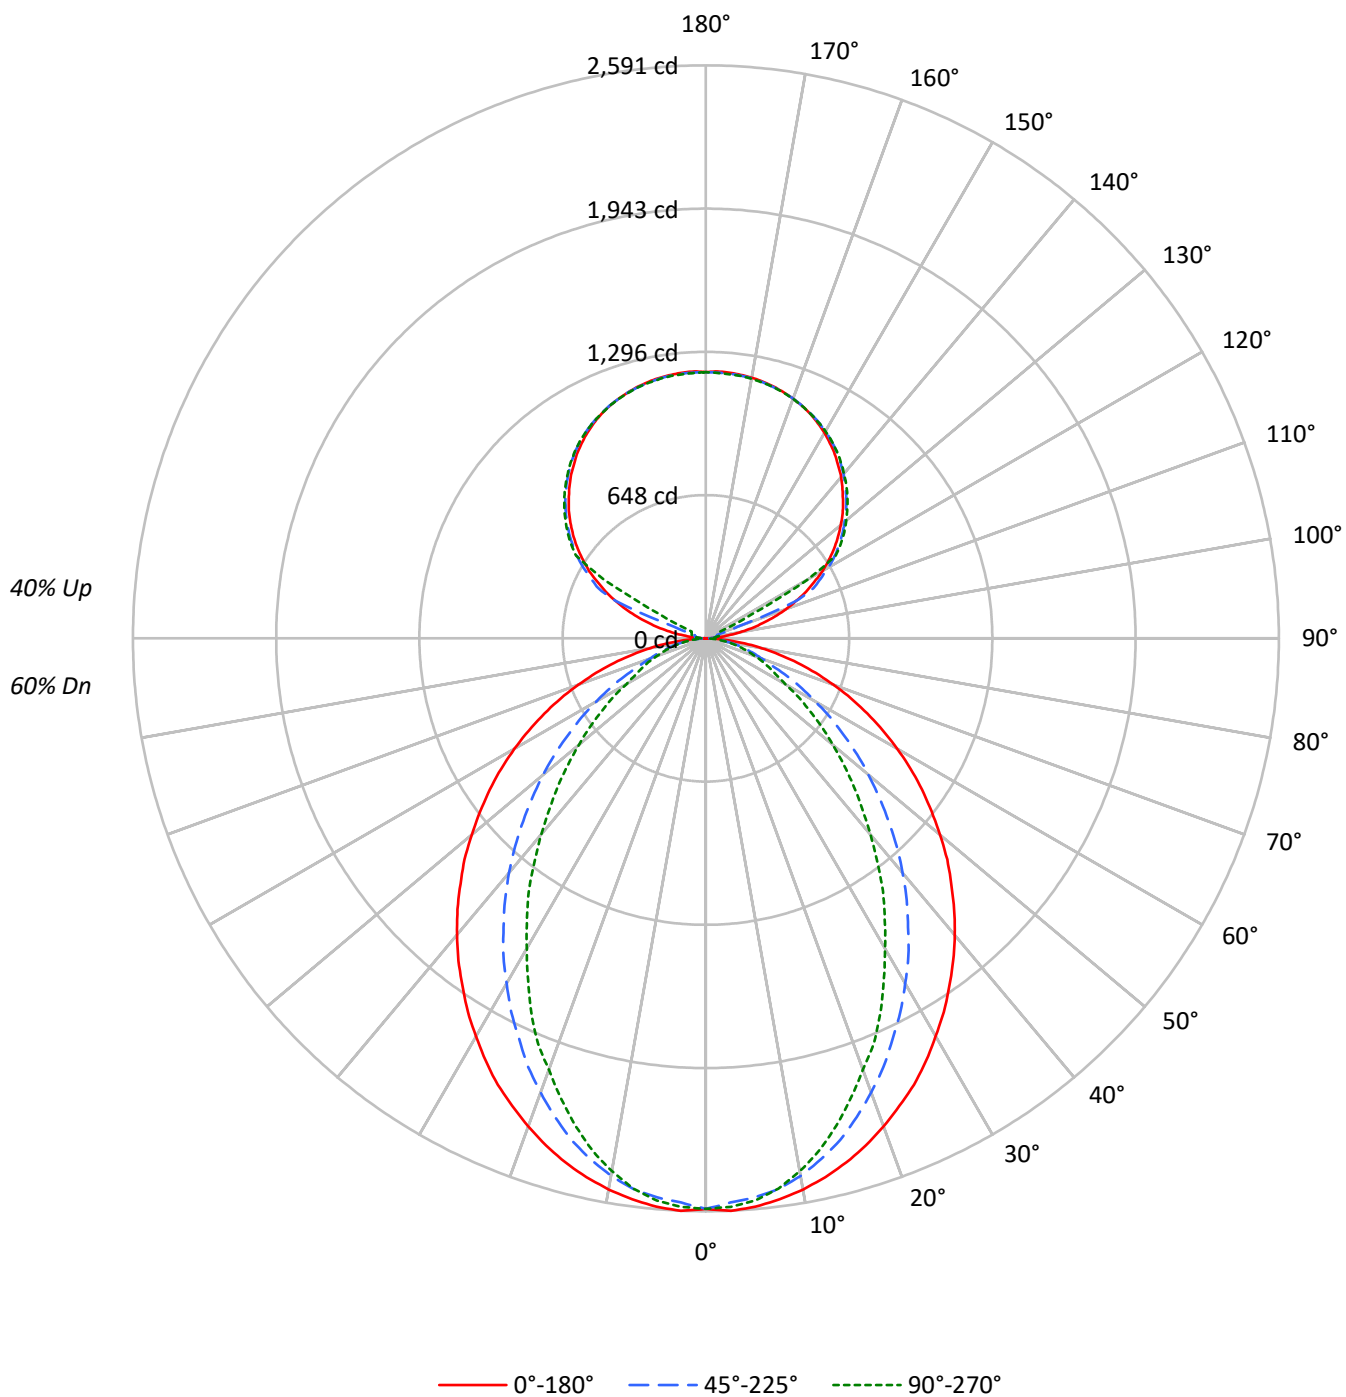

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2988	2988	2988
5°	2992	2939	2958
10°	2961	2879	2860
15°	2919	2782	2710
20°	2863	2649	2526
25°	2807	2500	2348
30°	2731	2347	2124
35°	2657	2184	1927
40°	2582	2015	1701
45°	2494	1827	1496
50°	2403	1638	1296
55°	2308	1437	1104
60°	2199	1226	907
65°	2072	1013	815
70°	1919	813	735
75°	1726	712	665
80°	1447	591	571
85°	988	384	420

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2494 cd/sqm

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.8	2.7
10°-20°	663.7	7.5
20°-30°	931.9	10.5
30°-40°	1015.8	11.5
40°-50°	933.6	10.6
50°-60°	733.2	8.3
60°-70°	477.3	5.4
70°-80°	245.7	2.8
80°-90°	64.8	0.7
90°-100°	39.7	0.4
100°-110°	148.0	1.7
110°-120°	392.4	4.4
120°-130°	650.9	7.4
130°-140°	691.4	7.8
140°-150°	642.6	7.3
150°-160°	516.6	5.8
160°-170°	332.9	3.8
170°-180°	114.6	1.3
0°-30°	1837.4	20.8
0°-40°	2853.2	32.3
0°-60°	4520.0	51.2
0°-90°	5307.8	60.1
90°-120°	580.1	6.6
90°-150°	2565.0	29.0
90°-180°	3529.0	39.9
0°-180°	8836.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2580	2580	2580	2580	2580	
5°	2580	2568	2538	2559	2552	245
15°	2454	2428	2349	2304	2281	691
25°	2227	2152	1998	1903	1868	1024
35°	1919	1800	1595	1448	1396	1201
45°	1569	1412	1167	1002	946	1212
55°	1193	1011	759	619	574	1066
65°	806	616	406	327	320	799
75°	430	266	187	170	168	454
85°	100	51	44	44	44	115
90°	1	10	17	22	24	8
95°	56	28	34	38	38	67
105°	265	291	53	63	66	283
115°	501	516	537	134	72	493
125°	708	720	736	742	745	632
135°	876	890	898	907	905	677
145°	1016	1016	1030	1036	1032	636
155°	1119	1112	1122	1127	1120	516
165°	1179	1174	1177	1183	1177	333
175°	1206	1200	1202	1208	1199	115
180°	1204	1204	1204	1204	1204	

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2579.8	2579.8	2579.8	2579.8	2579.8
2.5°	2591.4	2579.8	2554.0	2577.6	2572.9
5°	2579.8	2568.1	2537.7	2558.8	2551.8
7.5°	2558.8	2544.9	2512.2	2521.3	2509.7
10°	2530.8	2514.4	2467.8	2460.7	2446.8
12.5°	2495.8	2474.8	2411.6	2397.7	2371.9
15°	2453.7	2427.9	2348.7	2304.4	2281.1
17.5°	2404.7	2367.3	2269.2	2217.9	2180.5
20°	2348.7	2301.9	2185.2	2127.0	2075.5
22.5°	2288.0	2234.3	2098.7	2019.5	1984.6
25°	2227.3	2152.5	1998.4	1902.8	1867.7
27.5°	2155.0	2075.5	1905.1	1795.4	1741.6
30°	2078.0	1989.0	1802.2	1683.4	1620.2
32.5°	2003.1	1895.7	1704.4	1564.2	1505.7
35°	1919.1	1800.0	1594.7	1447.6	1396.1
37.5°	1837.5	1708.9	1491.9	1330.6	1272.5
40°	1751.0	1611.1	1384.4	1218.7	1158.0
42.5°	1662.3	1513.0	1277.1	1104.2	1046.1
45°	1569.0	1412.4	1167.4	1001.5	945.5
47.5°	1480.2	1314.6	1062.4	896.4	845.2
50°	1382.2	1216.5	959.6	798.3	749.6
52.5°	1286.3	1111.2	861.5	707.4	663.1
55°	1192.9	1010.8	758.7	618.8	574.4
57.5°	1097.3	910.5	667.8	537.0	499.6
60°	999.3	812.4	571.9	453.1	415.6
62.5°	903.6	716.8	490.2	378.3	359.6
65°	805.5	616.3	406.3	327.0	319.8
67.5°	712.1	522.9	327.0	287.0	280.2
70°	614.0	431.9	270.7	247.4	238.0
72.5°	520.7	347.8	226.4	207.9	203.1
75°	429.5	266.0	186.7	170.4	168.2
77.5°	338.6	189.0	147.1	137.7	133.0
80°	254.4	135.5	112.0	102.8	102.8
82.5°	177.4	91.1	77.0	72.3	72.3
85°	100.3	51.3	44.3	44.3	44.3
87.5°	37.4	18.5	18.5	16.3	16.3
90°	0.8	10.4	17.4	21.8	23.5
92.5°	21.8	18.3	20.9	22.6	23.5
95°	56.5	27.8	33.9	38.3	37.5
97.5°	101.9	30.5	44.4	47.1	47.9
100°	154.2	34.9	49.7	56.5	58.3
102.5°	211.6	210.0	51.4	60.9	63.6
105°	264.7	291.0	53.1	62.7	66.2
107.5°	326.6	348.4	54.9	64.5	67.9
110°	385.9	404.1	152.5	65.4	68.8

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	441.7	457.3	442.5	67.1	69.7
115°	500.8	515.6	537.4	134.1	71.5
117.5°	552.2	569.6	584.5	459.9	231.7
120°	609.8	622.8	638.5	649.0	531.4
122.5°	658.4	672.4	689.9	695.1	696.0
125°	708.1	719.5	736.0	742.2	744.8
127.5°	753.4	765.6	778.7	787.5	788.3
130°	796.1	810.1	819.6	829.2	828.4
132.5°	839.6	851.0	860.6	868.4	867.6
135°	876.3	890.3	898.0	906.8	905.1
137.5°	914.5	925.0	933.8	942.4	939.9
140°	952.0	959.0	968.6	976.4	972.1
142.5°	983.5	989.5	1000.9	1007.7	1003.4
145°	1016.5	1015.7	1030.4	1036.5	1032.2
147.5°	1045.2	1042.6	1057.4	1061.8	1058.4
150°	1073.1	1067.0	1081.0	1086.2	1081.8
152.5°	1096.6	1089.7	1102.7	1108.0	1101.9
155°	1119.3	1111.5	1121.9	1127.1	1120.2
157.5°	1137.6	1130.6	1138.5	1144.6	1137.6
160°	1153.2	1148.0	1153.2	1158.4	1152.4
162.5°	1167.2	1162.0	1166.4	1172.4	1164.6
165°	1179.4	1174.2	1176.8	1182.9	1176.8
167.5°	1189.0	1183.7	1186.4	1192.5	1184.6
170°	1196.9	1191.6	1193.3	1199.4	1191.6
172.5°	1202.0	1196.9	1198.6	1204.7	1196.9
175°	1206.3	1200.2	1202.0	1208.1	1199.4
177.5°	1208.1	1202.0	1202.9	1209.1	1201.2
180°	1203.8	1203.8	1203.8	1203.8	1203.8

TEST NUMBER: P921717

CATALOG NUMBER: DFN2DIP-HX3F0-070D040US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.80	12.72	12.67	13.61	14.73	7.77	8.69	8.65	9.58	10.71
	3H	13.47	14.30	14.36	15.20	16.34	8.96	9.79	9.85	10.69	11.83
	4H	14.08	14.86	14.98	15.76	16.92	9.42	10.19	10.32	11.10	12.26
	6H	14.50	15.22	15.41	16.13	17.30	9.74	10.45	10.65	11.36	12.54
	8H	14.63	15.31	15.55	16.24	17.41	9.83	10.51	10.75	11.44	12.61
	12H	14.69	15.34	15.61	16.26	17.45	9.87	10.52	10.80	11.44	12.64
4H	2H	11.83	12.60	12.73	13.51	14.67	8.38	9.15	9.28	10.06	11.22
	3H	13.65	14.30	14.57	15.24	16.41	9.73	10.37	10.65	11.31	12.48
	4H	14.34	14.93	15.27	15.86	17.06	10.28	10.86	11.20	11.80	12.99
	6H	14.86	15.36	15.80	16.32	17.52	10.70	11.20	11.64	12.16	13.36
	8H	15.03	15.50	15.97	16.45	17.66	10.82	11.30	11.77	12.24	13.46
	12H	15.12	15.55	16.09	16.52	17.73	10.89	11.32	11.85	12.28	13.50
8H	4H	14.32	14.79	15.26	15.74	16.95	10.56	11.03	11.50	11.98	13.19
	6H	14.88	15.27	15.85	16.26	17.47	11.07	11.46	12.04	12.45	13.67
	8H	15.09	15.43	16.07	16.41	17.65	11.26	11.61	12.24	12.59	13.82
	12H	15.23	15.53	16.21	16.50	17.78	11.38	11.68	12.36	12.66	13.94
12H	4H	14.27	14.70	15.23	15.66	16.88	10.57	10.99	11.53	11.96	13.18
	6H	14.85	15.20	15.83	16.18	17.41	11.12	11.47	12.10	12.45	13.68
	8H	15.07	15.38	16.05	16.35	17.63	11.33	11.63	12.31	12.61	13.89

END OF REPORT